

DOKUMEN BUKTI KORESPONDENSI ARTIKEL JURNAL

1. Email Korespondensi Pengusul dan Editor Selama Proses Review

(Mulai dari Submit – Revisi – Accepted – Resubmit – Publish)

- a. Email Subject: Submission received
- b. Email Subject: Major revision
- c. Email Subject: Revised version received
- d. Email Subject: Accepted for publication
- e. Email Subject: Manuscript resubmitted
- f. Email Subject: Paper has been published

2. Komentar dan Masukan Reviewers Terhadap Substansi Artikel

- a. Komentar Reviewer 1
- b. Komentar Reviewer 2
- c. Komentar Reviewer 3

3. Tanggapan Pengusul Terhadap Komentar Reviewer

- a. Jawaban Terhadap Komentar Reviewer 1
- b. Jawaban Terhadap Komentar Reviewer 2
- c. Jawaban Terhadap Komentar Reviewer 3

4. Perbaikan Secara Langsung Pada Revisi Artikel

- 1 -

Email Korespondensi Pengusul dan Editor Selama Proses Review
(Mulai dari Submit – Revisi – Accepted – Resubmit – Publish)

[Energies] Manuscript ID: energies-2107585 - Submission Received

1 message

Editorial Office <energies@mdpi.com>

Sat, Dec 3, 2022 at 3:46 PM

Reply-To: energies@mdpi.com

To: Muhammad Bachtiar Nappu <bachtiar@eng.unhas.ac.id>

Cc: Ardiaty Arief <ardiaty@eng.unhas.ac.id>, Willy Akbar Ajami <wawillyakbar@gmail.com>

Dear Dr. Nappu,

Thank you very much for uploading the following manuscript to the MDPI submission system. One of our editors will be in touch with you soon.

Journal name: Energies

Manuscript ID: energies-2107585

Type of manuscript: Article

Title: Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF

Authors: Muhammad Bachtiar Nappu *, Ardiaty Arief, Willy Akbar Ajami

Received: 3 December 2022

E-mails: bachtiar@eng.unhas.ac.id, ardiaty@eng.unhas.ac.id, wawillyakbar@gmail.com

Submitted to section: A: Sustainable Energy,

https://www.mdpi.com/journal/energies/sections/sustainable_energy

Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems

https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems

You can follow progress of your manuscript at the following link (login required):

https://susy.mdpi.com/user/manuscripts/review_info/b1b655471f1bab514170ef59c5c83a6b

The following points were confirmed during submission:

1. Energies is an open access journal with publishing fees of 2200 CHF for an accepted paper (see <https://www.mdpi.com/about/apc/> for details). This manuscript, if accepted, will be published under an open access Creative Commons CC BY license (<https://creativecommons.org/licenses/by/4.0/>), and I agree to pay the Article Processing Charges as described on the journal webpage (<https://www.mdpi.com/journal/energies/apc/>). See <https://www.mdpi.com/about/openaccess> for more information about open access publishing.

Please note that you may be entitled to a discount if you have previously received a discount code or if your institute is participating in the MDPI Institutional Open Access Program (IOAP), for more information see <https://www.mdpi.com/about/ioap>. If you have been granted any other special discounts for your submission, please contact the Energies editorial office.

2. I understand that:

a. If previously published material is reproduced in my manuscript, I will provide proof that I have obtained the necessary copyright permission.

(Please refer to the Rights & Permissions website:

<https://www.mdpi.com/authors/rights>).

b. My manuscript is submitted on the understanding that it has not been published in or submitted to another peer-reviewed journal. Exceptions to this rule are papers containing material disclosed at conferences. I confirm that I will inform the journal editorial office if this is the case for my manuscript. I confirm that all authors are familiar with and agree with submission of the contents of the manuscript. The journal editorial office reserves the right to contact all authors to confirm this in case of doubt. I

will provide email addresses for all authors and an institutional e-mail address for at least one of the co-authors, and specify the name, address and e-mail for invoicing purposes.

If you have any questions, please do not hesitate to contact the Energies editorial office at energies@mdpi.com

Kind regards,
Energies Editorial Office
St. Alban-Anlage 66, 4052 Basel, Switzerland
E-Mail: energies@mdpi.com
Tel. +41 61 683 77 34
Fax: +41 61 302 89 18

*** This is an automatically generated email ***

[Energies] Manuscript ID: energies-2107585 - Major Revisions

6 messages

Energies Editorial Office <energies@mdpi.com>

Mon, Dec 26, 2022 at 2:41 PM

Reply-To: nyxia.wang@mdpi.com

To: Muhammad Bachtiar Nappu <bachtiar@eng.unhas.ac.id>

Cc: Ardiaty Arief <ardiaty@eng.unhas.ac.id>, Willy Akbar Ajami <wawillyakbar@gmail.com>, Energies Editorial Office <energies@mdpi.com>

Dear Dr. Nappu,

Thank you again for your manuscript submission:

Manuscript ID: energies-2107585

Type of manuscript: Article

Title: Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF

Authors: Muhammad Bachtiar Nappu *, Ardiaty Arief, Willy Akbar Ajami

Received: 3 December 2022

E-mails: bachtiar@eng.unhas.ac.id, ardiaty@eng.unhas.ac.id, wawillyakbar@gmail.com

Submitted to section: A: Sustainable Energy,

https://www.mdpi.com/journal/energies/sections/sustainable_energy

Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems

https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems

Your manuscript has now been reviewed by experts in the field. Please find your manuscript with the referee reports at this link:

<https://susy.mdpi.com/user/manuscripts/resubmit/b1b655471f1bab514170ef59c5c83a6b>

Please revise the manuscript according to the referees' comments and upload the revised file within 10 days.

Please use the version of your manuscript found at the above link for your revisions.

(I) Please check that all references are relevant to the contents of the manuscript.

(II) Any revisions to the manuscript should be marked up using the "Track Changes" function if you are using MS Word/LaTeX, such that any changes can be easily viewed by the editors and reviewers.

(III) Please provide a cover letter to explain, point by point, the details of the revisions to the manuscript and your responses to the referees' comments.

(IV) If you found it impossible to address certain comments in the review reports, please include an explanation in your appeal.

(V) The revised version will be sent to the editors and reviewers.

If one of the referees has suggested that your manuscript should undergo extensive English revisions, please address this issue during revision. We propose that you use one of the editing services listed at <https://www.mdpi.com/authors/english> or have your manuscript checked by a native English-speaking colleague.

Do not hesitate to contact us if you have any questions regarding the revision of your manuscript. We look forward to hearing from you soon.

Kind regards,
Ms. Nyxia Wang

[Energies] Manuscript ID: energies-2107585 - Revised Version Received

1 message

Energies Editorial Office <energies@mdpi.com>

Thu, Jan 26, 2023 at 11:25 AM

Reply-To: elicia.xu@mdpi.com

To: Muhammad Bachtiar Nappu <bachtiar@eng.unhas.ac.id>

Cc: Ardiaty Arief <ardiaty@eng.unhas.ac.id>, Willy Akbar Ajami <wawillyakbar@gmail.com>, Energies Editorial Office <energies@mdpi.com>

Dear Dr. Nappu,

Thank you very much for providing the revised version of your paper:

Manuscript ID: energies-2107585

Type of manuscript: Article

Title: Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF

Authors: Muhammad Bachtiar Nappu *, Ardiaty Arief, Willy Akbar Ajami

Received: 3 December 2022

E-mails: bachtiar@eng.unhas.ac.id, ardiaty@eng.unhas.ac.id, wawillyakbar@gmail.com

Submitted to section: A: Sustainable Energy,

https://www.mdpi.com/journal/energies/sections/sustainable_energy

Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems

https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems

https://susy.mdpi.com/user/manuscripts/review_info/b1b655471f1bab514170ef59c5c83a6b

We will continue processing your paper and will keep you informed about the status of your submission.

Kind regards,

Elicia Xu

Assistant Editor

Email: elicia.xu@mdpi.com

MDPI Branch Office, TianJin

Room 1804, Tianjin-Lujiazui Financial Plaza Tower A, Hongqiao District, Tianjin

Tel./Fax: +86 22 2727 5507

Energies (IF: 3.252; CiteScore: 5.0; <http://www.mdpi.com/journal/energies>)

LinkedIn: <https://www.linkedin.com/company/energies-mdpi/>

Twitter: @energies_MDPI

Editor's Choice: https://www.mdpi.com/journal/energies/editors_choice

Performance Enhancement of a Multiresonant Piezoelectric Energy Harvester for Low Frequency Vibrations

<http://www.mdpi.com/1996-1073/12/14/2770>

Energy Retrofitting Effects on the Energy Flexibility of Dwellings

<http://www.mdpi.com/1996-1073/12/14/2788>

You are welcome to download your annual contribution report at

https://susy.mdpi.com/user/manage_accounts

Disclaimer: MDPI recognizes the importance of data privacy and protection. We treat personal data in line with the General Data Protection Regulation (GDPR) and with what the community expects of us. The information contained in this message is confidential and intended solely for the use of the individual or entity to whom it is addressed. If you have received this message in error, please notify me and delete this message from your system.

You may not copy this message in its entirety or in part, or disclose its contents to anyone.

[Energies] Manuscript ID: energies-2107585 - Accepted for Publication

1 message

Energies Editorial Office <energies@mdpi.com>

Wed, Feb 1, 2023 at 9:21 AM

Reply-To: Nyxia Wang <nyxia.wang@mdpi.com>, Energies Editorial Office <energies@mdpi.com>

To: Muhammad Bachtiar Nappu <bachtiar@eng.unhas.ac.id>

Cc: Ardiaty Arief <ardiaty@eng.unhas.ac.id>, Willy Akbar Ajami <wawillyakbar@gmail.com>, Energies Editorial Office <energies@mdpi.com>, Nyxia Wang <nyxia.wang@mdpi.com>

Dear Dr. Nappu,

Congratulations on the acceptance of your manuscript, and thank you for submitting your work to Energies:

Manuscript ID: energies-2107585

Type of manuscript: Article

Title: Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF

Authors: Muhammad Bachtiar Nappu *, Ardiaty Arief, Willy Akbar Ajami

Received: 3 December 2022

E-mails: bachtiar@eng.unhas.ac.id, ardiaty@eng.unhas.ac.id, wawillyakbar@gmail.com

Submitted to section: A: Sustainable Energy,

https://www.mdpi.com/journal/energies/sections/sustainable_energy

Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems

https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems

https://susy.mdpi.com/user/manuscripts/review_info/b1b655471f1bab514170ef59c5c83a6b

We will now edit and finalize your paper, which will then be returned to you for your approval. Within the next couple of days, an invoice concerning the article processing charge (APC) for publication in this open access journal will be sent by email from the Editorial Office in Basel, Switzerland.

If, however, extensive English edits are required to your manuscript, we will need to return the paper requesting improvements throughout.

We encourage you to set up your profile at SciProfiles.com, MDPI's researcher network platform. Articles you publish with MDPI will be linked to your SciProfiles page, where colleagues and peers will be able to see all of your publications, citations, as well as other academic contributions.

We also invite you to contribute to Encyclopedia (<https://encyclopedia.pub>), a scholarly platform providing accurate information about the latest research results. You can adapt parts of your paper to provide valuable reference information, via Encyclopedia, for others both within the field and beyond.

Kind regards,
Enrico Sciubba
Editor-in-Chief

[Energies] Manuscript ID: energies-2107585 - Manuscript Resubmitted

1 message

Energies Editorial Office <energies@mdpi.com>

Tue, Feb 7, 2023 at 9:52 AM

Reply-To: Nyxia Wang <nyxia.wang@mdpi.com>, Energies Editorial Office <energies@mdpi.com>

To: Muhammad Bachtiar Nappu <bachtiar@eng.unhas.ac.id>

Cc: Ardiaty Arief <ardiaty@eng.unhas.ac.id>, Willy Akbar Ajami <wawillyakbar@gmail.com>

Dear Dr. Nappu,

Thank you very much for resubmitting the modified version of the following manuscript:

Manuscript ID: energies-2107585

Type of manuscript: Article

Title: Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF

Authors: Muhammad Bachtiar Nappu *, Ardiaty Arief, Willy Akbar Ajami

Received: 3 December 2022

E-mails: bachtiar@eng.unhas.ac.id, ardiaty@eng.unhas.ac.id, wawillyakbar@gmail.com

Submitted to section: A: Sustainable Energy,

https://www.mdpi.com/journal/energies/sections/sustainable_energy

Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems

https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems

https://susy.mdpi.com/user/manuscripts/review_info/b1b655471f1bab514170ef59c5c83a6b

A member of the editorial office will be in touch with you soon regarding progress of the manuscript.

Kind regards,

Energies Editorial Office

Postfach, CH-4020 Basel, Switzerland

Office: St. Alban-Anlage 66, CH-4052 Basel

Tel. +41 61 683 77 34 (office)

E-mail: energies@mdpi.com

<https://www.mdpi.com/journal/energies/>

*** This is an automatically generated email ***

[Energies] Manuscript ID: energies-2107585; doi: 10.3390/en16041706. Paper has been published.

1 message

energies@mdpi.com <energies@mdpi.com>

Wed, Feb 8, 2023 at 10:15 PM

Reply-To: nyxia.wang@mdpi.com, energies@mdpi.com

To: bachtiar@eng.unhas.ac.id, ardiaty@eng.unhas.ac.id, wawillyakbar@gmail.com

Cc: billing@mdpi.com, website@mdpi.com, energies@mdpi.com, pesovic@mdpi.com, meng.zhang@mdpi.com, nyxia.wang@mdpi.com

Dear Authors,

We are pleased to inform you that your article "Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization–Based OPF" has been published in Energies as part of the Special Issue Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems and is available online:

Website: <https://www.mdpi.com/1996-1073/16/4/1706>

PDF Version: <https://www.mdpi.com/1996-1073/16/4/1706/pdf>

The meta data of your article, the manuscript files and a publication certificate are available here (only available to corresponding authors after login):

https://susy.mdpi.com/user/manuscripts/review_info/b1b655471f1bab514170ef59c5c83a6b

Special Issue:

https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems

Please note that this is an early access version. The complete PDF, HTML, and XML versions will be available soon. Please take a moment to check that everything is correct. You can reply to this email if there is a problem. If any errors are noticed, please note that all authors must follow MDPI's policy on updating published papers, found here: <https://www.mdpi.com/ethics#16>.

To encourage open scientific discussions and increase the visibility of published articles, MDPI recently implemented interactive commenting and recommendation functionalities on all article webpages (side bar on the right). We encourage you to forward the article link to your colleagues and peers.

We encourage you to set up your profile at www.SciProfiles.com, MDPI's researcher network platform. Articles you publish with MDPI will be linked to your SciProfiles page, where colleagues and peers will be able to see all of your publications, citations, as well as your other academic contributions. Please also feel free to send us feedback on the platform that we can improve it quickly and make it useful for scientific communities.

You can also share the paper on various social networks by clicking the links on the article webpage. Alternatively, our Editorial Office can post an announcement of your article on our Twitter channel, please send us a text of up to 200 characters with spaces. Please note that our service Scitations.net will automatically notify authors cited in your article. For further paper promotion guidelines, please refer to the following link: <https://www.mdpi.com/authors/promoting>.

We would be happy to keep you updated about new issue releases of energies. Please enter your e-mail address in the box at <https://www.mdpi.com/journal/energies/toc-alert/> to receive notifications. After issue release, a version of your paper including the issue cover will be available to download from the article abstract page.

To order high quality reprints of your article in quantities of 25-1000, visit: <https://www.mdpi.com/1996-1073/16/4/1706/reprints>

We support the multidisciplinary preprint platform /Preprints/, which permanently archives full text documents and datasets of working papers in all subject areas. Posting on the platform is entirely free of charge, and full details can be viewed at <http://www.preprints.org>.

We are dedicated to providing an outstanding publishing service, and we invite you to complete our author satisfaction survey <https://www.surveymonkey.com/r/authorfeedbackmdpi>. The survey contains 20 short questions and will only take a couple of minutes to complete.

To help us improve our Production and English editing service, provided as part of MDPI's editorial process, please take a few minutes to participate in the following survey: <https://www.surveymonkey.com/r/38TKGWF> (for Production and English editing service).

Thank you for choosing Energies to publish your work, we look forward to receiving further contributions from your research group in the future.

Kind regards,

--

MDPI
Postfach, CH - 4020 Basel, Switzerland
Office: St. Alban-Anlage 66, 4052 Basel, Switzerland
Tel. +41 61 683 77 34
Fax: +41 61 302 89 18
E-mail: website@mdpi.com
<https://www.mdpi.com/>

- 2 -

Komentar dan Masukan Reviewers Terhadap Substansi Paper

**▼ User Menu**

| | | |
|---|---------------|---|
| Home (/user/myprofile) | Journal | Energies (https://www.mdpi.com/journal/energies) (ISSN 1996-1073) |
| Manage Accounts (/user/manage_accounts) | Manuscript ID | energies-2107585 |
| Change Password (/user/chgpwd) | Type | Article |
| Edit Profile (/user/edit) | Title | Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF (https://www.mdpi.com/1996-1073/16/4/1706) |
| Logout (/user/logout) | Authors | Muhammad Bachtiar Nappu * , Ardiaty Arief , Willy Akbar Ajami |
| | Section | A: Sustainable Energy (https://www.mdpi.com/journal/energies/sections/sustainable_energy) |
| | Special Issue | Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems (https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems) |

▼ Submissions Menu


| | | |
|---|---|--|
| Submit Manuscript (/user/manuscripts/upload) | Abstract | Since the power grid grows and the necessity for higher system efficiency due to the increasing number of renewable energy penetration, power system operators need a fast and efficient method of operating the power system. One of the main problems in a modern power system operation that needs to be resolved is the optimal power flow (OPF). OPF is an efficient generator scheduling method to meet energy demands with the aim of minimizing the total production cost of power plants while maintaining system stability, security, and reliability. This paper proposes a new method to solve OPF by using incremental particle swarm optimization (IPSO). IPSO is a new algorithm of particle swarm optimization (PSO) that modifies the PSO structure by increasing the particle size, where each particle changes its position to determine its optimal position. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. The results of the research on optimal power flow for energy generation costs, system voltage stability, and losses obtained by the IPSO method are superior to the conventional PSO method. |
| Display Submitted Manuscripts (/user/manuscripts/status) | | |
| Display Co-Authored Manuscripts (/user/manuscripts/co-authored) | | |
| English Editing (/user/pre_english_article/status) | | The coverletter for this review report has been saved in the database. You can safely close this window. |
| Discount Vouchers (/user/discount_voucher) | Authors' Responses to Reviewer's Comments (Reviewer 1) | |
| Invoices (/user/invoices) | Author's Notes | We would like to thank you for your valuable comments and suggestions. All the comments have been incorporated in the paper appropriately and the response to the reviewers' |
| LaTeX Word | | |



Count (/user
/get/latex_word_count)

comments are attached.

Author's Report Notes (/user/review/displayFile/33980506
Notes File /5AC0OeJg?file=author-coverletter&report=25358625)

Reviewers
Menu 

Reviews (/user
/reviewer
/status)
Volunteer
Preferences
(/volunteer_reviewer_info
/view)

Review Report Form

Quality of English Language
 English very difficult to understand/incomprehensible
 Extensive editing of English language and style required
 Moderate English changes required
 English language and style are fine/minor spell check required
 I am not qualified to assess the quality of English in this paper

| | Yes | Can be improved | Must be improved | Not applicable |
|--|-------------------------------------|-------------------------------------|--------------------------|--------------------------|
| Does the introduction provide sufficient background and include all relevant references? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are all the cited references relevant to the research? | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Is the research design appropriate? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are the methods adequately described? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are the results clearly presented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are the conclusions supported by the results? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

Comments
and
Suggestions
for Authors

1. What is the main question addressed by the research?


The main question is addressed in applying into electrical grid and its optimal power flow a new approach related with advanced incremental particle swarm optimization. I consider this as actual thematic, based on reducing the iteration and faster process.

2. Do you consider the topic original or relevant in the field? Does it address a specific gap in the field?

The topic is original and relevant into the scientific orientation of the journal (A: Sustainable Energy)

3. What does it add to the subject area compared with other published material?

The authors present a new approach into optimization in the electrical grid to reducing number of iterations and made a process faster. The authors applied this method into the IEEE 30-bus system. The authors apply a method which is typical for the nature and social learning into an electrical grid, which is the new approach in the paper. The results are interesting, but they should be verified with a large number of technical objects and



devices (I mean an electrical systems and grids, which are the main object in the paper).

4. What specific improvements should the authors consider regarding the methodology? What further controls should be considered?

As I mentioned above, the authors should not be limited their research into one technical object (in this case 30 identical buses). I will ask the authors – are the results be the same or similar, compared with results obtained using presented method for other technical devices (electrical grids, power generators, photovoltaic systems).

In the new added section in the paper, authors should consider the application of the presented method to other technical objects as well.

5. Are the conclusions consistent with the evidence and arguments presented and do they address the main question posed?

The conclusions are well formulated but related only to dingle considered object. The authors mentioned only two factors (which are not unimportant), but by logical way, the following question arises: Are there other factors and parameters that can be optimized and can reduced (what will happen with power losses, the load in the individual lines, providing symmetrical load etc.)

6. Are the references appropriate?

The references are appropriate and are very well related with the scope of the paper and journal

7. Please include any additional comments on the tables and figures.

The tables and figures are readable and with a good quality and resolution. Only figure 2 may be with a large size. All tables may be combined to two (2) tables, according to that they have small numbers of row and parameters and are related to one object and consider only two methods (PSO and IPSO). Table 1 and table 2 may be comminated, also table 3 with table 4.


| | |
|---------------------|----------------------|
| Submission Date | 03 December 2022 |
| Date of this review | 14 Dec 2022 00:05:37 |

∨ User Menu ⓘ

| | | |
|---|---------------|---|
| Home (/user/myprofile) | Journal | Energies (https://www.mdpi.com/journal/energies) (ISSN 1996-1073) |
| Manage Accounts (/user/manage_accounts) | Manuscript ID | energies-2107585 |
| Change Password (/user/chgpwd) | Type | Article |
| Edit Profile (/user/edit) | Title | Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF (https://www.mdpi.com/1996-1073/16/4/1706) |
| Logout (/user/logout) | Authors | Muhammad Bachtiar Nappu * , Ardiaty Arief , Willy Akbar Ajami |
| | Section | A: Sustainable Energy (https://www.mdpi.com/journal/energies/sections/sustainable_energy) |
| | Special Issue | Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems (https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems) |

∨ Submissions Menu ⓘ

| | | |
|---|----------|--|
| Submit Manuscript (/user/manuscripts/upload) | Abstract | Since the power grid grows and the necessity for higher system efficiency due to the increasing number of renewable energy penetration, power system operators need a fast and efficient method of operating the power system. One of the main problems in a modern power system operation that needs to be resolved is the optimal power flow (OPF). OPF is an efficient generator scheduling method to meet energy demands with the aim of minimizing the total production cost of power plants while maintaining system stability, security, and reliability. This paper proposes a new method to solve OPF by using incremental particle swarm optimization (IPSO). IPSO is a new algorithm of particle swarm optimization (PSO) that modifies the PSO structure by increasing the particle size, where each particle changes its position to determine its optimal position. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. The results of the research on optimal power flow for energy generation costs, system voltage stability, and losses obtained by the IPSO method are superior to the conventional PSO method. |
| Display Submitted Manuscripts (/user/manuscripts/status) | | |
| Display Co-Authored Manuscripts (/user/manuscripts/co-authored) | | |
| English Editing (/user/pre_english_article/status) | | The coverletter for this review report has been saved in the database. You can safely close this window. |




Authors' Responses to Reviewer's Comments (Reviewer 2)

| | | |
|--|----------------|--|
| Discount Vouchers (/user/discount_voucher) | Author's Notes | We would like to thank you for your valuable comments and suggestions. All the comments have been incorporated in the paper appropriately and the response to the reviewers' |
| Invoices (/user/invoices) | | |
| LaTeX Word | | |

Count (/user
/get/latex_word_count)

comments are attached.

Author's Report Notes (/user/review/displayFile/34070813
Notes File /L06Fck75?file=author-coverletter&report=25431659)

Reviewers
Menu 

Reviews (/user
/reviewer
/status)
Volunteer
Preferences
(/volunteer_reviewer_info
/view)

Review Report Form

Quality of English Language
 English very difficult to understand/incomprehensible
 Extensive editing of English language and style required
 Moderate English changes required
 English language and style are fine/minor spell check required
 I am not qualified to assess the quality of English in this paper

| | Yes | Can be improved | Must be improved | Not applicable |
|--|--------------------------|-------------------------------------|--------------------------|--------------------------|
| Does the introduction provide sufficient background and include all relevant references? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are all the cited references relevant to the research? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Is the research design appropriate? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are the methods adequately described? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are the results clearly presented? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are the conclusions supported by the results? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

Comments and Suggestions for Authors

1-What are the novelty and advantages of your method? Please clarify What exactly is the purpose of this work?.

2- In the introduction, it is not enough to state the current work. It should be expanded and reconstructed. Including the motivation, the main work, and the improvements compared with previous related works should be emphasized in this section and explain how the present work defers from that published previously.

3- The literature review given in this paper is old to state the contribution of the present work, as there are recent controller that can deal with the same system which have been not added in your paper such as:

[1] Al Alahmadi, A. A., Belkhier, Y., Ullah, N., Abeida, H., Soliman, M. S., Khraisat, Y. S. H., & Alharbi, Y. M. (2021). Hybrid wind/PV/battery energy management-based intelligent non-integer control for smart DC-microgrid of smart university. *IEEE Access*, 9, 98948-98961.

[2] Althobaiti, Ahmed, et al. "Expert knowledge based proportional resonant controller for three phase inverter under abnormal grid conditions." *International Journal of Green*



4- The motivation of the research is not clear and the innovation of the paper is insufficient, if it is not then these should be respectively given.

5- The abstract and introduction is too short and a reader can't get full information of contribution. It must be revised. In particular, the last paragraph of the introduction should be seriously edited.

6-The recommended method should be presented in comparison with many other publications in the literature.

7- The authors need to give a mathematical analysis and proof of the stability and convergence properties of the proposed controller combined with the studied system.

| | |
|---------------------|----------------------|
| Submission Date | 03 December 2022 |
| Date of this review | 13 Dec 2022 01:17:41 |



∨ User Menu ⓘ

| | | |
|---|---------------|---|
| Home (/user/myprofile) | Journal | Energies (https://www.mdpi.com/journal/energies) (ISSN 1996-1073) |
| Manage Accounts (/user/manage_accounts) | Manuscript ID | energies-2107585 |
| Change Password (/user/chgpwd) | Type | Article |
| Edit Profile (/user/edit) | Title | Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF (https://www.mdpi.com/1996-1073/16/4/1706) |
| Logout (/user/logout) | Authors | Muhammad Bachtiar Nappu * , Ardiaty Arief , Willy Akbar Ajami |
| | Section | A: Sustainable Energy (https://www.mdpi.com/journal/energies/sections/sustainable_energy) |
| | Special Issue | Planning, Modelling, Operation and Assessment of Renewable Energy Power Systems (https://www.mdpi.com/journal/energies/special_issues/Renewable_Energy_Power_Systems) |

∨ Submissions Menu ⓘ

| | | |
|---|----------|--|
| Submit Manuscript (/user/manuscripts/upload) | Abstract | Since the power grid grows and the necessity for higher system efficiency due to the increasing number of renewable energy penetration, power system operators need a fast and efficient method of operating the power system. One of the main problems in a modern power system operation that needs to be resolved is the optimal power flow (OPF). OPF is an efficient generator scheduling method to meet energy demands with the aim of minimizing the total production cost of power plants while maintaining system stability, security, and reliability. This paper proposes a new method to solve OPF by using incremental particle swarm optimization (IPSO). IPSO is a new algorithm of particle swarm optimization (PSO) that modifies the PSO structure by increasing the particle size, where each particle changes its position to determine its optimal position. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. The results of the research on optimal power flow for energy generation costs, system voltage stability, and losses obtained by the IPSO method are superior to the conventional PSO method. |
| Display Submitted Manuscripts (/user/manuscripts/status) | | |
| Display Co-Authored Manuscripts (/user/manuscripts/co-authored) | | |
| English Editing (/user/pre_english_article/status) | | The coverletter for this review report has been saved in the database. You can safely close this window. |




Authors' Responses to Reviewer's Comments (Reviewer 3)

| | | |
|--|----------------|--|
| Discount Vouchers (/user/discount_voucher) | Author's Notes | We would like to thank you for your valuable comments and suggestions. All the comments have been incorporated in the paper appropriately and the response to the reviewers' |
| Invoices (/user/invoices) | | |
| LaTeX Word | | |

Count (/user
/get/latex_word_count)

comments are attached.

Author's Report Notes (/user/review/displayFile/34453316
Notes File /KGFSJxQ1?file=author-coverletter&report=25740585)

Reviewers
Menu 

Reviews (/user
/reviewer
/status)
Volunteer
Preferences
(/volunteer_reviewer_info
/view)

Review Report Form

Quality of English Language
 English very difficult to understand/incomprehensible
 Extensive editing of English language and style required
 Moderate English changes required
 English language and style are fine/minor spell check required
 I am not qualified to assess the quality of English in this paper

| | Yes | Can be improved | Must be improved | Not applicable |
|--|--------------------------|-------------------------------------|-------------------------------------|--------------------------|
| Does the introduction provide sufficient background and include all relevant references? | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| Are all the cited references relevant to the research? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Is the research design appropriate? | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Are the methods adequately described? | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| Are the results clearly presented? | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| Are the conclusions supported by the results? | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

Comments and Suggestions for Authors

Comments for authors:

1. The English language needs more work. There are many grammatical and typo mistakes in this manuscript. The paper needs to be edited by a native English speaker.
2. I suggest the authors revise the introduction of the study per the comments raised. The authors can also use the following points below as a guideline to help them come out with an interesting introduction that is more scientific.

Background & Significance: (What general background does the reader need in order to understand the manuscript and how important is it in the context of scientific research).

Problem definition: (What are the research questions to fill in the gaps of the existing knowledge body or methodology (Methods are not a contribution, but a tool to assess whether your hypothesis or predictions are supported or not



supported)? I would like to see well developed arguments for predicting or proposing specific relationships in this study.

Motivations & Objectives: (Why are you conducting the study and what are the goals to achieve?)

3. I would like to suggest that authors should update the introduction, and results part. Specifically, the latest research trends, and in order to highlight the academic frontier of the research, the references of the recent year need to be referenced.
4. What is the methodological contribution of this paper?
The author needs to pinpoint the exact methodological contribution of this present paper.
5. Increase the pixel size of Figure 3.
6. The author(s) need to compare their results (Each Findings) with past studies (what was provided in the article is not compares of results but an explanation of views from past authors) and in comparing the result from the empirical investigations the author(s) should as much as possible provide a recast of the comparison made and the supposed implications or advantages of the new finding made with those discovered by past authors. This will ensure justice to the extant literature and also evincing the superiority of the current findings over the past findings.
7. What are the limitations and caveats of this research?

| | |
|---------------------|----------------------|
| Submission Date | 03 December 2022 |
| Date of this review | 23 Dec 2022 21:10:06 |



- 3 -

Tanggapan Pengusul Terhadap Komentar Reviewer

Response to Reviewer 1 Comments

The authors would like to thank the Editor and Reviewers. All the comments have been incorporated in the paper appropriately and below are the response to the reviewers' comments.

1. What is the main question addressed by the research?

The main question is addressed in applying into electrical grid and its optimal power flow a new approach related with advanced incremental particle swarm optimization. I consider this as actual thematic, based on reducing the iteration and faster process.

Response 1: Thank you for your comment.

2. Do you consider the topic original or relevant in the field? Does it address a specific gap in the field?

The topic is original and relevant into the scientific orientation of the journal (A: Sustainable Energy)

Response 2: Thank you for your comment.

3. What does it add to the subject area compared with other published material?

The authors present a new approach into optimization in the electrical grid to reducing number of iterations and made a process faster. The authors applied this method into the IEEE 30-bus system. The authors apply a method which is typical for the nature and social learning into an electrical grid, which is the new approach in the paper. The results are interesting, but they should be verified with a large number of technical objects and devices (I mean an electrical systems and grids, which are the main object in the paper).

Response 3: In optimal power flow study, the main concern is in minimizing costs and power losses while maintaining the system voltage within its stability constraints. While the main advantage of IPSO compared to PSO is the smaller number of iterations. Therefore, these articles are shown in this study.

4. What specific improvements should the authors consider regarding the methodology? What further controls should be considered?

As I mentioned above, the authors should not be limited their research into one technical object (in this case 30 identical buses). I will ask the authors – are the results be the same or similar, compared with results obtained using presented method for other technical devices (electrical grids, power generators, photovoltaic systems).

In the new added section in the paper, authors should consider the application of the presented method to other technical objects as well.

Response 4: We have added a new paragraph elaborating the implementation of IPSO in other technical objects with their results as follow (lines 102-116):

IPSO is an optimization technique where each particle changes its position to determine its optimal position. The advantage of IPSO is that the population size increases with each iteration so that the optimization process becomes faster. In the literature, there is not much research implementing this IPSO method. A work by [30] compared the performance of PSO and IPSO, and their experimental results showed that IPSO was able to obtain better and faster solutions than PSO. A paper by [31] designed an IIR system identification task with a robust distributed algorithm based on incremental PSO and the results showed excellent identification performance. A hybrid IPSO, ant colony optimization and K-means (IPSOAntK-means) algorithm was proposed for automatic flower boundary extraction and the results informed that this hybrid IPSO method was one of the best methods [32]. Economic dispatch was proposed using IPSO and deep learning (DL). The results show that IPSO required more time than DL but the optimization results of IPSO were better than DL [33]. Therefore, this paper proposes a novel method for OPF by using incremental particle swarm optimization and called IPSO-OPF. The proposed method is implemented in the IEEE 30-bus system.

5. Are the conclusions consistent with the evidence and arguments presented and do they address the main question posed?

The conclusions are well formulated but related only to dingle considered object. The authors mentioned only two factors (which are not unimportant), but by logical way, the following question arises: Are there other factors and parameters that can be optimized and can reduced (what will happen with power losses, the load in the individual lines, providing symmetrical load etc.)

Response 5: The response for this point is similar to Response 3. In optimal power flow study, the main concern is in minimizing costs and power losses while maintaining the system voltage within its stability constraint. While the main advantage of IPSO compared to PSO is the smaller number of iterations. Therefore, these articles are explained in the conclusions.

6. Are the references appropriate?

The references are appropriate and are very well related with the scope of the paper and journal

Response 6: Thank you for your comment.

7. Please include any additional comments on the tables and figures.

The tables and figures are readable and with a good quality and resolution. Only figure 2 may be with a large size. All tables may be combined to two (2) tables, according to that they have small numbers of row and parameters and are related to one object and consider only two methods (PSO and IPSO). Table 1 and table 2 may be comminated, also table 3 with table 4.

Response 7: We have enlarged Figure 2. We also have merged Table 1 and 2; and Table 3 and 4.

Response to Reviewer 2 Comments

The authors would like to thank the Editor and Reviewers. All the comments have been incorporated in the paper appropriately and below are the response to the reviewers' comments.

1-What are the novelty and advantages of your method? Please clarify What exactly is the purpose of this work?.

Response 1: This paper proposes a new method for optimal power flow using incremental particle swarm optimization (IPSO). IPSO is the development of the meta-heuristic PSO method in which incremental social learning (ISL) is implemented into the PSO algorithm. ISL is stirred by the phenomenon of societal learning in the society of animals. In IPSO, the population size grows from iteration to iteration. When a new particle joins the population, its position is adjusted using a "societal learning" rule that persuades a preference towards the best particle. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. Hence the novelty and purpose of this research is to improve the OPF optimization by implementing IPSO to obtain faster results. The simulation results using the IEEE 30-bus system show that the performance of IPSO-OPF is superior to conventional PSO-OPF in resolving the optimal power flow mainly because IPSO-OPF converges faster than conventional PSO-OPF. IPSO-OPF results in fewer iterations, lower active power loss, better system voltage profile, and lower generation costs than the PSO-OPF method.

2- In the introduction, it is not enough to state the current work. It should be expanded and reconstructed. Including the motivation, the main work, and the improvements compared with previous related works should be emphasized in this section and explain how the present work defers from that published previously.

Response 2:

Considering suggestion from the reviewer, we have revised the introduction which included the motivation, the main work, and the improvements in the introduction. From the literature, there is no research on optimal power flow using of incremental particle swarm optimization (IPSO). Hence the motivation, the main work and the improvement in this paper is the implementation of incremental particle swarm optimization (IPSO) into the optimal power flow problem. IPSO is the development of the meta-heuristic PSO method in which incremental social learning (ISL) is implemented into the PSO algorithm. ISL is stirred by the phenomenon of societal learning in the society of animals. In IPSO, the population size grows from iteration to iteration. When a new particle joins the population, its position is adjusted using a "societal learning" rule that persuades a preference towards the best particle. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. Hence the novelty and purpose of this research is to improve the OPF optimization by implementing IPSO to obtain faster results. The simulation results using the IEEE 30-bus system show that the performance of IPSO-OPF is superior

to conventional PSO-OPF in resolving the optimal power flow mainly because IPSO-OPF converges faster than conventional PSO-OPF. IPSO-OPF results in fewer iterations, lower active power loss, better system voltage profile, and lower generation costs than the PSO-OPF method.

3- The literature review given in this paper is old to state the contribution of the present work, as there are recent controller that can deal with the same system which have been not added in your paper such as:

[1] Al Alahmadi, A. A., Belkhier, Y., Ullah, N., Abeida, H., Soliman, M. S., Khraisat, Y. S. H., & Alharbi, Y. M. (2021). Hybrid wind/PV/battery energy management-based intelligent non-integer control for smart DC-microgrid of smart university. *IEEE Access*, 9, 98948-98961.

[2] Althobaiti, Ahmed, et al. "Expert knowledge based proportional resonant controller for three phase inverter under abnormal grid conditions." *International Journal of Green Energy* (2022): 1-17.

Response 3: We have added the above references into our paper.

4- The motivation of the research is not clear and the innovation of the paper is insufficient, if it is not then these should be respectively given.

Response 4: We consider the motivation of this research is clear and the innovation of the paper is insufficient. The detailed response for this comment is the same as the Response 2.

5- The abstract and introduction is too short and a reader can't get full information of contribution. It must be revised. In particular, the last paragraph of the introduction should be seriously edited.

Response 5: The abstract is limited to maximum 200 words, and our abstract consists of 183 words. We tried to keep the abstract below 200 words.

We have added the last paragraph in the introduction as follow (lines 102-116):

IPSO is an optimization technique where each particle changes its position to determine its optimal position. The advantage of IPSO is that the population size increases with each iteration so that the optimization process becomes faster. In the literature, there is not much research implementing this IPSO method. A work by [30] compared the performance of PSO and IPSO, and their experimental results showed that IPSO was able to obtain better and faster solutions than PSO. A paper by [31] designed an IIR system identification task with a robust distributed algorithm based on incremental PSO and the results showed excellent identification performance. A hybrid IPSO, ant colony optimization and K-means (IPSOAntK-means) algorithm was proposed for automatic flower boundary extraction and the results informed that this hybrid IPSO method was one of the best methods [32]. Economic dispatch was proposed using IPSO and deep learning (DL). The results show that IPSO required more time than DL but the optimization results of IPSO were better than DL [33]. Therefore, this paper proposes a novel method for OPF by using incremental particle swarm optimization and called IPSO-OPF. The proposed method is implemented in the IEEE 30-bus system.

6-The recommended method should be presented in comparison with many other publications in the literature.

Response 6: We have not got any case study with the same system. The IEEE system used in some of the publications we found is different from the IEEE 30 bus system we used, so it is not possible to compare the results. Therefore, we only compare the results between IPSO and PSO.

7- The authors need to give a mathematical analysis and proof of the stability and convergence properties of the proposed controller combined with the studied system.

Response 7: We have provided the mathematical analysis and proof of the stability and convergence properties of the proposed controller combined with the studied system.

The mathematical analysis is provided by Table 2. Table 2 shows a comparison of the generation costs between the IPSO-OPF method and the PSO-OPF method including a summary of the comparison of optimal power flow results between the IPSO-OPF and PSO-OPF methods with iteration, active power losses, and generation costs as parameters. By using the PSO-OPF method, the total power generated by generator one is 191.7 MW while the total power generated by generator two is 74.28 MW with a total cost of generating using the PSO-OPF method of \$14,331/h. Meanwhile, using the IPSO-OPF method, the power generated by generator one and generator two is 191.7 MW and 74.26 MW, respectively. The total cost of generating the IPSO-OPF method is \$14,330/h. Thus, it can be seen that by using the IPSO-OPF method, the generation cost obtained is slightly cheaper than the generation cost using the PSO-OPF method.

The proof of the stability (in this case voltage stability) is shown in Figure 4. Figure 4 shows a comparison of the voltage profiles on each bus using the IPSO-OPF and PSO-OPF methods. It can be seen that the voltage magnitude obtained from the IPSO-OPF method on average is higher than the voltage magnitude using the PSO-OPF method, consequently in general the system voltage stability performance obtained using the IPSO-OPF method is better than the PSO-OPF method.

The convergence properties of IPSO and PSO are shown in Figure 3. Figure 3 shows the comparison of the number of iterations between the PSO and IPSO methods in the optimal power flow in the IEEE 30-bus system. It can be seen that using the IPSO-OPF method in power flow optimization has a faster time to converge than the PSO-OPF method. Furthermore, the IPSO-OPF method obtained a convergent value of 12.56 MW of system active power losses in the 25th iteration, while the PSO-OPF method converged in the 69th iteration with the result of 12.58 MW of active power losses. Hence it can be seen that in determining active power losses, the minimum value is obtained using the IPSO-OPF method with fewer iterations.

Response to Reviewer 3 Comments

The authors would like to thank the Editor and Reviewers. All the comments have been incorporated in the paper appropriately and below are the response to the reviewers' comments.

1. The English language needs more work. There are many grammatical and typo mistakes in this manuscript. The paper needs to be edited by a native English speaker.

Response 1: The English language in this paper has been re-checked and edited for improvement.

2. I suggest the authors revise the introduction of the study per the comments raised. The authors can also use the following points below as a guideline to help them come out with an interesting introduction that is more scientific.

Background & Significance: (What general background does the reader need in order to understand the manuscript and how important is it in the context of scientific research).

Problem definition: (What are the research questions to fill in the gaps of the existing knowledge body or methodology (Methods are not a contribution, but a tool to assess whether your hypothesis or predictions are supported or not supported)? I would like to see well developed arguments for predicting or proposing specific relationships in this study.

Motivations & Objectives: (Why are you conducting the study and what are the goals to achieve?)

Response 2: We have revised the introduction as follow:

Background & Significance: The background and significance are provided in the introduction from line 28 to line 82 as follow:

The optimal power flow (OPF) is a method for efficiently scheduling power plants with the aim of minimizing the total production costs of the power plants while maintaining the system safe and reliable and meeting the load demands by taking into account network losses and network constraints. OPF is one of the most essential studies in modern power systems operation to maintain and enhance system security, stability, and reliability. The OPF will decide the optimal operational settings of the electricity grid that are experiencing operational and physical obstacles. Then by using the optimization algorithm technique, elements that regulate the optimal point are expressed and formulated. The main intention of the OPF method is to determine the control variable settings and the equation system that optimizes the value of the objective functions. The selection of this function must be based on a cautious examination of the technical and economic aspects of the electric power system. Moreover, the rapid growth of the network and the need for efficiency in the electrical system make the system operators look for fast and efficient methods in the electric power system operation and planning.

There are many methods for solving OPF problems, ranging from conventional methods, such as AC-OPF [1], DC-OPF [2], SF-OPF [3, 4], and by using artificial intelligence or nature-inspired optimization techniques such as bat algorithms [5], particle swarm optimization [6], bacterial foraging method [7], whale optimization algorithm [8] artificial bee colony [9], differential search algorithm [10], grey wolf

optimizer and differential evolution [11], hunger games search (HGS) [12], moth swarm algorithm [13], gravitational search algorithm [14], teaching-learning-based optimization [15], circle search algorithm (CSA) [16], improved harmony search method [17], modified imperialist competitive algorithm [18], improved colliding bodies optimization algorithm [19], improved electromagnetism-like mechanism method [20], Gbest guided artificial bee colony [21], Lévy mutation teaching-learning-based optimization [22], and horse herd optimization [23]. A complete review of the most recent optimization techniques for OPF is presented in [24].

Meta-heuristic optimization approaches do not constantly assure obtaining an absolute optimum answer to the problem, but a rational solution that is close to a global ideal solution. Therefore, new algorithms are always being developed which are also motivated by the "No Free Lunch" theorem [25] that declares none optimization technique to be believed as the only preeminent method in solving all optimization problems. Some algorithms have succeeded in getting the optimum solution, but some algorithms are commonly slow in convergence. Some of these methods are easily trapped in the optimum locale or other words converge prematurely. Some stochastic algorithms have been demonstrated to be very successful in non-linear problems although they do not guarantee optimum global solutions within time limits. Optimization has been tried with many constraints by developing mathematical programming and modern heuristic search. The evolution of the search method is no stranger to solving mathematical functions. Natural selection and meta-heuristics are very useful for finding optimum global solutions. Specifically in the problem of OPF, since OPF is a vital and challenging issue in the operation of power systems and stability enhancement, power system researchers are continuously attracted to develop new algorithms for optimization or to enhance the existing approaches to acquire a more effective solution of OPF.

Problem definition: One of the optimization methods that is often used to solve OPF problems is the particle swarm optimization (PSO) method [6, 26, 27]. The PSO method is an optimization technique based on the swarm population that utilizes the experience of the cognitive as well as social principles of each swarm particle. The advantages of the PSO algorithm are its simple concept, memory, and the initial population is preserved, based on "productive teamwork" among the particles, so it is easy to implement and computationally efficient. Nevertheless, the shortcoming of this algorithm is due to its fast convergence which sometimes, throughout the optimization procedure, PSO cannot find a wider solution space and results in a quick loss of diversity, which inevitably gets caught in local optima or unwanted prematurely converges, meaning to quickly find solutions to local solutions [28]. Hence we propose the IPSO as an improvement of the conventional PSO in solving OPF problem.

Motivations & Objectives:

We have included the motivation and objective in the introduction. From the literature, there is no research on optimal power flow using of incremental particle swarm optimization (IPSO). Hence the motivation and objective in this paper is the implementation of incremental particle swarm optimization (IPSO) into the optimal power flow problem. IPSO is the development of the meta-heuristic PSO method in which incremental social learning (ISL) is implemented into the PSO algorithm. ISL is stirred by the phenomenon of societal learning in the society of animals. In IPSO, the population size grows from iteration to iteration. When a new particle joins the population, its position is adjusted using a "societal learning" rule that persuades a preference towards the best

particle. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. Hence the novelty and purpose of this research is to improve the OPF optimization by implementing IPSO to obtain faster results. The simulation results using the IEEE 30-bus system show that the performance of IPSO-OPF is superior to conventional PSO-OPF in resolving the optimal power flow mainly because IPSO-OPF converges faster than conventional PSO-OPF. IPSO-OPF results in fewer iterations, lower active power loss, better system voltage profile, and lower generation costs than the PSO-OPF method.

3. I would like to suggest that authors should update the introduction, and results part. Specifically, the latest research trends, and in order to highlight the academic frontier of the research, the references of the recent year need to be referenced.

Response 3: We have explained in the introduction the research trends in optimal power flow with various techniques that have been proposed.

4. What is the methodological contribution of this paper? The author needs to pinpoint the exact methodological contribution of this present paper.

Response 4: The methodological contribution of this paper is the development of a novel method for OPF by using incremental particle swarm optimization and called IPSO-OPF, where in IPSO, the size of the population raises over time. Once a new particle is inserted into the population, the position of the new particle is instigated using a "societal learning" instruction that will lead to a preference near the best particle. The simulation results show that the performance of IPSO-OPF is superior to conventional PSO-OPF in resolving the optimal power flow mainly because IPSO-OPF converges faster than conventional PSO-OPF. IPSO-OPF results in fewer iterations, lower active power loss, better system voltage profile, and lower generation costs than the PSO-OPF method.

5. Increase the pixel size of Figure 3.

Response 5: We have enlarged Figure 3.

6. The author(s) need to compare their results (Each Findings) with past studies (what was provided in the article is not compares of results but an explanation of views from past authors) and in comparing the result from the empirical investigations the author(s) should as much as possible provide a recast of the comparison made and the supposed implications or advantages of the new finding made with those discovered by past authors. This will ensure justice to the extant literature and also evincing the superiority of the current findings over the past findings.

Response 6: We have not got any case study with the same system. The IEEE system used in some of the publications we found is different from the IEEE 30 bus system we used, so it is not possible to compare the results. Therefore, we only compare the results between IPSO and PSO.

7. What are the limitations and caveats of this research?

Response 7: The limitations in this research are the system constraints as elaborated in Section 2.2 that consists of equality constraints and inequality constraints.

- 4 -

Perbaikan Secara Langsung Pada Revisi Artikel

1 Article

2 Energy Efficiency in Modern Power Systems Utilizing 3 Advanced Incremental Particle Swarm Optimization-Based 4 OPF

5 Muhammad Bachtiar Nappu ^{1,*}, Ardiaty Arief ², and Willy Akbar Ajami ¹

6 ¹ Electricity Market and Power Systems Research Group, Department of Electrical Engineering, Faculty of
7 Engineering, Hasanuddin University, Gowa 92171, INDONESIA

8 ² Power and Energy Systems Research Group, Department of Electrical Engineering, Faculty of Engineering,
9 Hasanuddin University, Gowa 92171, INDONESIA

10 * Correspondence: bachtiar@eng.unhas.ac.id; Tel.: +62 812 41 693 693

11 **Abstract:** Since the power grid grows and the necessity for higher system efficiency is due to the
12 increasing number of renewable energy penetration, power system operators need a fast and effi-
13 cient method of operating the power system. One of the main problems in a modern power system
14 operation that needs to be resolved is the optimal power flow (OPF). OPF is an efficient generator
15 scheduling method to meet energy demands with the aim of minimizing the total production cost
16 of power plants while maintaining system stability, security, and reliability. This paper proposes a
17 new method to solve OPF by using incremental particle swarm optimization (IPSO). IPSO is a new
18 algorithm of particle swarm optimization (PSO) that modifies the PSO structure by increasing the
19 particle size, where each particle changes its position to determine its optimal position. The ad-
20 vantage of IPSO is that the population increases with each iteration so that the optimization process
21 becomes faster. The results of the research on optimal power flow for energy generation costs, sys-
22 tem voltage stability, and losses obtained by the IPSO method are superior to the conventional PSO
23 method.

24 **Keywords:** economic dispatch; generation cost; incremental particle swarm optimization; incremen-
25 tal social learning; optimal power flow; particle swarm optimization; voltage stability

26

Citation: To be added by editorial
staff during production.

Academic Editor: Firstname Last-
name

Received: date

Accepted: date

Published: date

Publisher's Note: MDPI stays neu-
tral with regard to jurisdictional
claims in published maps and institu-
tional affiliations.



Copyright: © 2022 by the author
Submitted for possible open access
publication under the terms and
conditions of the Creative Commons
Attribution (CC BY) license
(<https://creativecommons.org/licenses/by/4.0/>).

27 1. Introduction

28 The optimal power flow (OPF) is a method for efficiently scheduling power plants
29 with the aim of minimizing the total production costs of the power plants while maintain-
30 ing the system safe and reliable and meeting the load demands by taking into account
31 network losses and network constraints. OPF is one of the most essential studies in the
32 modern power systems operation to maintain and enhance system security, stability, and
33 reliability. The OPF will decide the optimal operational settings of the electricity grid that
34 are experiencing operational and physical obstacles. Then by using the optimization al-
35 gorithm technique, elements that regulate the optimal point are expressed and formul-
36 ated. The main intention of the OPF method is to determine the control variable settings
37 and the equation system that optimizes the value of the objective functions. The selection
38 of this function must be based on a cautious examination of the technical and economic
39 aspects of the electric power system. Moreover, the rapid growth of the network and the
40 need for efficiency in the electrical system make the system operators look for fast and
41 efficient methods in the electric power system operation and planning.

42 There are many methods for solving OPF problems, ranging from conventional
43 methods, such as AC-OPF [1], DC-OPF [2], SF-OPF [3, 4], and by using artificial intelli-
44 gence or nature-inspired optimization techniques such as bat algorithms [5], particle

45 swarm optimization [6]-, bacterial foraging method [7], whale optimization algorithm [8]
46 artificial bee colony [9], differential search algorithm [10], grey wolf optimizer and differ-
47 ential evolution [11], hunger games search (HGS) [12], moth swarm algorithm [13], grav-
48 itational search algorithm [14], teaching-learning-based optimization [15], circle search al-
49 gorithm (CSA) [16], improved harmony search method [17], modified imperialist competi-
50 tive algorithm [18], improved colliding bodies optimization algorithm [19], improved
51 electromagnetism-like mechanism method [20], Gbest guided artificial bee colony [21],
52 Lévy mutation teaching-learning-based optimization [22], and horse herd optimization
53 [23]. A complete review of the most recent optimization techniques for OPF is presented
54 in [24].

55 Meta-heuristic optimization approaches do not constantly assure ~~to obtain~~ing an ab-
56 solute optimum answer ~~of to~~ the problem, but a rational solution that is close to a global
57 ideal solution. Therefore, new algorithms are always being developed which are also mo-
58 tivated by the “No Free Lunch” theorem [25] that declares none optimization technique
59 to be believed as the only preeminent method in solving all optimization problems. Some
60 algorithms have succeeded in getting the optimum solution, but some algorithms are
61 commonly slow in convergence. Some of these methods are easily trapped in the optimum
62 locale or other words converge prematurely. Some stochastic algorithms have been
63 demonstrated to be very successful in non-linear problems although they do not guaran-
64 tee optimum global solutions within time limits. Optimization has been tried with many
65 constraints by developing mathematical programming and modern heuristic search. The
66 evolution of the search method is no stranger to solving mathematical functions. Natural
67 selection and meta-heuristics are very useful for finding optimum global solutions. Spe-
68 cifically in the problem of OPF, since OPF is a vital and challenging issue in the operation
69 of power systems and stability enhancement, power system researchers are continuously
70 attracted to develop new algorithms for optimization or to enhance the existing ap-
71 proaches to acquire a more effective solution of OPF.

72 One of the optimization methods that is often used to solve OPF problems is the par-
73 ticle swarm optimization (PSO) method [6, 26, 27]. The PSO method is an optimization
74 technique based on the swarm population that utilizes the experience of the cognitive as
75 well as social principles of each swarm particle. The advantages of the PSO algorithm are
76 its simple concept, memory, ~~and~~ the initial population is preserved, based on “productive
77 teamwork” among the particles, so it is easy to implement and computationally efficient.
78 Nevertheless, the shortcoming of this algorithm is due to its fast convergence which some-
79 times, throughout the optimization procedure, PSO cannot find a wider solution space
80 and results in ~~a~~ quick loss of diversity, which inevitably gets caught in local optima or
81 unwanted prematurely converges, meaning to quickly find solutions to local solutions
82 [28].

83 The concept of the meta-heuristic method is to make a trade-off between exploration
84 and exploitation [13]. This technique starts with high exploration or high population di-
85 versity and then through the search process reduces its diversity. However, decreasing
86 diversity will not always lead to worthy exploitation or rapid convergence. Therefore, the
87 diversity of the population is still a trapped dilemma and requires careful and clever han-
88 dling.

89 In a system consisting of many learning particles or agents, each particle/agent must
90 not only familiarize ~~itself~~ with the characteristics of the environment but must also adjust
91 itself ~~with to~~ variations of other particles' behavior. This issue becomes crucial in research
92 of swarm intelligence especially if a large particles' quantity is engaged in the study be-
93 cause the learning process becomes more difficult. Therefore, to overcome this challenge,
94 in this paper, we propose an approach based on rising population numbers because in
95 some circumstances it can facilitate the scalability of the schemes composed of numerous
96 learning particles. This technique is motivated by the societal learning prodigies of animal
97 populations and is called incremental social learning (ISL) [29]. The ISL algorithm imple-
98 mented on PSO produces an IPSO (incremental particle swarm optimization) algorithm

where the size of the population raises over time. In IPSO, once a new particle is inserted into the population, the position of the new particle is instigated using a "societal learning" instruction that will lead to a preference near the best particle.

IPSO is an optimization technique where each particle changes its position to determine its optimal position. The advantage of IPSO is that the population size increases with each iteration so that the optimization process becomes faster. In the literature, there ~~are~~ is not very few-much research implementing this IPSO method. A work by [30] compared the performance of PSO and IPSO, and their experimental results showed that IPSO was able to obtain better and faster solutions than PSO. A paper by [31] designed an IIR system identification task with a robust distributed algorithm-based on incremental PSO and the results showed excellent identification performance. A hybrid IPSO, ant colony optimization and K-means (IPSOAntK-means) algorithm was proposed for automatic flower boundary extraction and the results informed that this hybrid IPSO method was one of the best methods [32]. Economic dispatch was proposed using IPSO and deep learning (DL). The results show that IPSO required more time than DL but the optimization results of IPSO were better than DL [33]. Therefore, this paper proposes a novel method for OPF by using incremental particle swarm optimization and called IPSO-OPF. The proposed method is implemented ~~in~~ the IEEE 30-bus system.

The next section of this paper is structured as follows: Section 2 describes the objective functions and constraints in the optimal power flow. Section 3 outlines the proposed methodology of incremental particle swarm optimization. Section 4 provides the results and analysis then Section 5 concludes the key outcomes of this study.

2. Optimal power flow

Optimal power flow (OPF) is a study that analyses the optimum settings in an electric power system. OPF was initially proposed by Carpentier in 1962 and has gone through a long time to develop various methods of solving power flow problems that can be applied today. The main role of the OPF is to determine the optimum settings for the power system [34]. The OPF optimizes objective functions that are problematic in the electric power system such as the total cost function of generation or economic dispatch, the network losses function, and the voltage deviation function on each bus by taking into account the limitations that exist in the operation of the equipment [2, 35, 36]. While optimizing the system's objective function, OPF also maintains the system stability by keeping the system balance between electricity generation and consumption [37].

2.1 Objective functions

In the multi-objective optimal power flow, there are several objective functions used, namely the generation cost function and the network losses function.

2.1.1 The generation cost function

The objective function of OPF, also known as economic dispatch, is to obtain a minimization of generating fuel costs by not violating the security constraint of each generator. The generation cost function is a mathematical function modeling to be optimized. The objective function equation for the generation cost is a non-linear function. The minimum generation cost formulation is derived as follows,

$$\text{Min } F = \sum_{i=1}^{N_G} F_i(P_{Gi}) \quad (1)$$

$$F(P_{Gi}) = \sum_{i=1}^{N_G} \alpha_i + \beta_i P_{Gi} + \gamma_i (P_{Gi})^2 \quad (2)$$

Where,

F : total generation cost (\$/h)

Formatted: Font: Not Bold

145 $F(P_{Gi})$: generation costs from the i^{th} generator which is a function of the generating
146 power output (\$/h)

147 P_{Gi} : the i^{th} generator power output (MW)

148 N_G : number of generating units

149 $\alpha_i \beta_{iv} \gamma_i$: coefficient of generation cost.

150 2.1.2 The network losses function

151 With the network losses objective, all control settings are regulated to minimize the
152 total active power losses. The network losses function is mathematical modeling to find
153 the value of network losses in the electric power system. The network losses function is
154 also a non-linear equation. The network losses function in the OPF problem is given in Eq.
155 (3).

$$156 P_{losses} = \sum_{k=1}^{N_{TL}} g_k \left[|V_i|^2 + |V_j|^2 + 2|V_i||V_j| \cos(\delta_i - \delta_j) \right] \quad (3)$$

157 Where,

158 P_{losses} : total network active power losses (MW)

159 N_{TL} : number of transmission lines in the system

160 g_k : the conductance of the k -line connecting the i and j buses

161 $|V_i|$: voltage magnitude on the i^{th} bus

162 $|V_j|$: voltage magnitude on the j^{th} bus

163 δ_i : voltage angle of bus i

164 δ_j : voltage angle of bus j

165 2.2 System constraints

166 2.2.1 Equality constraints

167 The equality constraint functions are formulated by a balance equation between
168 losses, generating power, and power absorbed by the load as well as the active and reac-
169 tive power balance equations. Eqs. (4) – (8) provide the non-linear power flow equations
170 that control the system,

$$171 \sum_{i=1}^{N_G} (P_{Gi}) = P_{load} + P_{losses} \quad (4)$$

$$172 \Delta P_i = P_{Gi} - P_{Di} \quad (5)$$

$$173 \Delta P_i = \sum_{j=1}^N |V_i||V_j||Y_{ij}|(\theta_{ij} - \delta_i + \delta_j) \quad (6)$$

$$174 \Delta Q_i = Q_{Gi} - Q_{Di} \quad (7)$$

$$175 \Delta Q_i = \sum_{j=1}^N |V_i||V_j||Y_{ij}|(\theta_{ij} - \delta_i + \delta_j) \quad (8)$$

176 Where,

177 P_{load} : total system load (MW)

178 $\sum_{i=1}^{N_G} (P_{Gi})$: total active power generation (MW)

179 P_{Gi} : active power generation at bus i

180 P_{Di} : active power demand at bus i

181 Q_{Gi} : reactive power generation at bus i

182 Q_{Di} : reactive load power at bus i

183 $|Y_{ij}|$: the element of bus admittance matrix Y_{bus}

184 θ_{ij} : the angle of ij element on Y_{bus}

185

186

2.2.2 Inequality constraints

The inequality constraints of the system are the formulation of continuous as well as discrete constraints that denote the security constraints and operational of the system which are as follows:

1. The power plants constraints, which consist of active and reactive power outputs of the power plants, and voltages limited by minimum and maximum limits

$$P_{Gi}^{min} \leq P_{Gi} \leq P_{Gi}^{max}, \quad i = 1, \dots, N_G \quad (9)$$

$$Q_{Gi}^{min} \leq Q_{Gi} \leq Q_{Gi}^{max}, \quad i = 1, \dots, N_G \quad (10)$$

$$|V_{Gi}^{min}| \leq |V_{Gi}| \leq |V_{Gi}^{max}|, \quad i = 1, \dots, N_G \quad (11)$$

Where

- P_{Gi}^{min} : the minimum active power of the i^{th} bus generator
- P_{Gi}^{max} : the maximum active power of the i^{th} bus generator
- Q_{Gi}^{min} : the minimum reactive power of the i^{th} bus generator
- Q_{Gi}^{max} : the maximum reactive power of the i^{th} bus generator
- $|V_{Gi}^{min}|$: the minimum voltage magnitudes of the i^{th} bus generator
- $|V_{Gi}^{max}|$: the maximum voltage magnitudes of the i^{th} bus generator
- N_G : number of generator buses

2. Security constraints including the voltage magnitude limit of the load bus

$$|V_{Lj}^{min}| \leq |V_{Lj}| \leq |V_{Lj}^{max}|, j = 1, \dots, N_{load} \quad (12)$$

Where

- $|V_{Lj}^{min}|$: the minimum voltage magnitudes of the j^{th} load bus
- $|V_{Lj}^{max}|$: the maximum voltage magnitudes of the j^{th} load bus
- N_{load} : number of load buses

3. The settings of the discrete transformer tap

$$T_{Ti}^{min} \leq T_{Ti} \leq T_{Ti}^{max}, \quad i = 1, \dots, N_T \quad (13)$$

N_T : number of transformers

4. The reactive power injection from compensators

$$Q_{Ci}^{min} \leq Q_{Ci} \leq Q_{Ci}^{max}, \quad i = 1, \dots, N_C \quad (14)$$

N_C : number of compensators

5. The loading of the transmission lines

$$S_{Tli} \leq S_{Tli}^{max}, \quad i = 1, \dots, N_{TL} \quad (15)$$

3. Proposed Methodology: The Incremental Particle Swarm Optimization Based Optimal Power Flow

3.1 Incremental social learning (ISL)

The incremental social learning (ISL) is usually applied in multi-agent algorithms. The basic concept of ISL is to add one agent or particle to a population according to its timetable [29]. The initial population comprises a little number of agents that allow the learning process to be carried out faster than the learning carried out by the larger population. New agents that are added on schedule to a population can quickly learn socially from more experienced agents who have been in the population for some time. Then, gradually, new agents are added to the population, aiming to allocate the optimal number of agents needed to complete a particular task. New agents are able to learn and acquire understanding from more knowledgeable agents through this social learning, without the new agents needing to spend 'money' to get that knowledge. In this ISL, new agents can save time to learn new knowledge or to perform their duties. With the presence of a new

agent in the inhabitants, the population will then adapt to new circumstances, but existing agents who have become part of the population do not need to be trained the whole thing from the beginning.

3.2 Particle swarm optimization

Particle swarm optimization (PSO) is a meta-heuristic method developed by Eberhart and Kennedy [38]. The meaning of swarm in PSO is individuals who flock together as in groups of birds or fish. PSO is a part of an evolutionary model algorithm inspired by the activities of flocks of birds and schools of fish in search of prey, where a flock does not have a front-runner to look for their food, so they will disperse to search for food in an unsystematic way.

In the PSO algorithm, the process of finding a solution is done by a population containing some particles [39]. PSO is an optimization technique with a concept of population-based activities in a food-searching procedure where each individual is called a particle. Every particle will adjust its position with respect to time. PSO consists of an intelligent population within a given search space. The population is produced unsystematically with the lowest and the largest value. PSO is comprised of particles traveling in the search space. Each individual particle signifies the position and location of the obstacle. Each particle travels around a multidimensional search space and adjusts its position according to its own individual experience and the near particle's experience. Each particle has a position denoted by $X_{i,j}^t$, and a velocity symbolized by $V_{i,j}^t$ in an N -dimensional search space, where i represents the i^{th} particle and N represents the dimension of the space search or number of unknown variables in a system of nonlinear equations. The following are equations that describe the position $X_{i,j}^t$ and the velocity $V_{i,j}^t$.

$$X_{i,j}^t = X_{i,1}^t, X_{i,2}^t, X_{i,3}^t, \dots, X_{i,N}^t \quad (16)$$

$$V_{i,j}^t = V_{i,1}^t, V_{i,2}^t, V_{i,3}^t, \dots, V_{i,N}^t \quad (17)$$

Each particle will look for the optimum answer with the intelligence obtained from its own experience by traversing the dimensions of the search space. Then each particle will make adjustments to its own best position or best solution (local best or personal best - P_{best}) and then acclimatizing the position of the best particle from the best value or solution from the entire population (global best - G_{best}) whilst crisscrossing the search space. PSO does not have crosses between individuals and does not have mutations, and the existing particles are not replaced by other particles during the search process. In every iteration, the particle position which signifies the solution is assessed for its accomplishment by incorporating its solution into the fitness function. Each particle is regarded as a spot in a particular dimension of space. The following equations are mathematical models that describe the mechanism for improving the state of the particle.

$$V_{i,j}^{t+1} = \psi V_{i,j}^t + \mu_1 \varepsilon_1 (\Psi_{i,j}^t - X_{i,j}^t) + \mu_2 \varepsilon_2 (Y_{i,j}^t - X_{i,j}^t) \quad (18)$$

$$X_{i,j}^{t+1} = X_{i,j}^t + V_{i,j}^{t+1} \quad (19)$$

Where $\Psi_{i,j}^t = \Psi_{i,1}^t, \Psi_{i,2}^t, \dots, \Psi_{i,N}^t$ represent the local best or personal best of the i^{th} particle, $Y_{i,j}^t = Y_{i,1}^t, Y_{i,2}^t, \dots, Y_{i,N}^t$ represent the global best from the whole flock, μ_1 and μ_2 are constants with the positive value which are normally called acceleration coefficients or learning factors or, ε_1 and ε_2 are positive random numbers between 0 and 1 produced at each iteration for each dimension, ψ is an inertial parameter named the constriction factor which indicates the effect of changing velocity from the old vector to the new vector. Eq. (18) is employed to obtain the velocity of the new particle according to the preceding velocity, the distance between the present position and the local best position, and the current distance from the global best position. Then the particle flies to a new position based on Eq. (19).

3.3 Implementation of incremental social learning into particle swarm optimization

The implementation of ISL into the PSO algorithm is called Incremental Particle Swarm Optimization (IPSO). In ISL, each time a new agent joins the population, the new member must study socially from a more experienced division of agents. In the IPSO algorithm, when a new agent or particle is entered into a population, the position of this new member is adjusted using information from agents who are already part of that population by "social learning" rules.

This process is applied as an initialization instruction that transfers a new particle from a randomly generated original position in the search space to a position closer to the particle position which serves as a "model" for the new particle to emulate [29]. The rules for initializing the j^{th} dimension of the new particle can be seen in the following equation:

$$\chi'_{new,j} = \chi_{new,j} + \tau(\varphi_{model,j} - \chi_{new,j}) \quad (20)$$

where $\chi'_{new,j}$ is the regenerated position of the new particle, $\chi_{new,j}$ is the initial random position of the new particle, $\varphi_{model,j}$ is the position of the model particle and τ is a homogeneously dispersed random number between 0 and 1. After this rule is implemented for every dimension, the best position of the previous new particle is modified to the $\chi'_{new,j}$ value and its velocity is arranged to zero. For all dimensions, the τ value is the same to confirm that the renewed position of the new particle will be in any place alongside the vector of $\varphi_{model,j} - \chi'_{new,j}$. Finally, the new particle neighbors, namely the collection of particles that will receive information in the next iteration, are generated randomly, taking into account the topological connectivity level of the swarm population.

3.4 Algorithm and flowchart of the proposed incremental PSO based OPF

The computational steps to calculate the optimal power flow based on IPSO are described in detail as follows and the flowchart can be seen in Figure 1.

- Step 1 : Input data of the system (generator cost function, network losses function, active power generation constraints, transmission line data, and bus data).
- Step 2 : Input IPSO variables (IPSO inertial weighting factor)
- Step 3 : Set the iteration equal to 1
- Step 4 : Generate population size 'N' where each particle in the IPSO algorithm is determined by various control variables
- Step 5 : Initialize the resulting population as P_{best} and eliminate the particles that do not satisfy the system inequality constraints
- Step 6 : Run the optimal power flow program for each particle
- Step 7 : Calculate and evaluate the fitness value for each particle and determine the G_{best} value among all particles
- Step 8 : Calculate and update each particle's velocity
- Step 9 : Adjust each particle's position and eliminate the particles that do not meet the constraints.
- Step 10 : Assess the fitness value of the new population with P_{best} then select the better particle that also satisfies the constraints
- Step 11 : Particles with higher fitness function values are designated as P_{best}
- Step 12 : If $iter < maximum\ iteration\ (iter_{max})$ then add a new particle into the population whose position is adjusted according to the "rules of social learning" and go to Step 6 otherwise go to Step 13.
- Step 13 : Print the G_{best} value that gives the optimal solution (minimum P_{losses}).

4. Results and analysis

This paper uses the IEEE 30-bus system [40] as the case study. The IEEE 30-bus power system consists of 2 power stations on buses 1 and 2. This system consists of 22 load points spread over each bus with a total load of 283.4 MW of active power and 126.2 MVar of reactive power. Figure 2 shows the single-line diagram of the IEEE 30-bus system.


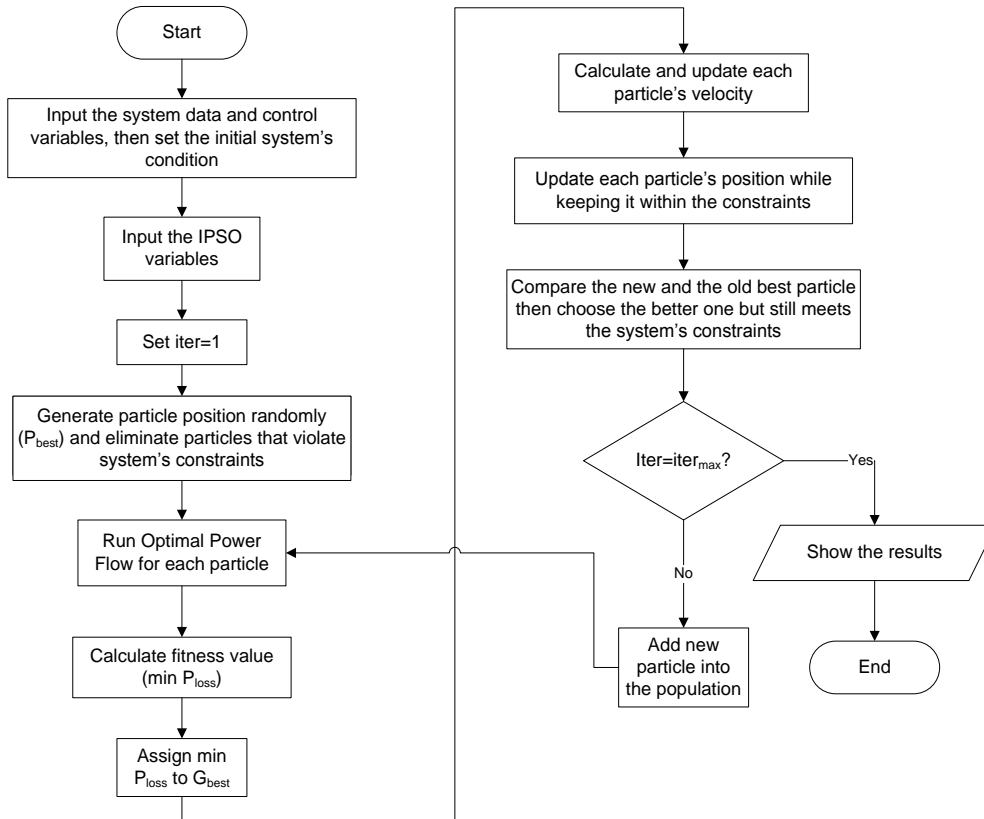


Figure 1. Flowchart of the optimal power flow based on incremental particle swarm optimization

Table 1 shows the generation data contained in the IEEE 30-bus system consisting of active power and reactive power generated by the generator, minimum and maximum active and reactive power that can be generated by the generator also the generation coefficient of each generator. As for the voltage profile constraint on each bus, it is determined to be 0.95 p.u. as the lower limit and 1.05 p.u. as the upper limit.

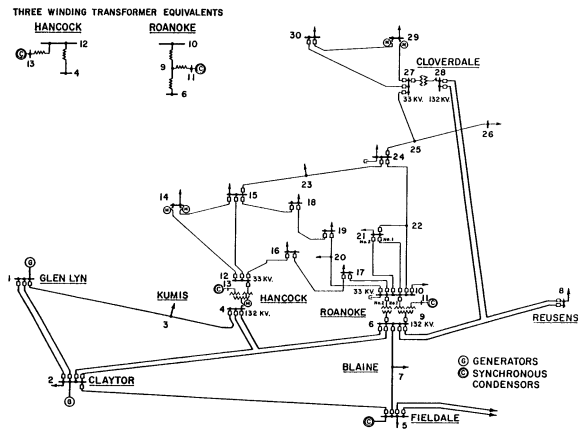

In this study,

the results of OPF based on IPSO are compared with conventional PSO. For OPF using the proposed method IPSO, it is named IPSO-OPF, and OPF using conventional PSO is called PSO-OPF. The fundamental modification of IPSO from the PSO lies in the renewal of new particles. The update of new particles on PSO uses the constant $\chi=0.729$, while the renewal of new particles on IPSO uses random numbers between 0 and 1. This difference affects the speed of obtaining the best fitness.

Formatted: Font: Bold

Formatted: Indent: First line: 0.75 cm

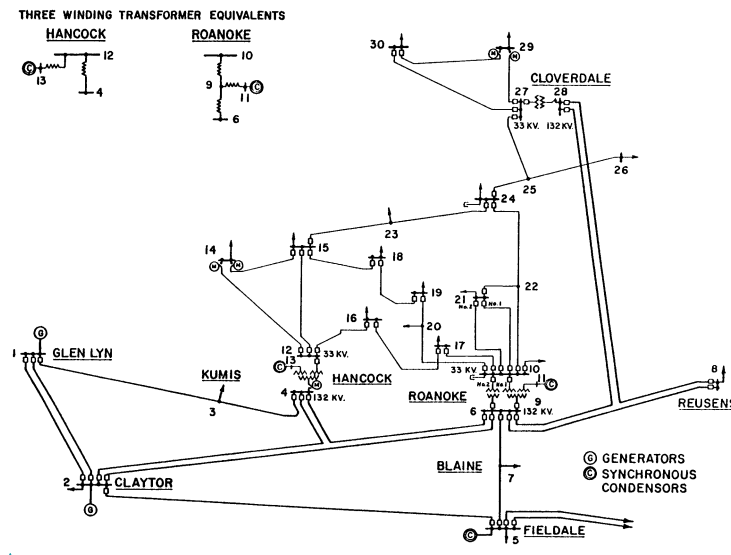


Figure 2. The single-line diagram of the IEEE 30-bus system.[40]

Formatted: Font: Bold

Table 1 shows the generation data contained in the IEEE 30-bus system consisting of active power and reactive power generated by the generator, minimum and maximum active and reactive power that can be generated by the generator. As for the voltage profile constraint on each bus, it is determined to be 0.95 p.u. as the lower limit and 1.05 p.u. as the upper limit. Table 2 informs the generation coefficient of each generator in the IEEE 30-bus system.

Table 1. Generator data and cost coefficient [40]

| Bus | P_{Gi} (MW) | Q_{Gi} (MVA _r) | Generator Constraints | | | | Generation cost coefficients | | |
|-----------|------------------|---------------------------------|------------------------|------------------------|---------------------------------------|---------------------------------------|------------------------------|-----------------------|--------------------------------------|
| | | | P_{Gi}^{max} (MW) | P_{Gi}^{min} (MW) | Q_{Gi}^{max} (MVA _r) | Q_{Gi}^{min} (MVA _r) | α_i (\$/h) | β_i (\$/MWh) | γ_i (\$/MW ² h) |
| 1 (Gen 1) | 191.7 | 29 | 191.7 | 20 | 30 | -10 | 1243.53 | 38.301 | 0.035 |
| 2 (Gen 2) | 40 | 10 | 140 | 5 | 50 | -40 | 451.325 | 46.159 | 0.105 |

Figure 3 shows the comparison of the number of iterations between the PSO and IPSO methods in the optimal power flow in the IEEE 30-bus system. It can be seen that using the IPSO-OPF method in power flow optimization has a faster time to converge than the PSO-OPF method. Furthermore, the IPSO-OPF method obtained a convergent value of 12.56 MW of system active power losses in the 25th iteration, while the PSO-OPF method converged in the 69th iteration with the result of 12.58 MW of active power losses. Hence it can be seen that in determining active power losses, the minimum value is obtained using the IPSO-OPF method with fewer iterations.

Table 2. Generation cost coefficients

| Generator | α_i (\$/h) | β_i (\$/MWh) | γ_i (\$/MW ² h) |
|-------------|-------------------|--------------------|-----------------------------------|
| Bus 1/Gen 1 | 1243.53 | 38.301 | 0.035 |
| Bus 2/Gen 2 | 451.325 | 46.159 | 0.105 |

In this study, the results of OPF based on IPSO are compared with conventional PSO. For OPF using the proposed method IPSO, it is named IPSO-OPF, and OPF using conventional PSO is called PSO-OPF. The fundamental modification of IPSO from the PSO lies in the renewal of new particles. The update of new particles on PSO uses the constant $\omega = 0.729$, while the renewal of new particles on IPSO uses random numbers between 0 and 1. This difference affects the speed of obtaining the best fitness.



Figure 3 shows the comparison of the number of iterations between the PSO and IPSO methods in the optimal power flow in the IEEE 30-bus system. It can be seen that using the IPSO-OPF method in power flow optimization has a faster time to converge than the PSO-OPF method. Furthermore, the IPSO-OPF method obtained a convergent value of 12.56 MW of system active power losses in the 25th iteration, while the PSO-OPF method converged on the 69th iteration with the result of 12.58 MW of active power losses.

Formatted: MDPI_3.1_text

Formatted Table

Hence it can be seen that in determining active power losses, the minimum value is obtained using the IPSO-OPF method with fewer iterations. In this study, the results of OPF based on IPSO are compared with conventional PSO. For OPF using the proposed method IPSO, it is named IPSO-OPF, and OPF using conventional PSO is called PSO-OPF. The fundamental modification of IPSO from the PSO lies in the renewal of new particles. The update of new particles on PSO uses the constant $\chi=0.729$, while the renewal of new particles on IPSO uses random numbers between 0 and 1. This difference affects the speed of obtaining the best fitness.

Figure 3 shows the comparison of the number of iterations between the PSO and IPSO methods in the optimal power flow in the IEEE 30 bus system. It can be seen that using the IPSO-OPF method in power flow optimization has a faster time to converge than the PSO-OPF method. Furthermore, the IPSO-OPF method obtained a convergent value of 12.56 MW of system active power losses in the 25th iteration, while the PSO-OPF method converged on the 69th iteration with the result of 12.58 MW of active power losses. Hence it can be seen that in determining active power losses, the minimum value is obtained using the IPSO-OPF method with fewer iterations.

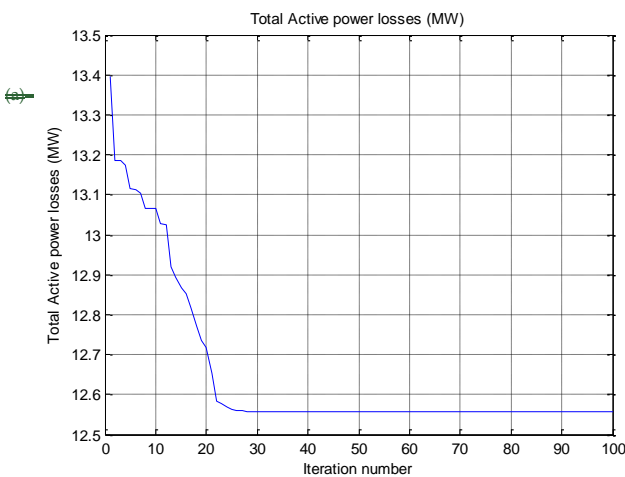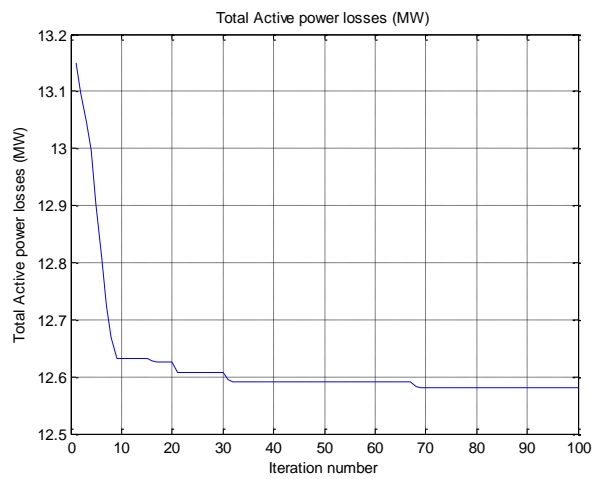

Formatted: Left, Indent: Left: 10.25 cm

(b)

Figure 3. Number of iterations by using (a) PSO-OPF method (b) IPSO-OPF method

Table 3-2 shows a comparison of the generation costs between the IPSO-OPF method and the PSO-OPF method including a summary of the comparison of optimal power flow results between the IPSO-OPF and PSO-OPF methods with iteration, active power losses, and generation costs as parameters. By using the PSO-OPF method, the total power generated by generator one is 191.7 MW while the total power generated by generator two is 74.28 MW with a total cost of generating using the PSO-OPF method of \$14,331/h. Meanwhile, using the IPSO-OPF method, the power generated by generator one and generator two is 191.7 MW and 74.26 MW, respectively. The total cost of generating the IPSO-OPF method is \$14,330/h. Thus, it can be seen that by using the IPSO-OPF method, the generation cost obtained is slightly cheaper than the generation cost using the PSO-OPF method.

Table 4 shows a summary of the comparison of optimal power flow results between the IPSO-OPF and PSO-OPF methods with iteration, active power losses, and generation costs as parameters. It can be seen from Table 2 that the IPSO-OPF method converges faster at the 25th iteration than the PSO-OPF method which converges at the 69th iteration. The active power losses obtained using the IPSO-OPF method are also lesser than the PSO-OPF method. As for the cost of generation, the IPSO-OPF method also produces a generation cost that is cheaper than the cost of generating the PSO-OPF method. Therefore, overall, the performance of IPSO-OPF is superior to the conventional PSO-OPF in solving optimal power flow especially since IPSO-OPF converges faster than the conventional PSO-OPF.

Table 3. Comparison of the generation costs of PSO-OPF and IPSO-OPF methods

| Methods | Active power (MW) | | Cost (\$/h) | | Active power losses (MW) | Total Cost (\$/h) | Number of iterations |
|---------|-------------------|-------|-------------|-------|--------------------------|-------------------|----------------------|
| | Gen 1 | Gen 2 | Gen 1 | Gen 2 | | | |
| PSO | 191.7 | 74.28 | 9,872 | 4,459 | 12.58 | 14,331 | 69 |
| IPSO | 191.7 | 74.26 | 9,872 | 4,458 | 12.56 | 14,330 | 25 |

Formatted Table

Figure 4 shows a comparison of the voltage profiles on each bus using the IPSO-OPF and PSO-OPF methods. It can be seen that the voltage magnitude obtained from the IPSO-OPF method on average is higher than the voltage magnitude using the PSO-OPF method, ~~consequently that~~ in general the system voltage stability performance obtained using the IPSO-OPF method is better than the PSO-OPF method.

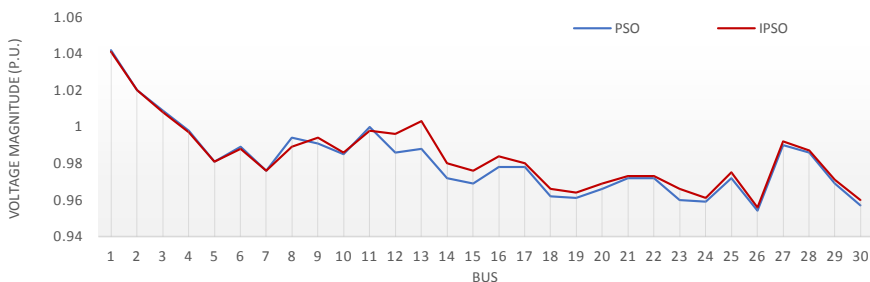


Figure 4. Voltage profile comparison between PSO-OPF and IPSO-OPF

Table 4 shows a summary of the comparison of optimal power flow results between the IPSO-OPF and PSO-OPF methods with iteration, active power losses, and generation costs as parameters. It can be seen that the IPSO-OPF method converges faster at the 25th iteration than the PSO-OPF method which converges at the 69th iteration. The active power losses obtained using the IPSO-OPF method are also lesser than the PSO-OPF method. As for the cost of generation, the IPSO-OPF method also produces a generation cost that is cheaper than the cost of generating the PSO-OPF method. Therefore, overall, the performance of IPSO-OPF is superior to the conventional PSO-OPF in solving optimal power flow especially since IPSO-OPF converges faster than the conventional PSO-OPF.

Table 4. Performance comparison between the PSO-OPF and the IPSO-OPF methods

| Parameter | PSO | IPSO |
|----------------------|-------------|-------------|
| Number of iterations | 69 | 25 |
| Active power losses | 12.58 MW | 12.56 MW |
| Generation cost | \$ 14,331/h | \$ 14,330/h |

Voltage magnitudes, active power losses, and generation costs between the IPSO-OPF and PSO-OPF methods have values that are not much different. This is because the fundamental difference between the two methods is in the iteration speed to obtain a convergent value.

5. Conclusions

This paper proposes a new method for optimal power flow using incremental particle swarm optimization (IPSO). IPSO is the development of the meta-heuristic PSO method in which incremental social learning (ISL) is implemented into the PSO algorithm. ISL is stirred by the phenomenon of societal learning in the society of animals. In IPSO, the population size grows from iteration to iteration. When a new particle joins the population, its position is adjusted using a "societal learning" rule that persuades a preference towards the best particle. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. The simulation results using the IEEE 30-bus system show that the performance of IPSO-OPF is superior to conventional PSO-OPF in resolving the optimal power flow mainly because IPSO-OPF converges faster than conventional PSO-OPF. IPSO-OPF results in fewer iterations, lower active power loss, better system voltage profile, and lower generation costs than the PSO-OPF method.

Author Contributions: Conceptualization, M.B.N. and A.A.; methodology, M.B.N. and A.A.; software, M.B.N. and W.A.A.; validation, M.B.N. and A.A.; formal analysis, M.B.N. and A.A.; investigation, M.B.N. and W.A.A.; resources, M.B.N. and W.A.A.; data curation, W.A.A.; writing—original draft preparation, M.B.N., A.A. and W.A.A.; writing—review and editing, M.B.N. and A.A.; visualization, A.A.; supervision, M.B.N.; project administration, W.A.A.; funding acquisition, M.B.N. All authors have read and agreed to the published version of the manuscript. ^z

Funding: This research received no external funding.

Data Availability Statement: The data used in this study are available from the authors upon reasonable request.

Conflicts of Interest: The authors declare no conflict of interest.

References

- 33 1. Venzke, A.; Chatzivasileiadis, S.; Molzahn, D. K. Inexact convex relaxations for AC optimal power flow: Towards AC
334 feasibility. *Electr. Power Syst. Res.* **2020**, *187*, 106480.
- 35 2. Nappu, M. B., LMP-lossless for congested power system based on DC-OPF. In proceeding of the Electrical Engineering
336 and Informatics (MICEEI), 2014 Makassar International Conference on, Makassar, SULSEL Indonesia, 26-30 November, 26-30
337 Nov. 2014 2014.
- 38 3. Bachtiar Nappu, M.; Arief, A.; Bansal, R. C. Transmission management for congested power system: A review of
339 concepts, technical challenges and development of a new methodology. *Renew. Sustain. Energy Rev.* **2014**, *38*, 572-580.
- 40 4. Nappu, M. B.; Bansal, R. C.; Saha, T. K. Market power implication on congested power system: A case study of financial
341 withheld strategy. *Int. J. Electr. Power Energy Syst.* **2013**, *47*, 408-415.
- 42 5. Venkateswara Rao, B.; Nagesh Kumar, G. V. Optimal power flow by BAT search algorithm for generation reallocation
343 with unified power flow controller. *Int. J. Electr. Power Energy Syst.* **2015**, *68*, 81-88.
- 44 6. Naderi, E.; Pourakbari-Kasmaei, M.; Abdi, H. An efficient particle swarm optimization algorithm to solve optimal power
345 flow problem integrated with FACTS devices. *Appl. Soft Comput.* **2019**, *80*, 243-262.
- 46 7. Amjady, N.; Fatemi, H.; Zareipour, H. Solution of Optimal Power Flow Subject to Security Constraints by a New
347 Improved Bacterial Foraging Method. *IEEE Trans. Power Syst.* **2012**, *27*, 1311-1323.
- 48 8. Swief, R. A.; Hassan, N. M.; Hasanien, H. M.; Abdelaziz, A. Y.; Kamh, M. Z. AC&DC optimal power flow incorporating
349 centralized/decentralized multi-region grid control employing the whale algorithm. *Ain Shams Eng. J.* **2021**, *12*, 1907-1922.
- 50 9. Rezaei Adaryani, M.; Karami, A. Artificial bee colony algorithm for solving multi-objective optimal power flow problem.
351 *Int. J. Electr. Power Energy Syst.* **2013**, *53*, 219-230.
- 52 10. Abaci, K.; Yamaci, V. Differential search algorithm for solving multi-objective optimal power flow problem. *Int. J. Electr.*
353 *Power Energy Syst.* **2016**, *79*, 1-10.
- 54 11. El-Fergany, A. A.; Hasanien, H. M. Single and Multi-objective Optimal Power Flow Using Grey Wolf Optimizer and
355 Differential Evolution Algorithms. *Electr. Power Compon. Syst.* **2015**, *43*, 1548-1559.
- 56 12. Al-Kaabi, M.; Dumbrava, V.; Eremia, M. Single and Multi-Objective Optimal Power Flow Based on Hunger Games
357 Search with Pareto Concept Optimization. *Energies.* **2022**, *15*, 8328.
- 58 13. Mohamed, A.-A. A.; Mohamed, Y. S.; El-Gaafary, A. A. M.; Hemeida, A. M. Optimal power flow using moth swarm
359 algorithm. *Electr. Power Syst. Res.* **2017**, *142*, 190-206.
- 60 14. Duman, S.; Güvenç, U.; Sönmez, Y.; Yörükeren, N. Optimal power flow using gravitational search algorithm. *Energy*
361 *Convers. Manag.* **2012**, *59*, 86-95.
- 62 15. Bouchekara, H. R. E. H.; Abido, M. A.; Boucherma, M. Optimal power flow using Teaching-Learning-Based
363 Optimization technique. *Electr. Power Syst. Res.* **2014**, *114*, 49-59.
- 64 16. Shaheen, M. A. M.; Ullah, Z.; Qais, M. H.; Hasanien, H. M.; Chua, K. J.; Tostado-Véliz, M.; Turkey, R. A.; Jurado, F.;
365 Elkadeem, M. R. Solution of Probabilistic Optimal Power Flow Incorporating Renewable Energy Uncertainty Using a Novel
366 Circle Search Algorithm. *Energies.* **2022**, *15*, 8303.
- 67 17. Sinsuphan, N.; Leeton, U.; Kulworawanichpong, T. Optimal power flow solution using improved harmony search
368 method. *Appl. Soft Comput.* **2013**, *13*, 2364-2374.
- 69 18. Ghasemi, M.; Ghavidel, S.; Ghanbarian, M. M.; Gharibzadeh, M.; Azizi Vahed, A. Multi-objective optimal power flow
370 considering the cost, emission, voltage deviation and power losses using multi-objective modified imperialist competitive
371 algorithm. *Energy.* **2014**, *78*, 276-289.
- 72 19. Bouchekara, H. R. E. H.; Chaib, A. E.; Abido, M. A.; El-Sehiemy, R. A. Optimal power flow using an Improved Colliding
373 Bodies Optimization algorithm. *Appl. Soft Comput.* **2016**, *42*, 119-131.
- 74 20. El-Hana Bouchekara, H. R.; Abido, M. A.; Chaib, A. E. Optimal Power Flow Using an Improved Electromagnetism-like
375 Mechanism Method. *Electr. Power Compon. Syst.* **2016**, *44*, 434-449.
- 76 21. Roy, R.; Jadhav, H. T. Optimal power flow solution of power system incorporating stochastic wind power using Gbest
377 guided artificial bee colony algorithm. *Int. J. Electr. Power Energy Syst.* **2015**, *64*, 562-578.
- 78 22. Ghasemi, M.; Ghavidel, S.; Gitizadeh, M.; Akbari, E. An improved teaching-learning-based optimization algorithm
379 using Lévy mutation strategy for non-smooth optimal power flow. *Int. J. Electr. Power Energy Syst.* **2015**, *65*, 375-384.
- 80 23. Ida Evangeline, S.; Rathika, P. Wind farm incorporated optimal power flow solutions through multi-objective horse
381 herd optimization with a novel constraint handling technique. *Expert Syst. Appl.* **2022**, *194*, 116544.
- 82 24. Risi, B.-G.; Riganti-Fulginei, F.; Laudani, A. Modern Techniques for the Optimal Power Flow Problem: State of the Art.
383 *Energies.* **2022**, *15*, 6387.
- 84 25. Wolpert, D. H.; Macready, W. G. No free lunch theorems for optimization. *IEEE Trans. Evol. Comput.* **1997**, *1*, 67-82.
- 85 26. Abido, M. A. Optimal power flow using particle swarm optimization. *Int. J. Electr. Power Energy Syst.* **2002**, *24*, 563-571.

Formatted: Indent: Left: 0 cm, Hanging: 0.75 cm,
No bullets or numbering

- 386 ~~27.~~ 27. Yumbala, P. E. O.; Ramirez, J. M.; Coello, C. A. C. Optimal Power Flow Subject to Security Constraints Solved With a
587 Particle Swarm Optimizer. *IEEE Trans. Power Syst.* **2008**, *23*, 33–40.
- 388 ~~28.~~ 28. Xinchao, Z. A perturbed particle swarm algorithm for numerical optimization. *Appl. Soft Comput.* **2010**, *10*, 119–124.
- 389 ~~29.~~ 29. Oca, M. A. M. d.; Stutzle, T.; Enden, K. V. d.; Dorigo, M. Incremental Social Learning in Particle Swarms. *IEEE Trans.*
590 *Syst. Man Cybern., Part B (Cybernetics)*. **2011**, *41*, 368–384.
- 391 ~~30.~~ 30. Xu, X.; Pan, Z.; Xi, Y.; Chen, L. Incremental Particle Swarm Optimization. *Phys. Procedia*. **2012**, *24*, 1369–1376.
- 392 ~~31.~~ 31. Majhi, B.; Panda, G. Distributed and robust parameter estimation of IIR systems using incremental particle swarm
593 optimization. *Digit. Signal Process.* **2013**, *23*, 1303–1313.
- 394 ~~32.~~ 32. Aydin, D.; Uğur, A. Automatic Flower Boundary Extraction using IPSOAntK-MEANS Algorithm. *Cybern Syst.* **2010**, *41*,
595 416–434.
- 396 ~~33.~~ 33. Rohiem, N. H.; Soeprijanto, A.; Putra, D. F. U.; Syai'in, M.; Sulistiawati, I. B.; Zahoor, M.; Shah, L. A. Resolving Economic
597 Dispatch with Uncertainty Effect in Microgrids Using Hybrid Incremental Particle Swarm Optimization and Deep Learning
598 Method. *Proc. Pak. Acad. Sci.: A. Physical and Computational Sciences*. **2021**, *58*, 119–129.
- 399 ~~34.~~ 34. Ajami, W. A.; Arief, A.; Nappu, M. B. Optimal power flow for power system interconnection considering wind power
600 plants intermittency. *Int. J. Smart Grid Clean Energy*. **2019**, *8* (3), 372–376.
- 401 ~~35.~~ 35. Nappu, M. B.; Arief, A. Network Losses-Based Economic Redispatch for Optimal Energy Pricing in a Congested Power
602 System. *Energy Procedia, ELSEVIER, September*. **2016**, 311–314.
- 403 ~~36.~~ 36. Nappu, M. B.; Arief, A., Economic redispatch considering transmission congestion for optimal energy price in a
604 deregulated power system. In proceeding of the 2015 International Conference on Electrical Engineering and Informatics
605 (ICEEI), 10–11 Aug. 2015 2015.
- 406 ~~37.~~ 37. Alahmadi, A. A. A.; Belkhier, Y.; Ullah, N.; Abeida, H.; Soliman, M. S.; Khraisat, Y. S. H.; Alharbi, Y. M. Hybrid
607 Wind/PV/Battery Energy Management-Based Intelligent Non-Integer Control for Smart DC-Microgrid of Smart University.
608 *IEEE Access*. **2021**, *9*, 98948–98961.
- 409 ~~38.~~ 38. Kennedy, J.; Eberhart, R., Particle swarm optimization. In proceeding of the IEEE Int. Conf. Neural Networks, Perth,
610 Australia, 1995.
- 411 ~~39.~~ 39. Althobaiti, A.; Ullah, N.; Belkhier, Y.; Jamal Babqi, A.; Alkhamash, H. I.; Ibeas, A. Expert knowledge based
612 proportional resonant controller for three phase inverter under abnormal grid conditions. *Int. J. Green Energy*. **2022**, 1–17.
- 413 ~~40.~~ 40. Dabbagchi, I.; Christie, R. (1993, 1 December 2022). *Power Systems Test Case Archive: 30 Bus Power Flow Test Case*.
614 Available: http://labs.ece.uw.edu/pstca/pf30/pg_tca30bus.htm
- 415 ~~41.~~
- 616

Article

Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF

Muhammad Bachtiar Nappu ^{1,*}, Ardiaty Arief ² and Willy Akbar Ajami ¹

¹ Electricity Market and Power Systems Research Group, Department of Electrical Engineering, Faculty of Engineering, Hasanuddin University, Gowa 92171, Indonesia; wawillyakbar@gmail.com

² Power and Energy Systems Research Group, Department of Electrical Engineering, Faculty of Engineering, Hasanuddin University, Gowa 92171, Indonesia; ardiaty@eng.unhas.ac.id

* Correspondence: bachtiar@eng.unhas.ac.id; Tel.: +62-812-41-693-693

Abstract: Since the power grid grows and the necessity for higher system efficiency is due to the increasing number of renewable energy penetrations, power system operators need a fast and efficient method of operating the power system. One of the main problems in a modern power system operation that needs to be resolved is optimal power flow (OPF). OPF is an efficient generator scheduling method to meet energy demands with the aim of minimizing the total production cost of power plants while maintaining system stability, security, and reliability. This paper proposes a new method to solve OPF by using incremental particle swarm optimization (IPSO). IPSO is a new algorithm of particle swarm optimization (PSO) that modifies the PSO structure by increasing the particle size, where each particle changes its position to determine its optimal position. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. The results of the research on optimal power flow for energy generation costs, system voltage stability, and losses obtained by the IPSO method are superior to the conventional PSO method.

Keywords: economic dispatch; generation cost; incremental particle swarm optimization; incremental social learning; optimal power flow; particle swarm optimization; voltage stability

Citation: Nappu, M.B.; Arief, A.;

Ajami, W.A. Energy Efficiency in Modern Power Systems Utilizing Advanced Incremental Particle Swarm Optimization-Based OPF.

Energies **2023**, *16*, x. <https://doi.org/10.3390/xxxxx>

Academic Editor(s):

Received: date

Revised: date

Accepted: date

Published: date



Copyright: © 2023 by the authors. Submitted for possible open access publication under the terms and conditions of the Creative Commons Attribution (CC BY) license (<https://creativecommons.org/licenses/by/4.0/>).

1. Introduction

Optimal power flow (OPF) is a method for efficiently scheduling power plants with the aim of minimizing the total production costs of the power plants while keeping the system safe and reliable and meeting the load demands by considering network losses and network constraints. OPF is one of the most essential studies in modern power systems operation to maintain and enhance system security, stability, and reliability. OPF will decide the optimal operational settings of the electricity grid that are experiencing operational and physical obstacles. Then by using the optimization algorithm technique, elements that regulate the optimal point are expressed and formulated. The main intention of the OPF method is to determine the control variable settings and the equation system that optimizes the value of the objective functions. The selection of this function must be based on a cautious examination of the technical and economic aspects of the electric power system. Moreover, the rapid growth of the network and the need for efficiency in the electrical system make the system operators look for fast and efficient methods in the electric power system operation and planning.

There are many methods for solving OPF problems, ranging from conventional methods, such as AC-OPF [1], DC-OPF [2], and SF-OPF [3,4], to using artificial intelligence

Commented [M1]: Notes for Authors

1. The initial layout for your manuscript was done by our layout team. Please do not change the layout, otherwise we cannot proceed to the next step.
2. Please do not delete our comments.
3. Please revise and answer all questions that we proposed. Such as: "It should be italic"; "I confirm"; "I have checked and revised all."
4. Please directly correct on this version.
5. Please make sure that all the symbols in the paper are of the same format.
6. Please note that at this stage (the manuscript has been accepted in the current form), we will not accept authorship or content changes to the manuscript text. Further updates after publication should be carefully considered.

Commented [Editor2]: Please confirm change.

Commented [KZ3R2]: I accept the change

Commented [M6]: Please carefully check the accuracy of names and affiliations.

Commented [KZ7R6]: I have checked the names, they are all correct

Commented [M8]: Please provide the name of the city instead of the district/town/county/province/state.

Commented [KZ9R8]: I confirm Gowa is correct

Commented [M4]: Please check all author names carefully.

Commented [KZ5R4]: All the author names are correct

or nature-inspired optimization techniques, such as bat algorithms [5], particle swarm optimization [6], bacterial foraging method [7], whale optimization algorithm [8], artificial bee colony [9], differential search algorithm [10], grey wolf optimizer and differential evolution [11], hunger games search (HGS) [12], moth swarm algorithm [13], gravitational search algorithm [14], teaching-learning-based optimization [15], circle search algorithm (CSA) [16], improved harmony search method [17], modified imperialist competitive algorithm [18], improved colliding bodies optimization algorithm [19], improved electromagnetism-like mechanism method [20], Gbest guided artificial bee colony [21], Lévy mutation teaching-learning-based optimization [22], and horse herd optimization [23]. A complete review of the most recent optimization techniques for OPF is presented in [24].

Metaheuristic optimization approaches do not constantly assure obtaining an absolute optimum answer to the problem, but a rational solution that is close to a global ideal solution. Therefore, new algorithms are always being developed, which are also motivated by the “No Free Lunch” theorem [25] that declares no optimization technique to be believed as the only pre-eminent method in solving all optimization problems. Some algorithms have succeeded in obtaining the optimum solution, but some algorithms are commonly slow in convergence. Some of these methods are easily trapped in the optimum locale, or other words converge prematurely. Some stochastic algorithms have been demonstrated to be very successful in nonlinear problems, although they do not guarantee optimum global solutions within time limits. Optimization has been tried with many constraints by developing mathematical programming and modern heuristic search. The evolution of the search method is no stranger to solving mathematical functions. Natural selection and metaheuristics are very useful for finding optimum global solutions. Specifically in the problem of OPF, since OPF is a vital and challenging issue in the operation of power systems and stability enhancement, power system researchers are continuously attracted to develop new algorithms for optimization or to enhance the existing approaches to acquire a more effective solution of OPF.

One of the optimization methods often used to solve OPF problems is the particle swarm optimization (PSO) method [6,26,27]. The PSO method is an optimization technique based on the swarm population that utilizes the experience of the cognitive and social principles of each swarm particle. The advantages of the PSO algorithm are its simple concept and memory, and the initial population is preserved, based on a “productive teamwork” among particles, so it is easy to implement and computationally efficient. Nevertheless, the shortcoming of this algorithm is due to its fast convergence, in which sometimes, throughout the optimization procedure, PSO cannot find a wider solution space and results in a quick loss of diversity, which inevitably becomes caught in local optima or unwanted premature converges, meaning quickly finding solutions to local solutions [28].

The concept of the metaheuristic method is to make a trade-off between exploration and exploitation [13]. This technique starts with high exploration or high population diversity and then, through the search process, reduces its diversity. However, decreasing diversity will not always lead to worthy exploitation or rapid convergence. Therefore, the diversity of the population is still a trapped dilemma and requires careful and clever handling.

In a system consisting of many learning particles or agents, each particle/agent not only must familiarize itself with the characteristics of the environment but also must adjust itself to variations of other particles' behavior. This issue becomes crucial in the research of swarm intelligence especially if a large particle quantity is engaged in the study because the learning process becomes more difficult. Therefore, to overcome this challenge, in this paper, we propose an approach based on rising population numbers because in some circumstances, it can facilitate the scalability of the schemes composed of numerous learning particles. This technique is motivated by the societal learning prodigies of animal populations and is called incremental social learning (ISL) [29]. The ISL algorithm

Commented [Editor10]: Please check that intended meaning is retained.

Commented [KZ11R10]: I have checked and revised it

implemented on PSO produces an IPSO (incremental particle swarm optimization) algorithm, where the size of the population rises over time. In IPSO, once a new particle is inserted into the population, the position of the new particle is instigated using a “societal learning” instruction that will lead to a preference near the best particle.

IPSO is an optimization technique where each particle changes its position to determine its optimal position. The advantage of IPSO is that the population size increases with each iteration so that the optimization process becomes faster. In the literature, there is not much research implementing this IPSO method. A work by [30] compared the performance of PSO and IPSO, and their experimental results showed that IPSO was able to obtain better and faster solutions than PSO. A paper by [31] designed an IIR system identification task with a robust distributed algorithm based on incremental PSO, and the results showed excellent identification performance. A hybrid IPSO, ant colony optimization, and K-means (IPSOAntK-means) algorithm was proposed for automatic flower boundary extraction, and the results informed that this hybrid IPSO method was one of the best methods [32]. Economic dispatch was proposed using IPSO and deep learning (DL). The result was that IPSO required more time than DL, but the results of IPSO were better than DL [33]. Therefore, this paper proposes a novel method for OPF by using incremental particle swarm optimization, called IPSO-OPF. The proposed method is implemented in the IEEE 30-bus system.

The next section of this paper is structured as follows: Section 2 describes the objective functions and constraints in the optimal power flow. Section 3 outlines the proposed methodology of incremental particle swarm optimization. Section 4 provides the results and analysis; then Section 5 concludes the key outcomes of this study.

2. Optimal Power Flow

Optimal power flow (OPF) is a study that analyses the optimum settings in an electric power system. OPF was initially proposed by Carpentier in 1962 and has gone through a long time to develop various methods of solving power flow problems that can be applied today. The main role of OPF is to determine the optimum settings for the power system [34]. OPF optimizes objective functions that are problematic in the electric power system, such as the total cost function of generation or economic dispatch, the network losses function, and the voltage deviation function on each bus by taking into account the limitations that exist in the operation of the equipment [2,35,36]. While optimizing the system’s objective function, OPF also maintains the system stability by keeping the system balance between electricity generation and consumption [37].

2.1. Objective Functions

In the multi-objective optimal power flow, there are several objective functions used, namely the generation cost function and the network losses function.

2.1.1. The Generation Cost Function

The objective function of OPF, also known as economic dispatch, is to obtain a minimization of generating fuel costs by not violating the security constraint of each generator. The generation cost function is a mathematical function modeling to be optimized. The objective function equation for the generation cost is a nonlinear function. The minimum generation cost formulation is derived as follows:

$$\text{Min } F = \sum_{i=1}^{N_G} F_i(P_{Gi}) \quad (1)$$

$$F(P_{Gi}) = \sum_{i=1}^{N_G} \alpha_i + \beta_i P_{Gi} + \gamma_i (P_{Gi})^2 \quad (2)$$

where

- F : total generation cost (\$/h)
 $F(P_{Gi})$: generation costs from the i^{th} generator, which is a function of the generating power output (\$/h)
 P_{Gi} : the i^{th} generator power output (MW)
 N_G : number of generating units
 $\alpha_i \beta_i \gamma_i$: coefficient of generation cost.

2.1.2. The Network Losses Function

With the network losses objective, all control settings are regulated to minimize the total active power losses. The network losses function is a mathematical modeling to find the value of network losses in the electric power system. The network losses function is also a nonlinear equation. The network losses function in the OPF problem is given in Equation (3):

$$P_{\text{losses}} = \sum_{k=1}^{N_{TL}} g_k \left[|V_i|^2 + |V_j|^2 + 2|V_i||V_j| \cos(\delta_i - \delta_j) \right] \quad (3)$$

where

- P_{losses} : total network active power losses (MW)
 N_{TL} : number of transmission lines in the system
 g_k : the conductance of the k -line connecting the i and j buses
 $|V_i|$: voltage magnitude on the i^{th} bus
 $|V_j|$: voltage magnitude on the j^{th} bus
 δ_i : voltage angle of bus i
 δ_j : voltage angle of bus j

2.2. System Constraints

2.2.1. Equality Constraints

The equality constraint functions are formulated by a balance equation between losses, generating power, and power absorbed by the load as well as the active and reactive power balance equations. Equations (4)–(8) provide the nonlinear power flow equations that control the system:

$$\sum_{i=1}^{N_G} (P_{Gi}) = P_{\text{load}} + P_{\text{losses}} \quad (4)$$

$$\Delta P_i = P_{Gi} - P_{Di} \quad (5)$$

$$\Delta P_i = \sum_{j=1}^N |V_i||V_j||Y_{ij}|(\theta_{ij} - \delta_i + \delta_j) \quad (6)$$

$$\Delta Q_i = Q_{Gi} - Q_{Di} \quad (7)$$

$$\Delta Q_i = \sum_{j=1}^N |V_i||V_j||Y_{ij}|(\theta_{ij} - \delta_i + \delta_j) \quad (8)$$

where

- P_{load} : total system load (MW)
 $\sum_{i=1}^{N_G} (P_{Gi})$: total active power generation (MW)
 P_{Gi} : active power generation at bus i
 P_{Di} : active power demand at bus i
 Q_{Gi} : reactive power generation at bus i

Commented [M12]: We have added a lowercase format to "Where", please confirm. The following highlights are the same

Commented [KZ13R12]: We confirm to accept these changes

Commented [M14]: Please confirm whether to keep the superscript format. The following highlights are the same

Commented [KZ15R14]: I confirm. Please keep the super script format

Q_{Di} : reactive load power at bus i
 $|Y_{ij}|$: the element of bus admittance matrix Y_{bus}
 θ_{ij} : the angle of ij element on Y_{bus}

2.2.2. Inequality Constraints

The inequality constraints of the system are the formulation of continuous and discrete constraints that denote the security and operational constraints of the system, which are as follows:

1. The power plant constraints, which consist of active and reactive power outputs of the power plants, and voltages limited by minimum and maximum limits:

$$P_{Gi}^{min} \leq P_{Gi} \leq P_{Gi}^{max}, \quad i = 1, \dots, N_G \quad (9)$$

$$Q_{Gi}^{min} \leq Q_{Gi} \leq Q_{Gi}^{max}, \quad i = 1, \dots, N_G \quad (10)$$

$$|V_{Gi}^{min}| \leq |V_{Gi}| \leq |V_{Gi}^{max}|, \quad i = 1, \dots, N_G \quad (11)$$

where

P_{Gi}^{min} : the minimum active power of the i^{th} bus generator
 P_{Gi}^{max} : the maximum active power of the i^{th} bus generator
 Q_{Gi}^{min} : the minimum reactive power of the i^{th} bus generator
 Q_{Gi}^{max} : the maximum reactive power of the i^{th} bus generator
 $|V_{Gi}^{min}|$: the minimum voltage magnitudes of the i^{th} bus generator
 $|V_{Gi}^{max}|$: the maximum voltage magnitudes of the i^{th} bus generator
 N_G : number of generator buses

2. Security constraints including the voltage magnitude limit of the load bus:

$$|V_{Lj}^{min}| \leq |V_{Lj}| \leq |V_{Lj}^{max}|, j = 1, \dots, N_{load} \quad (12)$$

where

$|V_{Lj}^{min}|$: the minimum voltage magnitudes of the j^{th} load bus
 $|V_{Lj}^{max}|$: the maximum voltage magnitudes of the j^{th} load bus
 N_{load} : number of load buses

3. The settings of the discrete transformer tap

$$T_{Ti}^{min} \leq T_{Ti} \leq T_{Ti}^{max}, \quad i = 1, \dots, N_T \quad (13)$$

N_T : number of transformers

4. The reactive power injection from compensators

$$Q_{Ci}^{min} \leq Q_{Ci} \leq Q_{Ci}^{max}, \quad i = 1, \dots, N_C \quad (14)$$

N_C : number of compensators

5. The loading of the transmission lines:

$$S_{TLi} \leq S_{TLi}^{max}, \quad i = 1, \dots, N_{TL} \quad (15)$$

3. Proposed Methodology: The Incremental Particle Swarm Optimization–Based Optimal Power Flow

3.1. Incremental Social Learning (ISL)

Incremental social learning (ISL) is usually applied in multiagent algorithms. The basic concept of ISL is to add one agent or particle to a population according to its timetable [29]. The initial population comprises a small number of agents that allow the learning process to be carried out faster than the learning carried out by the larger population. New agents that are added on schedule to a population can quickly learn socially from more

Commented [Editor16]: Is there a missing word here?

Commented [KZ17R16]: I have checked and revised it

experienced agents who have been in the population for some time. Then, gradually, new agents are added to the population, aiming to allocate the optimal number of agents needed to complete a particular task. New agents can learn and acquire understanding from more knowledgeable agents through this social learning, without the new agents needing to spend “money” to obtain that knowledge. In this ISL, new agents can save time to learn new knowledge or to perform their duties. With the presence of a new agent in the inhabitants, the population will then adapt to new circumstances, but existing agents who have become part of the population do not need to be trained on the whole thing from the beginning.

3.2. Particle Swarm Optimization

Particle swarm optimization (PSO) is a metaheuristic method developed by Eberhart and Kennedy [38]. The meaning of swarm in PSO is individuals who flock together as in groups of birds or fish. PSO is a part of an evolutionary model algorithm inspired by the activities of flocks of birds and schools of fish in search of prey, where a flock does not have a front-runner to look for their food, so they will disperse to search for food in an unsystematic way.

In the PSO algorithm, the process of finding a solution is performed by a population containing some particles [39]. PSO is an optimization technique with a concept of population-based activities in a food-searching procedure where each individual is called a particle. Every particle will adjust its position with respect to time. PSO consists of an intelligent population within a given search space. The population is produced unsystematically with the lowest and the largest value. PSO is composed of particles traveling in the search space. Each individual particle signifies the position and location of the obstacle. Each particle travels around a multidimensional search space and adjusts its position according to its own individual experience and the near particle’s experience. Each particle has a position denoted by $\chi_{i,j}^t$ and a velocity symbolized by $V_{i,j}^t$ in an N -dimensional search space, where i represents the i^{th} particle and N represents the dimension of the space search or the number of unknown variables in a system of nonlinear equations. The following are equations that describe the position $\chi_{i,j}^t$ and the velocity $V_{i,j}^t$:

$$\chi_{i,j}^t = \chi_{i,1}^t, \chi_{i,2}^t, \chi_{i,3}^t, \dots, \chi_{i,N}^t \quad (16)$$

$$V_{i,j}^t = V_{i,1}^t, V_{i,2}^t, V_{i,3}^t, \dots, V_{i,N}^t \quad (17)$$

Each particle will look for the optimum answer with the intelligence obtained from its own experience by traversing the dimensions of the search space. Then each particle will adjust its own best position or best solution (local best or personal best— P_{best}) and then acclimatize the position of the best particle from the best value or solution from the entire population (global best— G_{best}) while crisscrossing the search space. PSO does not have crosses between individuals and does not have mutations, and the existing particles are not replaced by other particles during the search process. In every iteration, the particle position that signifies the solution is assessed for its accomplishment by incorporating its solution into the fitness function. Each particle is regarded as a spot in a particular dimension of space. The following equations are mathematical models that describe the mechanism for improving the state of the particle:

$$V_{i,j}^{t+1} = \psi V_{i,j}^t + \mu_1 \varepsilon_1 (\Psi_{i,j}^t - \chi_{i,j}^t) + \mu_2 \varepsilon_2 (Y_{i,j}^t - \chi_{i,j}^t) \quad (18)$$

$$\chi_{i,j}^{t+1} = \chi_{i,j}^t + V_{i,j}^{t+1} \quad (19)$$

where $\Psi_{i,j}^t = \Psi_{i,1}^t, \Psi_{i,2}^t, \dots, \Psi_{i,N}^t$ represent the local best or personal best of the i^{th} particle; $Y_{i,j}^t = Y_{i,1}^t, Y_{i,2}^t, \dots, Y_{i,N}^t$ represent the global best from the whole flock; μ_1 and μ_2 are constants with the positive value, which are normally called acceleration coefficients or learning factors; ε_1 and ε_2 are positive random numbers between 0 and 1 produced at each iteration for each dimension; and ψ is an inertial parameter named the constriction factor,

Commented [M18]: Please confirm whether to keep the superscript format

Commented [KZ19R18]: Yes, please keep the format

which indicates the effect of changing velocity from the old vector to the new vector. Equation (18) is employed to obtain the velocity of the new particle according to the preceding velocity, the distance between the present position and the local best position, and the current distance from the global best position. Then the particle flies to a new position based on Equation (19).

3.3. Implementation of Incremental Social Learning into Particle Swarm Optimization

The implementation of ISL into the PSO algorithm is called incremental particle swarm optimization (IPSO). In ISL, each time a new agent joins the population, the new member must study socially from a more experienced division of agents. In the IPSO algorithm, when a new agent or particle is entered into a population, the position of this new member is adjusted using information from agents who are already part of that population by “social learning” rules.

This process is applied as an initialization instruction that transfers a new particle from a randomly generated original position in the search space to a position closer to the particle position, which serves as a “model” for the new particle to emulate [29]. The rules for initializing the j th dimension of the new particle can be seen in the following equation:

$$\chi'_{new,j} = \chi_{new,j} + \tau(\phi_{model,j} - \chi_{new,j}) \quad (10)$$

where $\chi'_{new,j}$ is the regenerated position of the new particle, $\chi_{new,j}$ is the initial random position of the new particle, $\phi_{model,j}$ is the position of the model particle, and τ is a homogeneously dispersed random number between 0 and 1. After this rule is implemented for every dimension, the best position of the previous new particle is modified to the $\chi'_{new,j}$ value, and its velocity is arranged to zero. For all dimensions, the τ value is the same to confirm that the renewed position of the new particle will be in any place alongside the vector of $\phi_{model,j} - \chi'_{new,j}$. Finally, the new particle neighbors, namely, the collection of particles that will receive information in the next iteration, are generated randomly, taking into account the topological connectivity level of the swarm population.

3.4. Algorithm and Flowchart of the Proposed Incremental PSO-Based OPF

The computational steps to calculate the optimal power flow based on IPSO are described in detail as follows, and the flowchart can be seen in Figure 1:

- Step 1 : Input data of the system (generator cost function, network losses function, active power generation constraints, transmission line data, and bus data)
- Step 2 : Input IPSO variables (IPSO inertial weighting factor)
- Step 3 : Set the iteration equal to 1
- Step 4 : Generate population size “N” where each particle in the IPSO algorithm is determined by various control variables
- Step 5 : Initialize the resulting population as P_{best} and eliminate the particles that do not satisfy the system inequality constraints
- Step 6 : Run the optimal power flow program for each particle
- Step 7 : Calculate and evaluate the fitness value for each particle and determine the G_{best} value among all particles
- Step 8 : Calculate and update each particle’s velocity
- Step 9 : Adjust each particle’s position and eliminate the particles that do not meet the constraints.
- Step 10 : Assess the fitness value of the new population with P_{best} ; then select the better particle that also satisfies the constraints
- Step 11 : Particles with higher fitness function values are designated as P_{best}
- Step 12 : If $iter < iter_{max}$, then add a new particle into the population whose position is adjusted according to the “rules of social learning” and go to Step 6; otherwise, go to Step 13.
- Step 13 : Print the G_{best} value that gives the optimal solution (minimum P_{losses}).

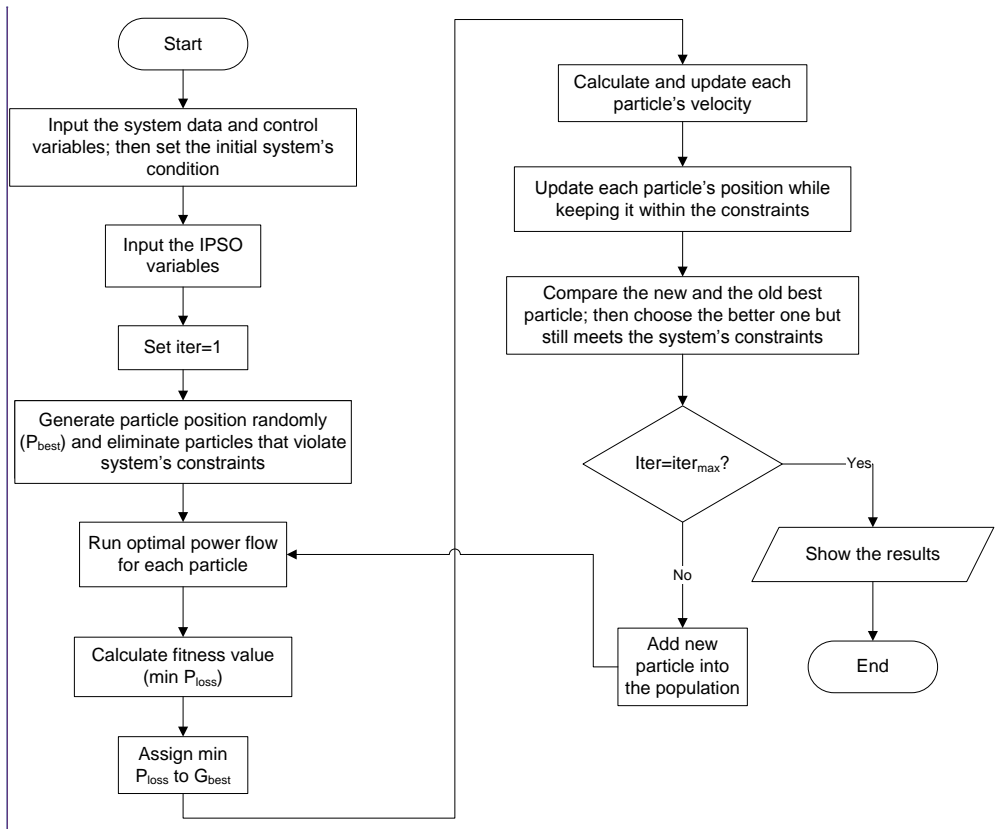


Figure 1. Flowchart of the optimal power flow based on incremental particle swarm optimization.

4. Results and Analysis

This paper uses the IEEE 30-bus system [40] as the case study. The IEEE 30-bus power system consists of two power stations on buses 1 and 2. This system consists of 22 load points spread over each bus with a total load of 283.4 MW of active power and 126.2 MVAR of reactive power. Figure 2 shows the single-line diagram of the IEEE 30-bus system.

Table 1 shows the generation data contained in the IEEE 30-bus system consisting of active power and reactive power generated by the generator, minimum and maximum active and reactive power that can be generated by the generator, and the generation coefficient of each generator. As for the voltage profile constraint on each bus, it is determined to be 0.95 p.u. as the lower limit and 1.05 p.u. as the upper limit.

In this study, the results of OPF based on IPSO are compared with conventional PSO. For OPF using the proposed method IPSO, it is named IPSO-OPF, and OPF using conventional PSO is called PSO-OPF. The fundamental modification of IPSO from PSO lies in the renewal of new particles. The update of new particles on PSO uses the constant $\chi = 0.729$, while the renewal of new particles on IPSO uses random numbers between 0 and 1. This difference affects the speed of obtaining the best fitness.

Commented [Editor20]: Please use comma with semicolon before “then” (“variables; then”, “particle; then”). Apply consistent capitalization style.

Commented [KZ21R20]: I have checked and revised all

Commented [M22]: The picture should appear after the mention in the main text. We have adjusted the position of Figure 1. Please confirm.

Commented [KZ23R22]: I confirm and accept the change

Commented [Editor24]: Please check that intended meaning is retained.

Commented [KZ25R24]: I have checked and it is correct

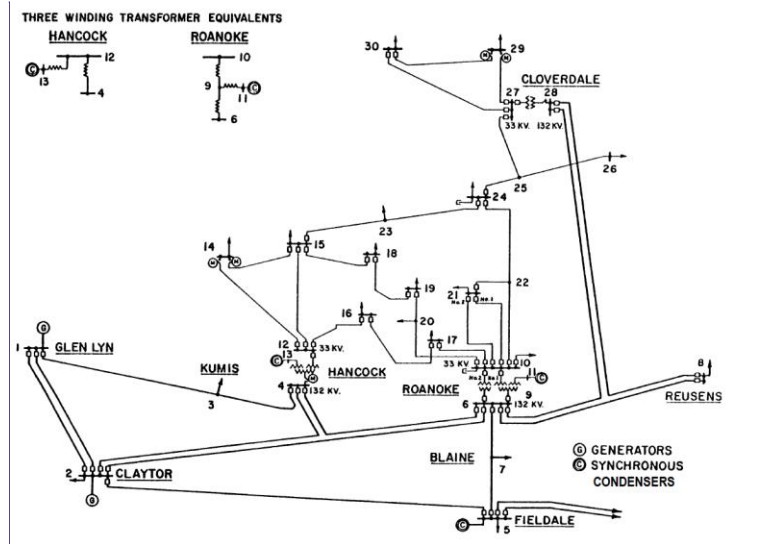


Figure 2. A single-line diagram of the IEEE 30-bus system [40].

Table 1. Generator data and cost coefficient [40].

| Bus | P_{Gi} (MW) | Q_{Gi} (MVA _r) | Generator Constraints | | | | Generation Cost coefficients | | |
|-----------|---------------|------------------------------|-----------------------|---------------------|------------------------------------|------------------------------------|------------------------------|--------------------|-----------------------------------|
| | | | P_{Gi}^{max} (MW) | P_{Gi}^{min} (MW) | Q_{Gi}^{max} (MVA _r) | Q_{Gi}^{min} (MVA _r) | α_i (\$/h) | β_i (\$/MWh) | γ_i (\$/MW ² h) |
| 1 (Gen 1) | 191.7 | 29 | 191.7 | 20 | 30 | -10 | 1243.53 | 38.301 | 0.035 |
| 2 (Gen 2) | 40 | 10 | 140 | 5 | 50 | -40 | 451.325 | 46.159 | 0.105 |

Figure 3 shows a comparison of the number of iterations between the PSO and IPSO methods in the optimal power flow in the IEEE 30-bus system. Utilizing the IPSO-OPF method in power flow optimization has a faster time to converge than the PSO-OPF method. Furthermore, the IPSO-OPF method obtained a convergent value of 12.56 MW of system active power losses in the 25th iteration, while the PSO-OPF method converged in the 69th iteration with a result of 12.58 MW of active power losses. Hence, it can be seen that in determining active power losses, the minimum value is obtained using the IPSO-OPF method with fewer iterations.

Commented [Editor26]: Should it be “CONDENSERS”?

Commented [KZ27R26]: I have change it to CONDENSERS

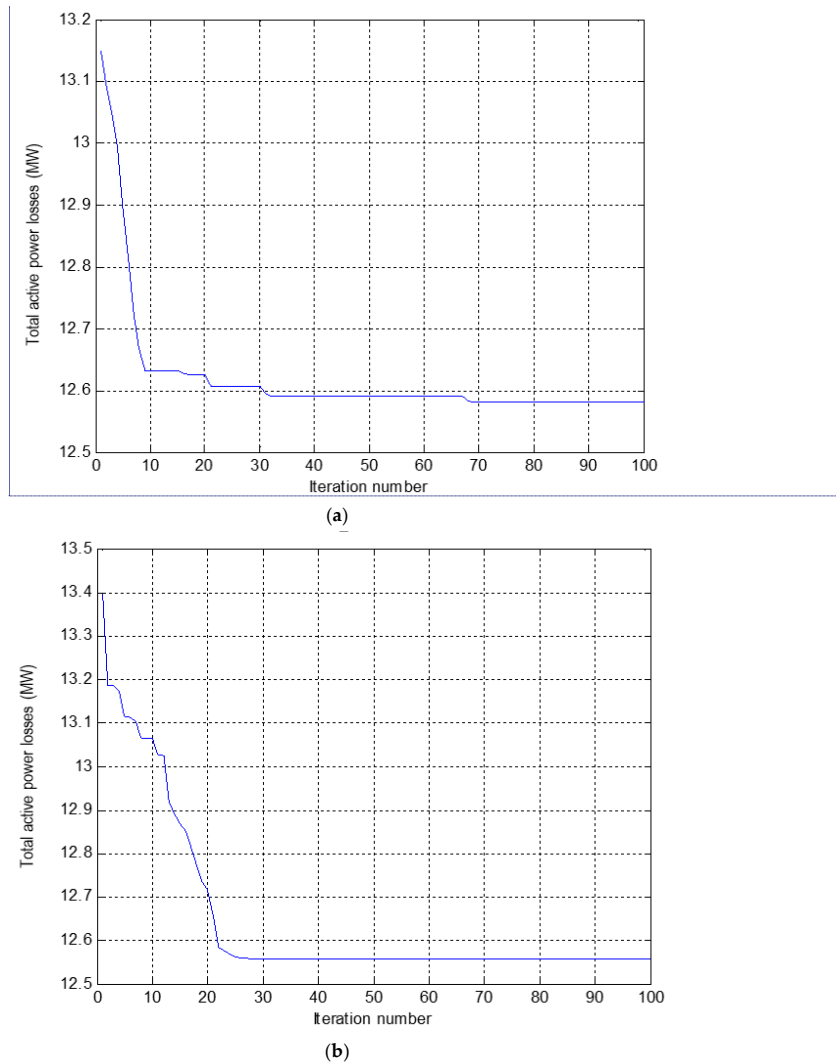


Figure 3. Number of iterations by using (a) the PSO-OPF method and (b) the IPSO-OPF method.

Table 2 shows a comparison of the generation costs between the IPSO-OPF method and the PSO-OPF method, including a summary of the comparison of optimal power flow results between the IPSO-OPF and PSO-OPF methods with iteration, active power losses, and generation costs as parameters. By using the PSO-OPF method, the total power generated by generator 1 is 191.7 MW, while the total power generated by generator 2 is 74.28 MW with a total cost of generating using the PSO-OPF method of USD 14,331/h. Meanwhile, using the IPSO-OPF method, the power generated by generators 1 and 2 is 191.7 and 74.26 MW, respectively. The total cost of generating the IPSO-OPF method is USD

Commented [Editor28]: Please apply consistent capitalization style.

Commented [KZ29R28]: I have checked and revised

Commented [Editor30]: Please check that intended meaning is retained.

Commented [KZ31R30]: I have checked and it is correct

14,330/h. Thus, it can be seen that by using the IPSO-OPF method, the generation cost obtained is slightly cheaper than the generation cost using the PSO-OPF method.

It can be seen from Table 2 that the IPSO-OPF method converges faster at the 25th iteration than the PSO-OPF method, which converges at the 69th iteration. The active power losses obtained using the IPSO-OPF method are also lesser than the PSO-OPF method. As for the cost of generation, the IPSO-OPF method also produces a generation cost that is cheaper than the cost of generating the PSO-OPF method. Therefore, overall, the performance of IPSO-OPF is superior to the conventional PSO-OPF in solving optimal power flow, especially since IPSO-OPF converges faster than the conventional PSO-OPF.

Table 2. Comparison of the generation costs of the PSO-OPF and IPSO-OPF methods.

| Methods | Active Power (MW) | | Cost (\$/h) | | Active Power Losses (MW) | Total Cost (\$/h) | Number of Iterations |
|---------|-------------------|-------|-------------|-------|--------------------------|-------------------|----------------------|
| | Gen 1 | Gen 2 | Gen 1 | Gen 2 | | | |
| PSO | 191.7 | 74.28 | 9872 | 4459 | 12.58 | 14,331 | 69 |
| IPSO | 191.7 | 74.26 | 9872 | 4458 | 12.56 | 14,330 | 25 |

Figure 4 shows a comparison of the voltage profiles on each bus using the IPSO-OPF and PSO-OPF methods. It is obvious that the voltage magnitude obtained from the IPSO-OPF method on average is higher than the voltage magnitude using the PSO-OPF method; consequently, in general, the system voltage stability performance obtained using the IPSO-OPF method is better than the PSO-OPF method.

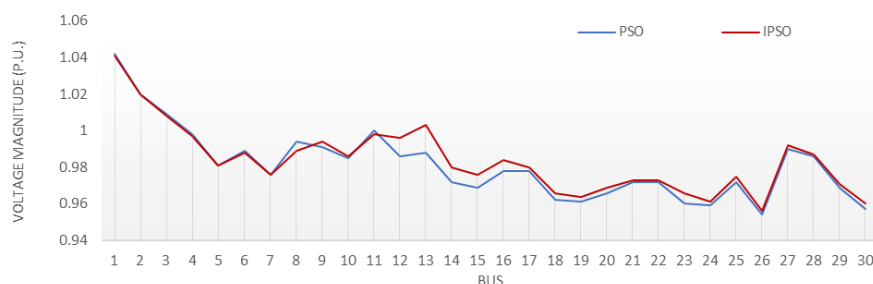


Figure 4. Voltage profile comparison between PSO-OPF and IPSO-OPF.

Voltage magnitudes, active power losses, and generation costs between the IPSO-OPF and PSO-OPF methods have values that are not much different. This is because the fundamental difference between the two methods is in the iteration speed to obtain a convergent value.

5. Conclusions

This paper proposes a new method for optimal power flow using incremental particle swarm optimization (IPSO). IPSO is the development of the metaheuristic PSO method in which incremental social learning (ISL) is implemented into the PSO algorithm. ISL is stirred by the phenomenon of societal learning in the society of animals. In IPSO, the population size grows from iteration to iteration. When a new particle joins the population, its position is adjusted using a “societal learning” rule that persuades a preference toward the best particle. The advantage of IPSO is that the population increases with each iteration so that the optimization process becomes faster. The simulation results using the IEEE 30-bus system show that the performance of IPSO-OPF is superior to conventional PSO-OPF in resolving the optimal power flow mainly because IPSO-OPF converges faster than

conventional PSO-OPF. IPSO-OPF results in fewer iterations, lower active power loss, a better system voltage profile, and lower generation costs than the PSO-OPF method.

Author Contributions: Conceptualization, M.B.N. and A.A.; methodology, M.B.N. and A.A.; software, M.B.N. and W.A.A.; validation, M.B.N. and A.A.; formal analysis, M.B.N. and A.A.; investigation, M.B.N. and W.A.A.; resources, M.B.N. and W.A.A.; data curation, W.A.A.; writing—original draft preparation, M.B.N., A.A., and W.A.A.; writing—review and editing, M.B.N. and A.A.; visualization, A.A.; supervision, M.B.N.; project administration, W.A.A.; funding acquisition, M.B.N. All authors have read and agreed to the published version of the manuscript.

Funding: This research received no external funding.

Data Availability Statement: The data used in this study are available from the authors upon reasonable request.

Conflicts of Interest: The authors declare no conflicts of interest.

References

- Venzke, A.; Chatzivasilieiadis, S.; Molzahn, D.K. Inexact convex relaxations for AC optimal power flow: Towards AC feasibility. *Electr. Power Syst. Res.* **2020**, *187*, 106480. <https://doi.org/10.1016/j.epsr.2020.106480>.
- Nappu, M.B. LMP-lossless for congested power system based on DC-OPF. In proceeding of the 2014 Makassar International Conference on Electrical Engineering and Informatics (MICEEI), Makassar, Indonesia, 26–30 November 2014.
- Nappu, M.B.; Arief, A.; Bansal, R.C. Transmission management for congested power system: A review of concepts, technical challenges and development of a new methodology. *Renew. Sustain. Energy Rev.* **2014**, *38*, 572–580. <https://doi.org/10.1016/j.rser.2014.05.089>.
- Nappu, M.B.; Bansal, R.; Saha, T.K. Market power implication on congested power system: A case study of financial withheld strategy. *Int. J. Electr. Power Energy Syst.* **2013**, *47*, 408–415. <https://doi.org/10.1016/j.ijepes.2012.09.016>.
- Venkateswara Rao, B.; Nagesh Kumar, G.V. Optimal power flow by BAT search algorithm for generation reallocation with unified power flow controller. *Int. J. Electr. Power Energy Syst.* **2015**, *68*, 81–88. <https://doi.org/10.1016/j.ijepes.2014.12.057>.
- Naderi, E.; Pourakbari-Kasmaei, M.; Abdi, H. An efficient particle swarm optimization algorithm to solve optimal power flow problem integrated with FACTS devices. *Appl. Soft Comput.* **2019**, *80*, 243–262. <https://doi.org/10.1016/j.asoc.2019.04.012>.
- Amjady, N.; Fatemi, H.; Zareipour, H. Solution of Optimal Power Flow Subject to Security Constraints by a New Improved Bacterial Foraging Method. *IEEE Trans. Power Syst.* **2012**, *27*, 1311–1323. <https://doi.org/10.1109/tpwrs.2011.2175455>.
- Swief, R.; Hassan, N.M.; Hasanien, H.M.; Abdelaziz, A.Y.; Kamh, M. AC&DC optimal power flow incorporating centralized/decentralized multi-region grid control employing the whale algorithm. *Ain Shams Eng. J.* **2021**, *12*, 1907–1922. <https://doi.org/10.1016/j.asej.2021.01.004>.
- Adaryani, M.R.; Karami, A. Artificial bee colony algorithm for solving multi-objective optimal power flow problem. *Int. J. Electr. Power Energy Syst.* **2013**, *53*, 219–230. <https://doi.org/10.1016/j.ijepes.2013.04.021>.
- Abaci, K.; Yamacli, V. Differential search algorithm for solving multi-objective optimal power flow problem. *Int. J. Electr. Power Energy Syst.* **2016**, *79*, 1–10. <https://doi.org/10.1016/j.ijepes.2015.12.021>.
- El-Fergany, A.A.; Hasanien, H.M. Single and Multi-objective Optimal Power Flow Using Grey Wolf Optimizer and Differential Evolution Algorithms. *Electr. Power Compon. Syst.* **2015**, *43*, 1548–1559. <https://doi.org/10.1080/15325008.2015.1041625>.
- Al-Kaabi, M.; Dumbra, V.; Eremia, M. Single and Multi-Objective Optimal Power Flow Based on Hunger Games Search with Pareto Concept Optimization. *Energies* **2022**, *15*, 8328. <https://doi.org/10.3390/en15228328>.
- Mohamed, A.-A.A.; Mohamed, Y.S.; El-Gaafary, A.A.; Hemeida, A.M. Optimal power flow using moth swarm algorithm. *Electr. Power Syst. Res.* **2017**, *142*, 190–206. <https://doi.org/10.1016/j.epsr.2016.09.025>.
- Duman, S.; Güvenç, U.; Sönmez, Y.; Yörükere, N. Optimal power flow using gravitational search algorithm. *Energy Convers. Manag.* **2012**, *59*, 86–95. <https://doi.org/10.1016/j.enconman.2012.02.024>.
- Boučekara, H.; Abido, M.; Boucherma, M. Optimal power flow using Teaching-Learning-Based Optimization technique. *Electr. Power Syst. Res.* **2014**, *114*, 49–59. <https://doi.org/10.1016/j.epsr.2014.03.032>.
- Shaheen, M.A.M.; Ullah, Z.; Qais, M.H.; Hasanien, H.M.; Chua, K.J.; Tostado-Véliz, M.; Turkey, R.A.; Jurado, F.; Elkadeem, M.R. Solution of Probabilistic Optimal Power Flow Incorporating Renewable Energy Uncertainty Using a Novel Circle Search Algorithm. *Energies* **2022**, *15*, 8303. <https://doi.org/10.3390/en15218303>.
- Sinsuphan, N.; Leeton, U.; Kulworawanichpong, T. Optimal power flow solution using improved harmony search method. *Appl. Soft Comput.* **2013**, *13*, 2364–2374. <https://doi.org/10.1016/j.asoc.2013.01.024>.
- Ghasemi, M.; Ghavidel, S.; Ghanbarian, M.M.; Gharibzadeh, M.; Vahed, A.A. Multi-objective optimal power flow considering the cost, emission, voltage deviation and power losses using multi-objective modified imperialist competitive algorithm. *Energy* **2014**, *78*, 276–289. <https://doi.org/10.1016/j.energy.2014.10.007>.
- Boučekara, H.; Chaib, A.; Abido, M.; El-Sehiemy, R. Optimal power flow using an Improved Colliding Bodies Optimization algorithm. *Appl. Soft Comput.* **2016**, *42*, 119–131. <https://doi.org/10.1016/j.asoc.2016.01.041>.

Commented [M32]: Please do NOT change the reference format with EndNote and other tools. Our production editor has done thoroughly layout work for the reference. Thanks for your cooperation.

20. Bouchehara, H.R.E.-H.; Abido, M.A.; Chaib, A.E. Optimal Power Flow Using an Improved Electromagnetism-like Mechanism Method. *Electr. Power Compon. Syst.* **2016**, *44*, 434–449. <https://doi.org/10.1080/15325008.2015.1115919>.
21. Roy, R.; Jadhav, H. Optimal power flow solution of power system incorporating stochastic wind power using Gbest guided artificial bee colony algorithm. *Int. J. Electr. Power Energy Syst.* **2015**, *64*, 562–578. <https://doi.org/10.1016/j.ijepes.2014.07.010>.
22. Ghasemi, M.; Ghavidel, S.; Gitizadeh, M.; Akbari, E. An improved teaching–learning-based optimization algorithm using Lévy mutation strategy for non-smooth optimal power flow. *Int. J. Electr. Power Energy Syst.* **2015**, *65*, 375–384. <https://doi.org/10.1016/j.ijepes.2014.10.027>.
23. Evangeline, S.I.; Rathika, P. Wind farm incorporated optimal power flow solutions through multi-objective horse herd optimization with a novel constraint handling technique. *Expert Syst. Appl.* **2022**, *194*, 116544. <https://doi.org/10.1016/j.eswa.2022.116544>.
24. Risi, B.-G.; Riganti-Fulginei, F.; Laudani, A. Modern Techniques for the Optimal Power Flow Problem: State of the Art. *Energies* **2022**, *15*, 6387. <https://doi.org/10.3390/en15176387>.
25. Wolpert, D.H.; Macready, W.G. No free lunch theorems for optimization. *IEEE Trans. Evol. Comput.* **1997**, *1*, 67–82. <https://doi.org/10.1109/4235.585893>.
26. Abido, M. Optimal power flow using particle swarm optimization. *Int. J. Electr. Power Energy Syst.* **2002**, *24*, 563–571. [https://doi.org/10.1016/s0142-0615\(01\)00067-9](https://doi.org/10.1016/s0142-0615(01)00067-9).
27. Yumbala, P.E.O.; Ramirez, J.M.; Coello, C.A.C. Optimal Power Flow Subject to Security Constraints Solved with a Particle Swarm Optimizer. *IEEE Trans. Power Syst.* **2008**, *23*, 33–40. <https://doi.org/10.1109/tpwrs.2007.913196>.
28. Xinchao, Z. A perturbed particle swarm algorithm for numerical optimization. *Appl. Soft Comput.* **2010**, *10*, 119–124. <https://doi.org/10.1016/j.asoc.2009.06.010>.
29. de Oca, M.A.M.; Stutzle, T.; Edden, K.V.D.; Dorigo, M. Incremental Social Learning in Particle Swarms. *IEEE Trans. Syst. Man Cybern. Part B (Cybern.)* **2011**, *41*, 368–384. <https://doi.org/10.1109/tsmcb.2010.2055848>.
30. Xu, X.; Pan, Z.; Xi, Y.; Chen, L. Incremental Particle Swarm Optimization. *Phys. Procedia* **2012**, *24*, 1369–1376. <https://doi.org/10.1016/j.phpro.2012.02.204>.
31. Majhi, B.; Panda, G. Distributed and robust parameter estimation of IIR systems using incremental particle swarm optimization. *Digit. Signal Process.* **2013**, *23*, 1303–1313. <https://doi.org/10.1016/j.dsp.2013.02.015>.
32. Aydin, D.; Uğur, A. Automatic Flower Boundary Extraction using IPSOAntK-MEANS Algorithm. *Cybernetics Syst.* **2010**, *41*, 416–434.
33. Rohiem, N.H.; Soeprijanto, A.; Putra, D.F.U.; Syai'In, M.; Sulistiawati, I.B.; Zahoor, M.; Shah, L.A. Resolving Economic Dispatch with Uncertainty Effect in Microgrids Using Hybrid Incremental Particle Swarm Optimization and Deep Learning Method. *Proc. Pak. Acad. Sci. A. Phys. Comput. Sci.* **2021**, *58*, 119–129. [https://doi.org/10.53560/ppasa\(58-sp1\)762](https://doi.org/10.53560/ppasa(58-sp1)762).
34. Ajami, W.A.; Arief, A.; Nappu, M.B. Optimal power flow for power system interconnection considering wind power plants intermittency. *Int. J. Smart Grid Clean Energy* **2019**, *8*, 372–376. <https://doi.org/10.12720/sgce.8.3.372-376>.
35. Nappu, M.B.; Arief, A. Network Losses-based Economic Redispatch for Optimal Energy Pricing in a Congested Power System. *Energy Procedia* **2016**, *100*, 311–314. <https://doi.org/10.1016/j.egypro.2016.10.183>.
36. Nappu, M.B.; Arief, A. Economic redispatch considering transmission congestion for optimal energy price in a deregulated power system. In Proceeding of the 2015 International Conference on Electrical Engineering and Informatics (ICEEI), Denpasar, Indonesia, 10–11 August 2015. <https://doi.org/10.1109/iceei.2015.7352565>.
37. Al Alahmadi, A.A.; Belkhier, Y.; Ullah, N.; Abeida, H.; Soliman, M.S.; Khraisat, Y.S.H.; Alharbi, Y.M. Hybrid Wind/PV/Battery Energy Management-Based Intelligent Non-Integer Control for Smart DC-Microgrid of Smart University. *IEEE Access* **2021**, *9*, 98948–98961. <https://doi.org/10.1109/access.2021.3095973>.
38. Kennedy, J.; Eberhart, R. Particle swarm optimization. In Proceeding of the ICNN'95-International Conference on Neural Networks, Perth, Australia, 27 November–1 December 1995.
39. Althobaiti, A.; Ullah, N.; Belkhier, Y.; Babqi, A.J.; Alkhamash, H.I.; Ibeas, A. Expert knowledge based proportional resonant controller for three phase inverter under abnormal grid conditions. *Int. J. Green Energy* **2022**, *1–17*. <https://doi.org/10.1080/15435075.2022.2107395>.
40. Dabbagchi, I.; Christie, R. Power Systems Test Case Archive: 30 Bus Power Flow Test Case. 1993. Available online: http://labs.ece.uw.edu/pstca/pf30/pg_tca30bus.htm (accessed on 1 December 2022).

Disclaimer/Publisher's Note: The statements, opinions and data contained in all publications are solely those of the individual author(s) and contributor(s) and not of MDPI and/or the editor(s). MDPI and/or the editor(s) disclaim responsibility for any injury to people or property resulting from any ideas, methods, instructions or products referred to in the content.

Commented [M33]: Newly added information. Please confirm.

Commented [KZ34R33]: I confirm OK

Commented [M35]: Please add the volume number.

Commented [KZ36R35]: I have checked again and no volume number is provided for this paper