

mzah_2020_IOP_Conf._Ser._E
arth_Environ._Sci._402_012021.
pdf
by

Submission date: 17-Aug-2020 04:25AM (UTC+0700)

Submission ID: 1370266445

File name: mzah_2020_IOP_Conf._Ser._Earth_Environ._Sci._402_012021.pdf (381.47K)

Word count: 4256

Character count: 22061

PAPER • OPEN ACCESS

9

Adaptive thermal comfort of naturally ventilated classrooms of elementary schools in the tropics

To cite this article: Baharuddin Hamzah *et al* 2020 *IOP Conf. Ser.: Earth Environ. Sci.* **402** 012021

View the [article online](#) for updates and enhancements.

9

Adaptive thermal comfort of naturally ventilated classrooms of elementary schools in the tropics

Baharuddin Hamzah^{*}, Rosady Mulyadi, Samsuddin Amin, Asniawaty Kusno
Department of Architecture, Faculty of Engineering, Hasanuddin University, ,
Indonesia

*Corresponding e-mail: baharsyah@unhas.ac.id

Abstract. Thermal comfort is one of the very important factors in enhancing the human quality of life, including students who spend a lot of times learning in schools. This article was intended to analyze the students' adaptive thermal comfort in naturally ventilated classrooms of the elementary schools in the tropical city of Makassar. The study analyzed data gathered from 33 surveyed classrooms in six primary schools. The recorded data consisted of the personal and adaptive behavior of 1,111 students, and the thermal environments of the classrooms. At the same time, students filled out the questionnaires asking their thermal sensation, comfort level, and thermal preferences against the classrooms' thermal environments. The results of measurements showed that the indoor mean air temperature, air humidity, and air velocity were 30.4 °C, 68%, and 0.1 m/s, respectively. They indicated that the classrooms had the hot temperature, high humidity, and low air velocity. The calculated PMV based on these parameters showed that about 90% of students felt either warm (+2) or hot (+3). The PMV overestimated the actual students' thermal comfort where more than 85% of students voted slightly cool (-1), neutral (0), and slightly warm (+1). In addition, the neutral temperature predicted by PMV was 25.5 °C. This neutral temperature was very low in comparison to 30.2 °C calculated by using thermal sensation vote (TSV). These suggested that students of elementary schools in the tropic were tolerant to the hot environment. The use of the adaptive models to calculate the neutral temperature of students presented similar results gathered from actual votes. Therefore, the adaptive model became the best method to explain the thermal comfort of students in the elementary schools in the tropics.

Keywords: adaptive model, air temperature, neutral temperature, thermal comfort, elementary schools

13

1. Introduction

Thermal comfort is an important factor in increasing the human quality of life, including students who spend a lot of times learning in schools. In 1968, Pepler and Warner discovered a positive effect of the classrooms' thermal quality on students' performances [1]. Mendell and Heath [2] carried out an extensive literature review and found that a good correlation between indoors' school environments, which include thermal comfort and the students' performance, and attendance records. It is necessary to provide a healthy and comfortable environment in schools to enhance students' productivity and well-being [3].

A number of articles have analyzed and discussed the students' thermal comfort in the classrooms in countries worldwide, which have different climate types. For examples, the analysis of students'



Content from this work may be used under the terms of the [Creative Commons Attribution 3.0 licence](https://creativecommons.org/licenses/by/3.0/). Any further distribution of this work must maintain attribution to the author(s) and the title of the work, journal citation and DOI.

thermal comfort in classrooms in the temperate climate was carried out in United Kingdom (UK) [4-6]. Several studies have also been conducted in the Mediterranean climate, such as in Italy [7-9], in the subtropical climate in, Japan [10,11], Taiwan [12], and Australia [13]. In the tropical area, a number of thermal comfort studies have also been carried out. The studies included in Malaysia [10], Singapore [14], Indonesia [15-19] and Hawaii [20]. Most of these thermal comfort studies were established on the heat balance models using the predicted mean vote (PMV) model. In 1970 Fanger [21] developed the PMV model, which later on was adopted by ASHRAE to become ASHRAE 55 standard [22]. The PMV model is calculated using six variables, i.e. air temperature, relative humidity, mean radiant temperature (MRT), air velocity, index of clothing, and the metabolic rate of respondents' activity. A number of studies found that the PMV model mostly overestimated the respondents' actual vote in the naturally ventilated classrooms in the hot regions, such as in Singapore [14] and Indonesia [16-18]. Wong and Khoo [14] found the neutral temperature in the secondary school in Singapore predicted by PMV was 26.1 °C. It was 2.7 °C lower than the neutral temperature calculated from students' actual voting the thermal sensation vote (TSV). Several studies done by Hamzah et al. [16-18] also found the neutral temperatures predicted by PMV were lower than the students' actual vote using TSV. For example, Hamzah et al. [16] found the neutral temperatures of students were 23.0 °C (PMV) and 29.0 °C (TSV) for secondary schools in Makassar, Indonesia. A big discrepancy of 6 °C was found in this study [16], which led to the doubt of using PMV in predicting thermal comfort in the tropics.

Another thermal comfort model is an adaptive thermal comfort model. The model is especially established for predicting the thermal comfort in naturally ventilated buildings located in the hot environment. Based on the worldwide thermal comfort data collected from 1935 to 1975, Humphreys [23] proposed a linear regression between neutral temperature (T_n) and mean outdoor temperature (T_{out}) as follows:

$$T_n = 11.9 + 0.534T_{out} \quad (1)$$

The equation has subsequently been revised to increase the precision of the relationship as follows [24]:

$$T_n = 13.2 + 0.534T_{out} \quad (2)$$

Auliciems [12] attempted to reanalyze Humphreys' data [23] by eliminating some conflicting data, integrating of more recent field studies results, and uniting data from buildings with passive and active climate control. Auliciems proposed the relationship between neutral temperature (T_n) with average indoor air temperature (T_a) and outdoor monthly temperature (T_{out}):

$$T_n = 9.22 + 0.48T_a + 0.14T_{out} \quad (3)$$

According to Roaf et al. [26], there are three categories of thermal comfort adaptation i.e. physiological, behavioral, and psychological. Among these three adaptation categories, behavioral adaptation is definitely the most common way to do for the people in adjusting their thermal comfort [26]. The behavior adaptations include changing the activity and the clothing levels, closing or opening the windows, switching the fans, switching the air conditionings, etc.

Most of state-owned schools in Makassar or even in Indonesia were planned and constructed as prototype buildings. Usually, no consideration is paid to the condition of local climate and environment. The schools have been built to the same models regardless of the thermal sensation and preference of occupants. During daytime, the classrooms experience hot thermal environment. The temperature mostly varied from 28 °C in the morning to 33 °C in the afternoon [18]. These temperatures are laid outside the comfort zone of ASHRAE [22] or local standards [27]. However, most studies in Makassar show that despite the hot temperature, still more than 80% of students voted in the comfortable region and more than 80% students accepted the hot thermal environment. To explain this phenomenon, a further analysis based on adaptive thermal comfort model in the elementary schools is necessary to be undertaken.

27 2. Methods

2.1. Data collection

The study was carried out at the 33 classrooms in the six chosen primary schools in different locations in Makassar tropical city. The data collection was carried out in two protocols as follows:

- The objective measurement survey was carried out to collect the thermal environment and the personal data. Several instruments have been used for the measurement and collection of indoor environmental data. The main instrument used in the study was the Thermal Comfort Multi Logger (LSI TC) from LSI-Lastem, Italy. The LSI TC consists of three sensors collected and recorded in one data logger. The three sensors include a portable psychrometric forced ventilation probe (BSU106), which was used to collect air temperature and relative humidity. The second sensor is a globe thermometric probe (BST131), which was used to collect the globe temperature. The third sensor is a wet bulb temperature probe (BSU121) for collecting wet bulb temperature. In addition to the LSI TC, Hobo Loggers recorded the measurements of thermal environments inside the classrooms. They were developed and manufactured by Onset in the United States (US). Two types of Hobo loggers were used in the study, namely a standard Hobo, which only measured and recorded the air temperature and relative humidity, and the Hobo logger with external sensor. Four standard Hobo and two Hobo with external sensors were used in the surveys. The external sensors attached in the Hobo loggers were used to measure the air velocity inside the classrooms. The equipment was placed in the six points in the classrooms, with the sensors attached in the pole at about 1 m above the floor level [14]. Because of the number of instruments were limited, two environmental parameters could not be measured at the six points. The MRT was only measured and recorded at point A, and the air velocity at points A and B. The position of instruments in the classrooms was similar that shown in Hamzah et al. [18]. The students' clothing data were written in details in the questionnaires, and the students' activities were recorded by the surveyors.
- The subjective measurement survey was carried out to collect the students' responses level. This was collected by questionnaire method. The questionnaire was developed and modified based on the questionnaire used by Wong and Khoo [14]. This modified questionnaire has also been used in the naturally ventilated classrooms in Makassar [16-19]. The questionnaire has been adapted to include seven questions. Among the seven questions, four questions correlated with the thermal aspects that are thermal sensation, comfort level, reference, and thermal acceptance. The following two questions asked about the students' votes on the air velocity. The last question intended to obtain the students' votes on the humidity. This questionnaire asked the TSV of respondents in seven scales, namely: cold (-3), cool (-2), slightly cool (-1), neutral (0), slightly warm (+1), warm (+2), and hot (+3). The TCV also in seven scales: much too cool (-3), too cool (-2), comfortable cool (-1), comfortable (0), comfortable warm (+1), too warm (+2), and much too warm (+3).

2.2. Data analysis and processing

Data were processed and analyzed by using spreadsheet software and a statistical package. The MS Excel spreadsheet was used to calculate the mean, minimum, and maximum values of environmental data and to generate graph illustrating the proportion of PMV, TSV, and TCV. The availability of two personal variables for each respondent and four environmental variables was required for calculating the PMV of each student. The calculation of PMV was completed using MS Excel spreadsheet template developed by Farina [28]. The PMV calculator was developed based on the ASHRAE standard 55 [22]. Statistical analysis of SPSS (statistical package for social science) software has been used to show the scatterplots of respondents' actual votes (TSV and TCV) and the PMV against the operative temperature (T_o). The linier regressions of the three pairs were also calculated using the SPSS software. The validity of linier regression equations was evaluated by the two criteria. Firstly, the test of linearity of regression to make sure that the regression was linier, and second was the test of

significance of equation coefficient. Before analyzing, the data were verified by examining the normality and reliability of data.

2.3. Research Sample

The surveys and measurements were carried out in six selected elementary schools in Makassar, which represented six sub-districts in the city. The elementary school in Indonesia is known as *Sekolah Dasar* (SD). The selected schools are situated in the dense area in the city center to less dense area in the suburban. The first surveyed school was SD Inpres Nipa-nipa. The selected school is situated in a suburban area, which is far away from the settlements concentration. The second surveyed was in SD Negeri Sudirman 1. This school is located in opposite of the town square in the city center. The school shares its location with three other elementary schools. In the third day, the survey was carried out in the SD Inpres Tamalanrea 4. The school was located in the dense area of residential complex of Bumi Tamalanrea Permai (BTP), which borders with the road environments. The fourth day of the survey was carried out in the SD Inpres Daya. The school is located in the local commercial area. It is adjacent to arterial roads about 13 Km away from the city center. The fifth school to be surveyed was SD Inpres Hartaco Indah. The school is located in the medium density of residential area. The last survey was carried out in the SD Unggulan Toddopuli. The school is situated in the medium density of residential and commercial regions. The characteristics of the samples are illustrated in Table 1.

Table 1: Characteristics of samples and date of survey (adapted from [18])

No.	School name	School location	Number of classes	Number of students	Date of survey
1	Inpres Nipa-nipa	Manggala	5	157	21 April 2016
2	SD Negeri Sudirman 1	Ujung Pandang	6	205	29 April 2016
3	SD Inpres Tamalanrea 4	Tamalanrea	5	160	30 April 2016
4	SD Inpres Daya	Biringkanaya	6	239	3 May 2016
5	SD Inpres Hartaco Indah	Tamalate	5	126	7 May 2016
6	SD Unggulan Toddopuli	Panakkukang	6	224	12 May 2016
Total			33	1,111	

17

3. Results and Discussion

3.1. Outdoor and indoor microclimate conditions

The outdoor microclimate condition was recorded in the Vaisala Station located at the rooftop of Department of Architecture Building, Faculty of Engineering, Gowa Campus. The monthly average outdoor temperatures were 30.2 °C and 30.6 °C for April and May 2016, respectively.

The indoor microclimatic conditions recorded during the measurements can be seen in Table 2. The table shows that the average air temperature was 31.4 °C with minimum and maximum temperature were 28.3 °C and 34.3 °C, respectively. The air temperature condition showed the excessive heat in the classrooms. This average air temperature was higher than the temperature specified in the national standard SNI [27] and international ASHRAE standard [22]. The average of air humidity of 68% was within the comfort zone of SNI [26].


Table 2. The average indoor thermal environment measured at the six schools (adapted from [18])

School name	Air Temp (°C)	RH (%)	MRT (°C)	Air Velocity (m/s)
Inpres Nipa-Nipa	30.9	66.50	30.9	0.13
SD Negeri Sudirman 1	30.0	71.35	29.7	0.10
SD Inpres Tamalanrea 4	30.9	70.48	30.7	0.06
SD Inpres Daya	32.1	67.97	32.1	0.13
SD Inpres Hartaco Indah	32.6	64.11	32.5	0.08
SD Unggulan Toddopuli	32.1	67.73	32.0	0.10

Total	31.4	68.02	31.3	0.10
--------------	-------------	--------------	-------------	-------------

3.2. Students response to the thermal environment based on the thermal balance

This sub-section presents the results that have been explained in Hamzah et al. [18] and were presented in the 51st International Conference on Architectural Science Association (ANZAScA) in Victoria University Wellington, New Zealand in December 2017. Figure 1 demonstrates the response of students to the air temperature in the classrooms. In terms of TSV scale, the majority of respondents (more than 85%) voted the center points (-1, 0 and +1). In details, less than 30% respondents voted the neutral (0) point, about 12% voted the hot regions (+2 and +3), and 2% voted the cold regions (-2 and -3). In the Bedford scale, more than 87% of respondents voted the central region (-1 to +1), about 10% in hot regions (+2 and +3), and only about 2% in the cold regions (-2 and -3). Interestingly, about 50% of respondents felt comfortable (0) in comparison to less than 30% voted neutral (0) in TSV scale.

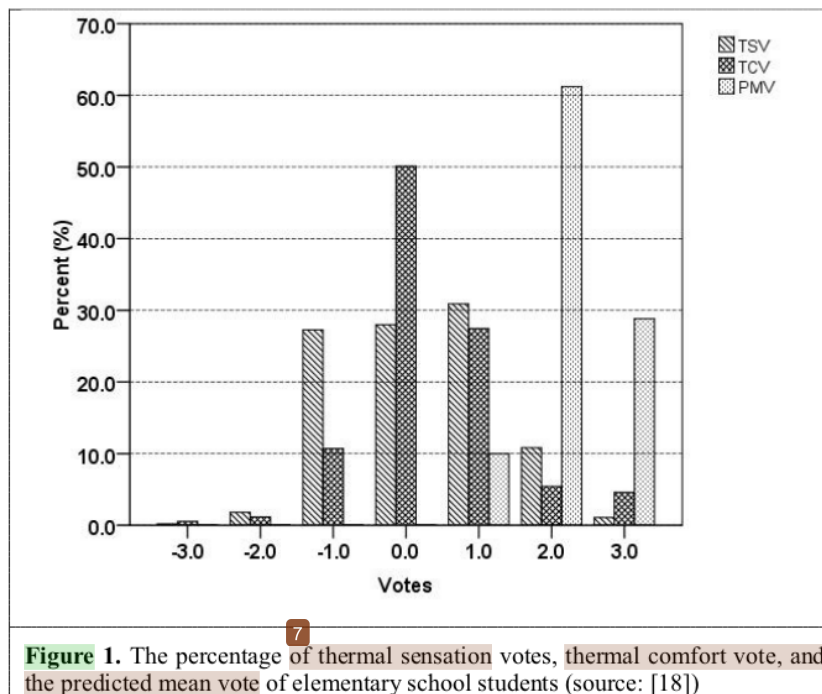

As expected, the percentage of predicted vote was very different from the TSV and TCV. In the predicted model, almost 90% of students were predicted to have votes in the hot regions (+2 and +3), and only 10% respondents were predicted in the central line vote (-1 to +1). The figure suggested that the percentage of votes by PMV model overestimated the respondents' actual votes. In the PMV model, only small number of students would be predicted to feel slightly warm (+1), and no students to be predicted neutral (0), while in the TSV and TCV, there were almost 30% and 50% of students felt neutral and comfortable, respectively. Those results were in line with several studies conducted in Makassar [16,17] and Singapore [14]. This indicates that PMV model may not be suitable for estimating the students' thermal comfort in the naturally ventilated classrooms in the tropical area.

Figure 2 demonstrates the scatterplots and the linier regressions of the operative temperature (T_o) against the predicted PMV, TSV, and the TCV. The operative temperatures ranged from 28.5 °C to 34.0 °C the neutral temperature (T_n) obtained from PMV model was 25.36 °C (T_o). This predicted T_n was lower than that one resulted from actual votes (TSV or TCV). The neutral temperature (T_n) was obtained from the relationship between actual votes (TSV and TCV) and the operative temperature (T_o) were 30.2 °C (T_o) and 29.4 °C (T_o) for TSV and TCV, respectively. The neutral temperature was calculated based on the TSV was very similar to the study conducted in Makassar [16,17] and Singapore [14]. The neutral temperatures obtained from Makassar studies were 29.0 °C and 29.2 °C, respectively for secondary school [16] and university students [17]. While the Singapore study found the neutral temperature of 28.8 °C for secondary school students [14].

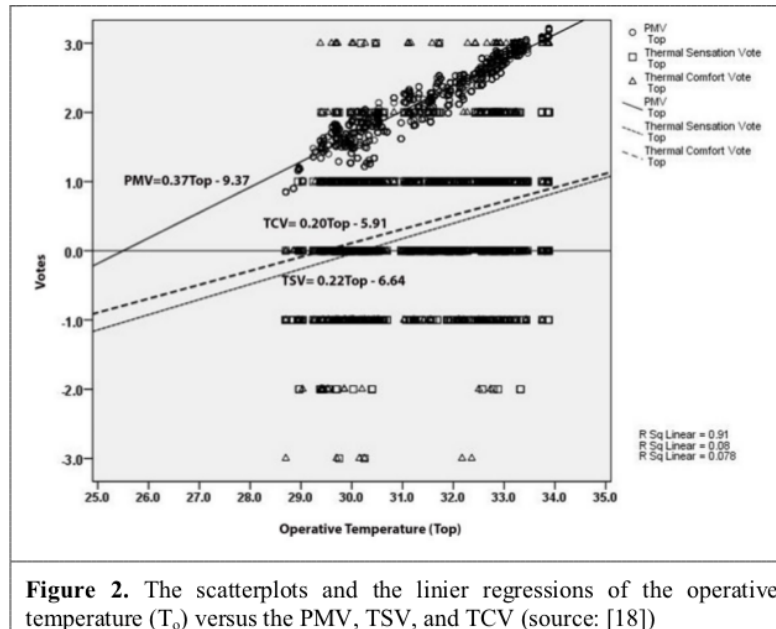


Figure 2. The scatterplots and the linier regressions of the operative temperature (T_o) versus the PMV, TSV, and TCV (source: [18])

3.3. Adaptive thermal comfort

The neutral temperatures (T_n) of each school were calculated using the Humphrey’s model (eq. 2) and Auliciems model (eq. 3). The results of calculations are shown in Table 3. As seen in Table 3, the Humphreys model only produced two neutral temperatures for the six schools, while the Auliciems model produced more varied neutral temperatures. The reason for this is that because Humphreys only uses the outdoor temperature, while Auliciems uses the indoor and outdoor temperature. The Humphreys model gives very close to the neutral temperature calculated from actual votes. In average, Humphreys produced neutral temperature of 29.4 °C, which was close to 30.2 °C resulted from actual votes. The neutral temperature predicted by Auliciems was almost 1 °C below the Humphreys. This might be due to the Auliciems model also included the data gathered from buildings with active thermal control.

Table 3. The comparison of neutral temperatures between Humphreys model and Auliciems model

School name	Air Temp (T_a) (°C)	Out Temp (T_{out}) (°C)	Neutral Temp (T_n) Humphreys model	Neutral Temp (T_n) Auliciems model
SD Inpres Nipa-Nipa	30.9	30.2	29.3	28.3
SD Negeri Sudirman 1	30.0	30.2	29.3	27.8

SD Inpres Tamalanrea 4	30.9	30.2	29.3	28.3
SD Inpres Daya	32.1	30.6	29.5	28.9
SD Inpres Hartaco Indah	32.6	30.6	29.5	29.2
SD Unggulan Toddopuli	32.1	30.6	29.5	28.9
Average	31.4	30.4	29.4	28.6

3.4. Adaptive behavior of students

The surveys discovered that most of students used handheld fans to adjust their thermal comfort. When they felt hot, they mostly used their books for this purpose. Very little students used the battery operated handheld fans. For the classrooms equipped with electric fans, students had very limited access to this equipment. Students should ask permission or wait instruction from their teachers to operate the fans. Students who sat next to the open-able windows could open or close the windows when needed. Because the open-able windows were only located in one side of the classrooms, only very small numbers of students benefited from those facilities.

4. Conclusion

Based on the analysis as mentioned before, it can be concluded that the PMV model cannot explain the thermal sensation and acceptance of students in the hot condition of classrooms in Makassar. The PMV model overestimated the thermal sensation of students. Using the PMV model, only about 10% students predicted to vote in the central line (-1 to +1). With the average air temperature of 30.4 °C, most students (more than 85%) voted the central line, which meant that most students felt neutral or comfortable. The neutral temperature (T_n) of 25.5 °C resulted from the predicted mean vote (PMV) was very low in comparison to the air temperature inside the classrooms, and the neutral temperature (T_n) of actual votes which were 30.2 °C and 29.4 °C for TSV and TCV, respectively. The use of the adaptive models to calculate the neutral temperature of students presented similar results gathered from actual votes. The closest neutral temperature of actual votes was that one predicted by Humphrey's model i.e. 29.4 °C. Therefore, the adaptive model was the best method to explain the thermal comfort of students in the elementary schools in the tropics.

5. Acknowledgments

The work was carried out under Competence Based Research Scheme with Contract Number 019/SP2H/LT/DRPM/II/2016 Dated 17 February 2016. The authors would like to thank the Directorate of Research and Public Services (Ministry of Research, Technology, and Higher Education of Republic of Indonesia) for funding this research and the Hasanuddin University for facilitating the research funding management. The authors would also like to acknowledge the permission and the help obtained from the headmasters/headmistress and teachers of the elementary schools. Finally, the authors would like to thank all students (Doctor and Master) at the Laboratory of Building Science, Department of Architecture (Sahabuddin, Imawaty Idrus, Ansarullah, M. Tayeb Mustamin, Andi Yunita and Robertho Tasrief), who involved in this research during the data collection and data analysis.

6. References

- [1] Pople RD and Warner RE 1968 *ASHRAE Trans.* **74**(1): p. 211-224
- [2] Mendell MJ and Heath GA 2005 *Indoor Air* **15** 27-52.
- [3] Bellia L, Boerstra A, da Silva MCG, Ianniello E, Lopardo G, Minichiello F Romagnoni P and van Dijken, F 2010 in Alfano FRdA (ed.) Brussels: REHVA
- [4] Teli D, Bourikas L, James PAB and Bahaj AS 2017 *Procedia Env. Sci.* **38** 844-851
- [5] Teli D, Jentsch MF and James PAB 2012 *Energy and Build.* **53** 166-182
- [6] Teli D, Jentsch MF and James PAB 2014 *Build. and Environ.* **82** 640-654

- [7] Ricciardi P and Buratti C 2018 *Build. and Environ.* **127** 23-36
- [8] Gargnati SP, Ansaldi R and Filippi M 2009 *Build. and Environ.* **44** 785-792
- [9] Gargnati SP, Filippi M and Viazzo S 2007 *Build. and Environ.* **42** 951-959
- [10] Zaki SA, Damiati SA, Rijal HB, Hagishima A and Razak AA 2017 *Build. and Environ.* **122** 294-306
- [11] Kwok AG and Chun C 2003 *Solar Ener.* **74**(3) 245-252
- [12] Hwang PL, Lin TP, Chen CP and Kuo NJ 2009 *Int. J. Biometeorol* **53**(2) 189-200
- [13] Kim J and de Dear R 2018 *Build. and Environ.* **127** 13-22
- [14] Wong NH and Khoo SS 2003 *Energy and Build.* **35**(4) 337-351
- [15] Karyono TH, Heryanto S and Faridah I 2015 *Arch. Sci. Rev.* **58**(2) 174-183
- [16] Hamzah B, Gou Z, Mulyadi R and Amin S 2018 *Buildings* **8**(4).
- [17] Hamzah B, Ishak MT, Beddu S and Osman MY 2016 *Struc. Survey* **34**(4/5) 427-445
- [18] Hamzah B, Mulyadi R and Amin S 2017 *Proceedings 51st Int. Conf. of the Arch. Sci. Ass. (ANZAScA)* Wellington New Zealand: Department of Architecture, Victoria University of Wellington.
- [19] Hamzah B, Kusno Asniawaty, Mulyadi R 2019 *Int. Jour. of Sust. Energy.* **38**(4) 382-397
- [20] Kwok AG 1998 *ASHRAE Trans.* **104**(1B) 1031-1047.
- [21] Fanger PO 1970 Copenhagen (Danish Technical Press)
- [22] ASHRAE 2013 (*ANSI/ASHRAE Standard 55-2013*) Atlanta US (ASHRAE)
- [23] Humphreys MA 1981 in *Bioengineering, Thermal Physiology and Comfort*, Cena and Clark (eds.) Amsterdam (Elsevier) 229-250
- [24] Humphreys MA and Nicol JF 2000 *ASHRAE Trans.* **106** 485-92
- [25] Auliciems A 1989 in *Building Design and Human Performance* N.C. Ruck (ed.) New York (Van Nostrand Reinhold)
- [26] Roaf S, Nicol F, Humphreys M, Tuohy P and Boerstra A 2010 *Arch. Sci. Review* **53**(1) 65-77
- [27] PSN, 2011 Standar Nasional Indonesia, Jakarta, Indonesia (Badan Standardisasi Nasional)
- [28] Farina A 2015 Available from: http://www.angelifarina.it/Public/Fisica-Tecnica-Ambientale-2015/Lez-04-05/PMV_cal_tanabe6.xls

ORIGINALITY REPORT

23%

SIMILARITY INDEX

15%

INTERNET SOURCES

15%

PUBLICATIONS

9%

STUDENT PAPERS

PRIMARY SOURCES

1	anzasca.net Internet Source	6%
2	Submitted to Loughborough University Student Paper	1%
3	www.tandfonline.com Internet Source	1%
4	www.emeraldinsight.com Internet Source	1%
5	Baharuddin Hamzah, Asniawaty Kusno, Rosady Mulyadi. "Design of energy efficient and thermally comfortable air-conditioned university classrooms in the tropics", International Journal of Sustainable Energy, 2018 Publication	1%
6	Baharuddin Hamzah, Muhammad Taufik Ishak, Syarif Beddu, Mohammad Yoenus Osman. "Thermal comfort analyses of naturally ventilated university classrooms", Structural Survey, 2016 Publication	1%

7	repository.unhas.ac.id Internet Source	1%
8	Submitted to Fort Valley State Univeristy Student Paper	1%
9	onlinelibrary.wiley.com Internet Source	1%
10	Submitted to Universitas Pendidikan Indonesia Student Paper	1%
11	Submitted to University of Lincoln Student Paper	1%
12	Henry Feriadi, Nyuk Hien Wong. "Thermal comfort for naturally ventilated houses in Indonesia", Energy and Buildings, 2004 Publication	1%
13	Submitted to Universiti Kebangsaan Malaysia Student Paper	1%
14	Submitted to University College London Student Paper	<1%
15	www.mdpi.com Internet Source	<1%
16	www.scribd.com Internet Source	<1%
17	Sheikh Ahmad Zaki, Siti Aisyah Damiami, Hom Bahadur Rijal, Aya Hagishima, Azli Abd Razak.	<1%

"Adaptive thermal comfort in university classrooms in Malaysia and Japan", Building and Environment, 2017

Publication

18

Erminia Attaianese, Francesca Romana d'Ambrosio Alfano, Boris Igor Palella. "Chapter 57 An Ergonomic Approach of IEQ Assessment: A Case Study", Springer Science and Business Media LLC, 2019

Publication

<1%

19

www.cruising.com.au

Internet Source

<1%

20

researchportal.hw.ac.uk

Internet Source

<1%

21

De Giuli, V., R. Zecchin, L. Corain, and L. Salmaso. "Measurements of indoor environmental conditions in Italian classrooms and their impact on children's comfort", Indoor and Built Environment, 2015.

Publication

<1%

22

A.H. Taki, M.A. Ealiwa, A.T. Howarth, M.R. Seden. "Assessing thermal comfort in Ghadames, Libya: Application of the adaptive model", Building Services Engineering Research and Technology, 2016

Publication

<1%

23

Student Paper

<1%

24

Thananchai Leephakpreeda. "Implementation of adaptive indoor comfort temperature control via embedded system for air-conditioning unit", Journal of Mechanical Science and Technology, 2012

Publication

<1%

25

Ryoji Sasaki, Motohiko Yamada, Yasushi Uematsu, Hiromu Saeki. "Comfort environment assessment based on bodily sensation in open air: relationship between comfort sensation and meteorological factors", Journal of Wind Engineering and Industrial Aerodynamics, 2000

Publication

<1%

26

Devanir Avigo. "Particulate matter analysis at elementary schools in Curitiba, Brazil", Analytical and Bioanalytical Chemistry, 06/2008

Publication

<1%

27

s3.amazonaws.com

Internet Source

<1%

28

Submitted to Laureate Education Inc.

Student Paper

<1%

29

Charles Munonye, Yingchun Ji. "Evaluating the perception of thermal environment in naturally ventilated schools in a warm and humid climate

<1%

in Nigeria", Building Services Engineering Research and Technology, 2020

Publication

30

Submitted to National University of Singapore

Student Paper

<1%

31

pt.scribd.com

Internet Source

<1%

32

etheses.whiterose.ac.uk

Internet Source

<1%

33

Submitted to University of Wollongong

Student Paper

<1%

34

www.daniels.utoronto.ca

Internet Source

<1%

35

Buhani Buhani, Dian Herasari, Suharso
Suharso, Suropto Dwi Yuwono. "Correlation of
Ionic Imprinting Cavity Sites on the Amino-Silica
Hybrid Adsorbent with Adsorption Rate and
Capacity of Cd²⁺ Ion in Solution", Oriental
Journal of Chemistry, 2017

Publication

<1%

36

Baizhan Li, , Meilan Tan, Hong Liu, Xiaolei Ma,
and Wenjie Zhang. "Occupant's Perception and
Preference of Thermal Environment in Free-
running Buildings in China", Indoor and Built
Environment, 2010.

Publication

<1%

37

A. K. Melikov. "Human Response to an Individually Controlled Microenvironment", HVAC&R Research, 07/01/2007

Publication

<1%

38

Samar Thapa, Ajay Kr. Bansal, Goutam Kr. Panda. "Adaptive thermal comfort in the residential buildings of north east India—An effect of difference in elevation", Building Simulation, 2017

Publication

<1%

39

Submitted to The Hong Kong Polytechnic University

Student Paper

<1%

40

Rupp, Ricardo Forgiarini, Natalia Giraldo Vásquez, and Roberto Lamberts. "A review of human thermal comfort in the built environment", Energy and Buildings, 2015.

Publication

<1%

41

Tzu-Ping Lin. "Passenger thermal perceptions, thermal comfort requirements, and adaptations in short- and long-haul vehicles", International Journal of Biometeorology, 10/23/2009

Publication

<1%

42

Francesca Stazi, Federica Naspi. "Chapter 6 Experimental Data Acquisition", Springer Science and Business Media LLC, 2018

Publication

<1%

43

Samar Thapa, Ajay Kumar Bansal, Goutam Kumar Panda, Madhavi Indraganti. "Adaptive Thermal Comfort in the different buildings of Darjeeling Hills in eastern India – effect of difference in elevation", Energy and Buildings, 2018

Publication

<1%

Exclude quotes On

Exclude matches < 5 words

Exclude bibliography Off