

# Zaenab\_Muslimin\_Jurnal\_PE.pdf

*by*

---

FILE	ZAENAB_MUSLIMIN_JURNAL_PE.PDF (476.77K)		
TIME SUBMITTED	22-JAN-2021 03:32PM (UTC+0700)	WORD COUNT	3997
SUBMISSION ID	1492064310	CHARACTER COUNT	21198

## A new perspective in power loss reduction of ninety two buses integrated D-STATCOM

**Abstract.** The electrical energy demand continues to increase along with the rapid development of technology and population growth. Fulfilling the electricity supply is a challenge for the operation of the electric power system since the construction of distribution and transmission infrastructures require large costs and such long time process. The complexity of the power distribution system itself may affect the voltage deviation and power loss parameters. The more complex of the distribution system was configured the more critical impacts on those disturbance parameters encountered entire the power network. The contribution in this research is exploring on 99 bus context with D-STATCOM injection to increase the voltage profile, reducing the total active power loss and optimal size of D-STATCOM using the Optimal Power Flow (OPF) method for load flow analysis and Particle Swarm Optimization (PSO) in optimizing total loss active power and size of D-STATCOM on a radial distribution network system. This study aims to improve the distribution network performance in terms of the voltage profile, the total active power loss through optimal D-STATCOM placement. Optimization uses the Optimal Power Flow (OPF) method based on Particle Swarm Optimization (PSO). The proposed algorithm is calculated numerically for the North Makassar distribution system with ninety two buses included a network pattern open-loop radial configuration and the total load reaches 4.914 MW. The optimized computation algorithm result a minimum voltage profile of up to 0.73%, an average voltage profile up 0.8% or 4kV and a minimum total active power loss around 10.53%.

**Streszczenie.** Celem artykułu jest poprawa parametrów sieci przez optymalizację położenia układu D-STATCOM oraz zastosowanie metody OPF (optymalny przepływ mocy) z wykorzystaniem algorytmów rojowych PS. Zaproponowany algorytm jest obliczony numerycznie dla regionu North Makasar w Algierii. Uzyskano poprawę jakości napięcia i minimum mocy biernej. (Nowe perspektywy w redukcji strat mocy w sieci zintegrowanej z D-STATCOM)

**Keywords:** optimal power flow, D-STATCOM, Particle Swarm Optimization Algorithm, Power Loss

**Słowa kluczowe:** optymalny przepływ mocy OPF, STATCOM, algorytmy rojowe

### Introduction

Fulfillment of electricity supply is a challenge for the operation of the electric power system and the construction of distribution channels in supporting the continuity of electric power delivery, which requires huge costs and a long time process. The complexity of the power distribution system increases the voltage deviation and the power loss. To solve the problem, installing a Distribution Static Compensator (D-STATCOM) in a radial distribution network is one solution [1].

Generally, the electric power system is divided into three main components, namely the generating system, transmission system, and distribution system. A distribution system is a network that connects sources to loads or consumers. Radial network configuration is the simplest distribution network configuration and the lowest investment cost. The radial distribution system has many branches, the distance between the source of the generator with the load is far, the ratio of  $R/X$  voltage is high. These things can cause voltage drops and power losses in the distribution network [2].

Power loss causes inefficient power grids in distributing from source to load or consumers. Whereas the voltage drop can cause damage to consumer electrical equipment. Some researchers claim that 13% of the total power generated is wasted as a loss in the distribution system [3]. Because it is necessary to make efforts to overcome this, one solution is to inject the Distribution Static Compensator (D-STATCOM) in the radial distribution system. Through time series simulation to analyze the dynamic characteristics of the distribution network for various seasons shows that D-STATCOM increases the voltage profile and power factor on each bus [4]. D-STATCOM implementation on various types of loads using the Simpower System tool with MATLAB Simulink control is obtained D-STATCOM conceptually similar to STATCOM on the transmission network. D-STATCOM can compensate for reactive power, increase power factor, control the harmonic voltage, thereby improving power quality at the distribution end [5].

D-STATCOM is an inverter-based voltage source which is a special power device, connected in parallel with the power system and can supply reactive power to increase the voltage profile and reduce power loss in the line [6]. The main components of D-STATCOM include, VSC (Voltage Source Converter), energy storage equipment, transformers that are connected parallel to the distribution network through transformer couplings. The basic principle of D-STATCOM is it will produce an ac voltage source in the distribution that can be controlled by a voltage source converter (VSC). The output voltage from D-STATCOM can control the active and reactive power exchanges between D-STATCOM and the distribution network system [7]. In the D-STATCOM installation, the placement and installation of power capacity is essential, improper location selection and D-STATCOM size can cause even greater loss [8].

Power flow optimization which is called Optimal Power Flow (OPF) is used to optimize the power flow of the interconnected electric power system so that the active and reactive and voltage control variables are obtained [9]. To determine the size and placement of D-STATCOM on the distribution network in reducing power loss is solved using the Particle Swarm Optimization (PSO) method [10]. This method was chosen because it is easy to implement with a small number of parameters used. Algorithm PSO is a stochastic optimization based on increasing individual, competition and social cooperation in the population. PSO reduces computational burden when compared to other classical optimization methods [11]. The PSO-based algorithm can be used to determine the location and size of an optimal multi-DG unit to reduce loss in the main distribution network [12].

To minimize system power loss and increase the voltage profile with DG and DSTATCOM, Cuckoo Search Algorithm (CSA) based optimization is applied to the IEEE 33 and 136 bus standards [13]. While determining the optimal location of DG and DSTATCOM on a radial distribution network system in reducing losses, increasing the profile and stability of the distribution system voltage by considering load variations using a new method namely

Lightning Search Algorithm (LSA). Its application on IEEE 33 buses and 69 buses obtained very satisfying results [14]. Furthermore, T. Yuvaraj et al conducted a study on the placement and size of D-STATCOM in a radial distribution network to minimize power loss using the new bat algorithm method. The Voltage Stability Index (VSI) is used to determine the optimal location and bat algorithm to determine the optimal size of the D-STATCOM. Applied to IEEE 33 bus and 69 bus radial distribution systems, the simulation results show that the implementation of D-STATCOM in the radial distribution network has reduced the total power loss [15]. Unbalanced load caused by non-linear load results in a decrease in power quality. To

improve power quality, D-STATCOM-based Levenberg-31 guard Back (ANN-LMBNN) propagation is proposed. Simulation results show that the D-STATCOM-based intelligent control method applied to the IEEE 13 bus system is able to overcome power quality problems [16,17].

This research applies the D-STATCOM PSO Algorithm hybrid computing technique as an alternative problem solving on Makassar Power Distribution Network which consist of 92 bus. With Operational Power Flow (OPF), power grid variables can be obtained in the form of voltage, angle, active power, reactive power and total active power loss.

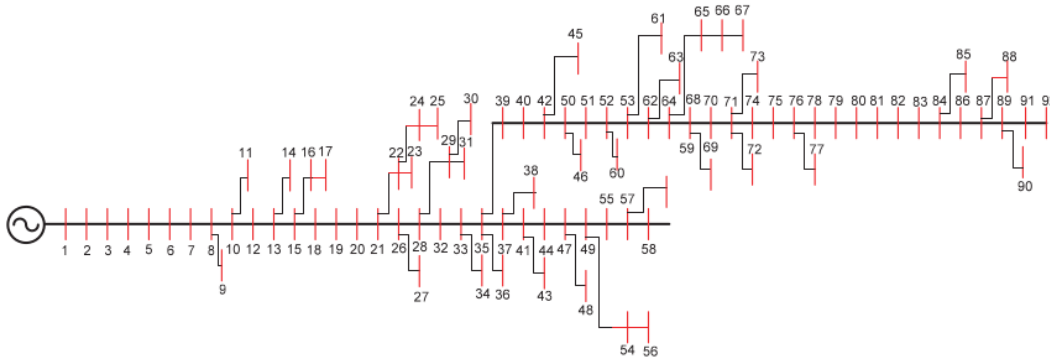


Fig.1. Distribution System of North Makassar 92 Bus

### Optimal Power Flow (OPF)

Optimal Power Flow (OPF) was first formulated in 1962 by Carpentier. Carpentier presented the OPF as an extension of the problem economic dispatch (ED) in the power system. Carpentier's main contribution includes the power flow equation in the formulation of economic dispatch (ED) [18]. Optimal Power Flow (OPF) plays a very important role in the operation of the power system. OPF schedules certain variables in the power system optimally to meet the balance of power flow and power system constraints [19]. The aim of the OPF is to optimize power grid variables including active power, reactive power, voltage and angle of the bus that can affect the increase in voltage profile and reduce power loss in the distribution network [20]. The OPF method can determine the optimal operating conditions on distribution networks that experience problems in operation. As with the object of this study that uses a broad radial system depicted in the figure 1. Optimal point variables are formulated and solved using an appropriate optimization algorithm, such as the Newton-Raphson method. The objective functions to minimize power loss are as follows [21,22].

Minimizing loss on distribution network systems

$$(1) \min \sum_{i=1}^n P_{loss}$$

A simple one-line diagram can be illustrated as in Fig. 2.

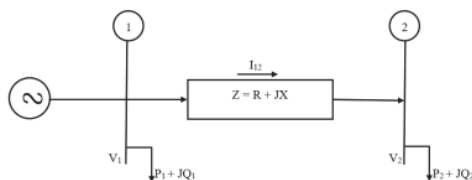


Fig.2. Simple one-line diagram

Based on Figure 2, the stresses in vertices 1 and 2 are obtained as follows:

$$(2) V_1 = V_2 + I_{12} * (R + jX)$$

$$(3) V_2 = V_1 - I_{12} * (R + jX)$$

Line Current is calculated using the equation (4) :

$$(4) I_{12} = \left( \frac{P_1 + jQ_1}{V_1} \right)^*$$

Active and reactive power losses are calculated using equations (5) and (6)

$$(5) P_{losses(1,2)} = (I_{12})^2 * R = \left( \frac{P_1^2 + Q_1^2}{|V_1|^2} \right) * R$$

$$(6) Q_{losses(1,2)} = (I_{12})^2 * X = \left( \frac{P_1^2 + Q_1^2}{|V_1|^2} \right) * X$$

Total active and reactive power losses are calculated by adding all active and reactive power losses in each branch as in equation (7).

$$(7) P_{Total Losses} = \sum P_{losses(1,2)}$$

The minimization of active and reactive power loss as an objective function is stated as follows:

$$(8) F = \min(P_{loss}) = \sum_{i=1}^n I_{12}^2 * R$$

$$(9) F = \min(Q_{loss}) = \sum_{i=1}^n I_{12}^2 * X$$

### Particle Swarm Optimization (PSO)

Particle Swarm Optimization (PSO) is an optimization algorithm based on swarm intelligence. The PSO algorithm is initialized with a population consisting of random solution candidates. Swarm Intelligence is formed from the coordination and competition of particles in the population, which conducts searches and produces optimization [23].

PSO algorithm is a particle in the population that follows superior particles, that is, the particle which is the best

candidate for a solution, with a certain speed to find the most optimal solution in the solution space based on objective functions. The speed of these particles is regulated dynamically based on the experience of individual and community particles [24,25]

Mathematically, the PSO algorithm is written as follows [26]:

$$x_{id}(t+1) = x_{id}(t) + v_{id}(t+1)$$

$$v_{id}(t+1) = w v_{id}(t) + c_1 r_1 (P_{id} - x_{id}(t)) + c_2 r_2 (P_{gd} - x_{id}(t))$$

where:  $x_{id}$  = the current search position of a particle  $i$ ;  $x_{id}(t+1)$  = updated search position of a particle  $i$ ;  $v_{id}$  = current speed of a particle  $i$ ;  $v_{id}(t+1)$  = updated speed of a particle  $i$ ;  $c_1, c_2$  = constants (0 to 4);  $r_1, r_2$  = uniformly distributed random variables (0 to 1);  $w$  = inertia constant;  $P_{id} = P_{best}$  = the best position of a particle  $i$ ;  $P_{gd} = G_{best}$  = The best solution for a particle  $i$ .

The Particle Swarm Optimization (PSO) method can help optimizing power system problems. The initial generation of PSO is started by random movements which are adjusted to the speed and position of the particles. Then find the best solutions and fitness according to the objective function used. Random moves and then selected through the best fitness values from  $P_{best}$  and  $G_{best}$ . The operating results of the fitness value will be evaluated according to the objective function used so that the next variable is included in the looping process. The PSO process stops when it reaches the specified maximum iteration. Optimal power flow completion steps with the PSO algorithm to minimize total active and reactive power losses, increase the voltage profile, location and size of the D-STATCOM on the North Makassar 92 bus distribution system as shown in Fig. 3.

#### Simulation Results and Discussion

To analyze how the effect of D-STATCOM injection using the OPF method and its size with the PSO algorithm is applied to the North Makassar Distribution system, 92 buses with a total active power load of 4.91378 MW are calculated by adding all active loads to each bus and the total reactive power load of 2.83931 MVar calculated by adding all reactive loads to each bus. The voltage profile for each bus before the D-STATCOM injection is shown in Fig. 4, where the total value of active power loss is 195.940 kW, the total reactive power loss is 68.36 kVar, the minimum voltage is 0.95190 pu on bus 80 and bus 92 and the average voltage for all the bus is 0.96364 pu.

To find out the effect of D-STATCOM injection on the voltage profile on each bus and the total active power loss in the North Makassar distribution system, 92 Buses, 7 case trials were conducted (A, B, C, D, E, F, and G). Case A is the initial condition a base (without D-STATCOM injection), and cases B, C, D, E, F and G are D-STATCOM injection cases on bus 20, bus 35, bus 48, bus 51, bus 80, and bus 81, respectively. The selection of D-STATCOM injection is based on a single line diagram which is the location of the bus in the front branch, middle branch, and final branch.

Table 1. Voltage on the bus

Scenario	Voltage (PU)						V <sub>average</sub> (PU)
	Bus 20	Bus 35	Bus 48	Bus 51	Bus 80	Bus 81	
Case A	0.97000	0.96616	0.96507	0.96132	0.95262	0.95249	0.96364
Case B	0.97312	0.96953	0.96864	0.96469	0.95600	0.95587	0.96680
Case C	0.97146	0.96798	0.96709	0.96314	0.95444	0.95432	0.96530
Case D	0.97220	0.96890	0.96843	0.96406	0.95536	0.95524	0.96616
Case E	0.97335	0.970333	0.96944	0.96650	0.95781	0.95768	0.96785
Case F	0.97310	0.97003	0.96913	0.96608	0.95992	0.95580	<b>0.96817</b>
Case G	0.97167	0.96825	0.96735	0.96369	0.95580	0.95573	0.96588

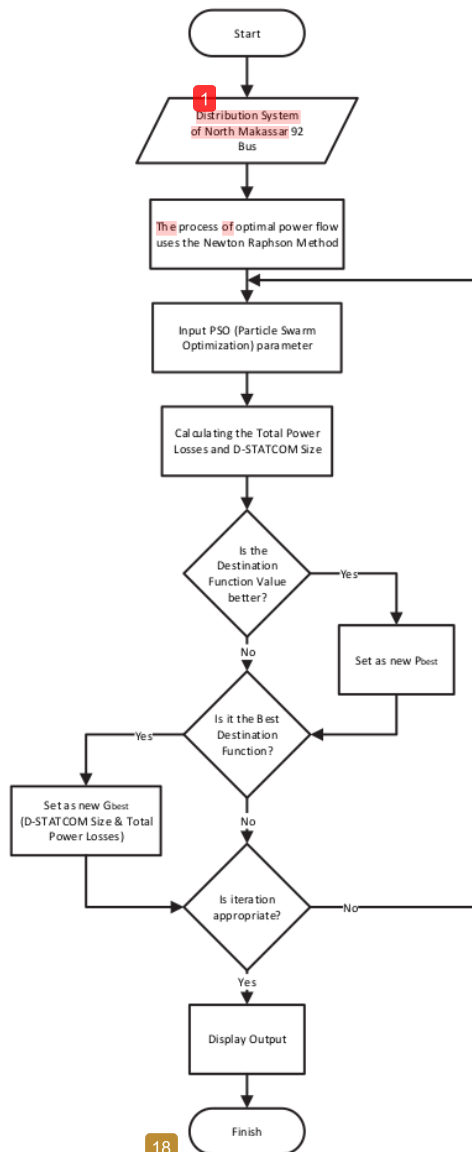


Fig.3. Flow chart of optimization using Particle Swarm Optimization Algorithm

The results obtained from the North Makassar distribution system, 92 buses using Optimal Power Flow (OPF) are shown in Table 1. and the optimal size of D-STATCOM using the Particle Swarm Optimization (PSO) algorithm can be seen in Table 2.

Table 2. Total active power loss, total reactive power loss and the percentage of loss reduction

Scenario	Injection D-STATCOM (kVar)	Ploss (kW)	Qloss (kVar)	Loss Reduction (%)	
				Ploss	Qloss
Case A	-	195.94	68.36	-	-
Case B	375	182.25	22.24	6.99	67.46
Case C	113	188.84	44.01	3.62	35.62
Case D	221	184.54	32.16	5.82	52.95
Case E	526	176.62	10.31	9.86	84.93
Case F	481	175.31	6.66	10.53	90.26
Case G	129	186.66	36.34	4.74	46.84

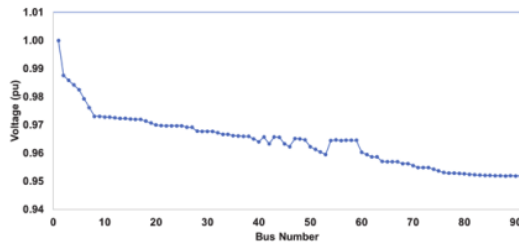


Fig.4. Profile of North Makassar distribution system voltage before D-STATCOM injection

Based on Table 1 that, with D-STATCOM injection can increase the voltage profile, when D-STATCOM is injected on the bus 20 the minimum voltage increases to 0.95528 pu on buses 88 and 92, if D-STATCOM is injected on the bus 35 the minimum voltage rises to 0.95373 pu on buses 88 and 92, while for D-STATCOM injection respectively on bus 48, bus 51, bus 80 and bus 81 the minimum voltage rises: 0.95464 pu; 0.95709 pu; 0.95512 pu and 0.95514 pu for buses 88 and 92. The highest increase in minimum voltage on buses 88 and 92 occurred when D-STATCOM was injected on Bus 80 by 0.73%, and the average voltage value for all buses was 0.96817 pu in Case F (Bus 80) with a percentage increase of 0.4% equivalent to 8kV.

Comparison of the voltage profile before D-STATCOM injection (Case A) and after D-STATCOM injection for Cases B, C, D, E and F are shown in Fig. 5.

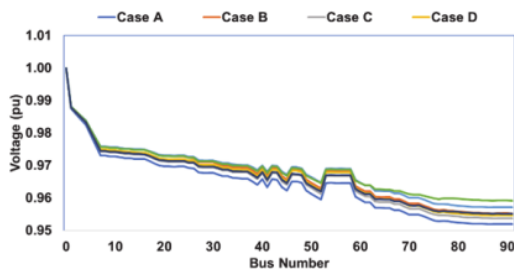


Fig.5. Comparison of Voltage Profiles based on

Based on the results in Table 2, when D-STATCOM was injected on bus 20 by 375 kVar the total active and reactive power loss were reduced to 182.25 kW and 22.24 kVar. Similarly, when 113 kVar D-STATCOM were injected on bus 35 the total active and reactive power loss were reduced to 188.84 kW and 44.01 kVar while D-STATCOM injection in case D, case E, case F and case G respectively total active and reactive power loss were reduced by 221 kVar D-STATCOM, Ploss = 184.54 kW, Qloss = 32.16 kVar; 526 kVar D-STATCOM, Ploss = 176.62 kW, Qloss = 10.31 kVar; 481 kVar D-STATCOM, Ploss = 175.31 kW, Qloss =

6.66 kVar and 129 kVar D-STATCOM, Ploss = 186.66 kW, Qloss = 36.34 kVar. The smallest total active and reactive power loss occurred when D-STATCOM is injected on bus 80 (case F), i.e. the total active power loss is 175, 31 kW and reactive power 6.66 kVar, the reduction percentage reached 10.53% for active power and 90.26% for reactive power.

Comparison of total active power loss and reactive power loss before and after D-STATCOM injection is shown in Fig. 6. While the variation of total active power loss versus iteration is shown in Fig. 7, it appears in the picture that for case B (injection on bus 20) convergence is achieved at 29th iteration, case C (injection on bus 35) convergence is reached at 22 iteration, case D (injection on bus 48) convergence achieved at 29th iteration, Case E (injection on bus 51) convergent reached at 31st iteration, case F (injection on bus 80) convergence is achieved at 31st iteration and case G (injection on bus 81) convergence reached at 27th iteration.

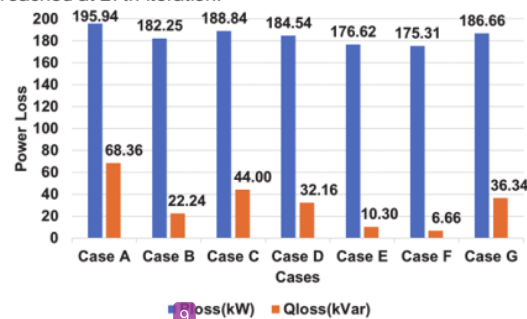


Fig.6. Comparison of total active power loss and reactive power loss

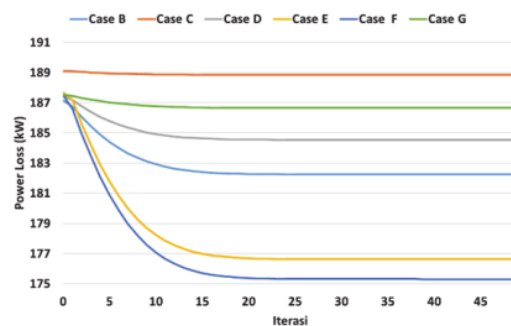


Fig. 7. Variations in total active power loss based on the scenario

## Conclusion

The optimization method of North Makassar power distribution system applied using PSO algorithm in this study exhibited the excellent increasing of the voltage profile and reducing the total active power loss. There are

seven scenarios that have been tested, where one scenario is the base case while the other six scenarios are the placement of D-Statcom based on the bus position. The most optimal D-STATCOM injection is placement on bus 80 (case of F) amount 481 kVar. Bus 80 placed on single line diagram of North Makassar distribution system. It's result the increasing of the minimum voltage profile on Bus 88 and Bus 92 by 0.73% (14.6 kV) and the average voltage for all buses is 0.4% (4kV) and is able to minimize the total active power loss of 10.53%. Compared to other scenarios, D-Statcom placement using PSO on bus 80 is superior 94.63% for decrease power loss.

#### REFERENCES

- [1] Reza Sirjani, Ahmad Rezaee Jordehi, *Optimal placement and sizing of distribution static compensator (D-STATCOM) in electric distribution networks: A review*, Renewable and Sustainable Energy Reviews, 77 (2017) 688–694
- [2] A. Bayat, A. Bagherib, *Optimal active and reactive power allocation in distribution networks using a novel heuristic approach*, Applied Energy 233–234 (2019) 71–85
- [3] T.Yuvaraj, K.R.Devabalaji, K.Ravi, *Optimal placement and sizing of DSTATCOM using Harmony Search algorithm*, Energy Procedia 79 (2015) 759 – 765
- [4] B.Muruganantham, R.Gananadass, N.P.Padhy, *Reactive Power Reallocation in the Distribution System with DSTATCOM*, 1<sup>st</sup> International Conference on Power Engineering, Computing and CONTROL (PECCON) VIT University, Chennai Campus, Energy Procedia 117 (2017) 485-492.
- [5] P. Bapaiah, *Power Quality Improvement by using DSTATCOM*, International Journal of Emerging Trends in Electrical and Electronics (IJETEE) Vol. 2, Issue. 4, April-2013.
- [6] Gupta, A.R. and A. Kumar, *Optimal placement of D-STATCOM using sensitivity approaches in mesh distribution system with time variant load models under load growth*, Ain Shams Engineering Journal, 2018, 9(4): p. 783-799
- [7] Vinay M. Awasthi, V. A. Huchche, *Reactive Power Compensation using D-STATCOM*, IEEE 978-1-4673-9925-8/16/\$31.00 ©2016
- [8] Atma Ram Gupta, *Effect of optimal allocation of multiple DG and DSTATCOM in radial distribution system for minimising losses and THD*, IEEE 978-1-5386-3032-7/17/\$31.00 ©2017
- [9] Jordan Radosavljević, Mirosljub Jevtić, Dardan Klimenta, Nebojša Arsić, *Optimal Power Flow for Distribution Networks with Distributed Generation*, Serbian Journal of Electrical Engineering, Vol. 12, No. 2, June 2015, 145-170
- [10] S. Devi, M. Geethanjali, *Optimal location and sizing determination of Distributed Generation and D-STATCOM using Particle Swarm Optimization algorithm*, Electrical Power and Energy Systems 62 (2014) 562–570
- [11] Meenu Jayamohan, Bindumol E K, Babu C A, *Voltage Stability Enhancement of Radial Distribution System by Optimal Placement of DG and D-STATCOM*, International Conference on Recent Trends in Engineering, Science & Technology - (ICRTEST 2016), pp.1-6
- [12] T.S. Tawfeek, A.H. Ahmed, S. Hasan, *Analytical and particle swarm optimization algorithms for optimal allocation of four different distributed generation types in radial distribution networks*, 5th International Conference on Energy and Environment Research, ICEER 2018 ; Energy Procedia 153 (2018) 86-94.
- [13] Yuvaraj and K. Ravi ; *Multi-objective simultaneous DG and D-STATCOM allocation in radial distribution networks using Cuckoo Searching Algorithm*, Alexandria Engineering Journal (2018) 57, 2729–2742;
- [14] Yuvaraj Thangaraj, Ravi Kuppan, *Multi-objective Simultaneous Placement of DG and D-STATCOM Using Novel Lightning Search Algorithm*, Journal of Applied Research and Technology 15 (2017) 477–491
- [15] T. Yuvaraj \*, K. Ravi, K.R. Devabalaji, *D-STATCOM allocation in distribution networks considering load variations using bat algorithm*, Ain Shams Engineering Journal (2017) 8, 391–403.
- [16] T.Anil Kumar, L.Shanmukha Rao, *Improvement of Power Quality of Distribution System using ANN-LMBNN based D-STATCOM*, International Conference on Innovations in Power and Advanced Computing Technologies [i-PACT2017], IEEE 978-1-5090-5682-8 /17/\$31.00 ©2017.
- [17] Z Muslimin, A Suyuti, E Palantei, Indrabayu, I C Gunadin, *Reactive power injection at the North Makassar distribution system with D-STATCOM*, International Symposium on Material Electrical Engineering (ISMEE), IOP Conf. Series: Material Science and Engineering 850 (2020) 012009.
- [18] E. Mohagheghi, M. Alramlawi, A. Gabash and P. Li, *A Survey of Real-Time Optimal Power Flow*, MDPI, Germany, 2018.
- [19] A.V. Klymchuk, O.E. Rubanenko, V.V. Teptia, O.V.S.M. Kozhambardiyeva, K. Gromaszek, N. Askarova, *Control of power flow and voltage in parallel working electrical GRIDS*, Przegląd Elektrotechniczny, str (2017), nr 104307, 90-94.
- [20] S. Singh and K. S. Verma, *Artificial Intelligence Techniques for Multi objective Optimum Power Flow with Valve Point Loading Incorporating SVC*, International Journal of Recent Development in Engineering and Technology, vol. 4, no. 6, pp. 41-48, 2015.
- [21] D.B. Prakash, C. Lakshminarayana, *Multiple DG Placements in Distribution System for Power Loss Reduction Using PSO Algorithm*, Global Colloquium in Recent Advancement and Effectual Researches in Engineering, Science and Technology (RAEREST 2016), Procedia Technology 25 (2016) 785 – 792
- [22] T. R. Aisenani, *Optimal Power Flow Problem in Distribution Networks: A Comprehensive Background, Methodologies and Analysis*, The University of Sydney, Sydney, 2018.
- [23] Yan HE, Wei Jin Ma, dan Ji Ping Zhang, *The Parameters Selection of PSO Algorithm Influencing on Performance of Fault Diagnosis*, MATEC Web of Conferences, 2016, 63.
- [24] Pavleka Josip, Nikolovski Srete, Stojkiv Marinko, *Finding Optimal Location of FACTS device for dynamic Reactive Power Compensation Using Genetic Algorithm and Particle Swarm Optimisation*, Przegląd Elektrotechniczny, 95 (2019), nr 8, 86-91
- [25] B. Bakhshideh Zad, H. Hasanvand, J. Lobry, F. Vallée; *Optimal reactive power control of DGs for voltage regulation of MV distribution systems using sensitivity analysis method and PSO algorithm*, Electrical Power and Energy Systems 68 (2015) 52–60
- [26] A.H. Ahmed, S.Hasan, *Optimal allocation of distributed generation units for converting conventional radial distribution system to loop using particle swarm optimization*. 5<sup>th</sup> International Conference on Energy and Environment Research, ICEER 2018, Energy Procedia 153 (2018) 118–124.

ORIGINALITY REPORT

---

% **22**  
SIMILARITY INDEX

%  
INTERNET SOURCES

% **22**  
PUBLICATIONS

%  
STUDENT PAPERS

---

PRIMARY SOURCES

---

**1** Z Muslimin, A Suyuti, E Palantei, I Indrabayu, I C Gunadin. "Reactive power injection at the North Makassar distribution system with D-STATCOM", IOP Conference Series: Materials Science and Engineering, 2020 **%4**  
Publication

---

**2** "Advances of Science and Technology", Springer Science and Business Media LLC, 2020 **%2**  
Publication

---

**3** "Power Electronics and Renewable Energy Systems", Springer Science and Business Media LLC, 2015 **%1**  
Publication

---

**4** Aguiar, Ana B.M., Arezki Merkhouf, Claude Hudon, and Kamal Al-Haddad. "Investigation of the electromagnetic simulation results variation of a hydro electrical generator", IECON 2012 - 38th Annual Conference on IEEE Industrial Electronics Society, 2012. **%1**  
Publication

---

5

Atma Ram Gupta. "Effect of optimal allocation of multiple DG and D-STATCOM in radial distribution system for minimizing losses and THD", 2017 7th International Symposium on Embedded Computing and System Design (ISED), 2017

Publication

% 1

6

T. Yuvaraj, K. Ravi, K.R. Devabalaji. "DSTATCOM allocation in distribution networks considering load variations using bat algorithm", Ain Shams Engineering Journal, 2017

Publication

% 1

7

"Advances in Natural Computation", Springer Science and Business Media LLC, 2005

Publication

% 1

8

Ashutosh Kumar Tagore, Atma Ram Gupta. "Impact of DG and D-STATCOM allocation in radial distribution system for reducing harmonics", 2017 8th International Conference on Computing, Communication and Networking Technologies (ICCCNT), 2017

Publication

% 1

9

Kondreddi Saicharan, Atma Ram Gupta. "Allocation of UPQC in Overloaded Mesh Distribution System with Battery Charging Load", 2020 First IEEE International Conference on Measurement, Instrumentation, Control and

% 1

10

M. Jayamohan, E.K. Bindumol, C.A. Babu. "Voltage stability enhancement of radial distribution system by optimal placement of DG and D-STATCOM", International Conference on Recent Trends in Engineering, Science & Technology - (ICRTEST 2016), 2016

Publication

% 1

---

11

J. Senthil Kumar, P. Prem, M. Jagabar Sathik. "Evaluation of DG impacts on distribution networks", Elsevier BV, 2021

Publication

% 1

---

12

Mai, Yun Fei, Wen Jing Ding, and Shao Long Liu. "Research on the PID Tuning of Electric Power-Assisted Steering Test Bench System", Applied Mechanics and Materials, 2014.

Publication

% 1

---

13

Reza Sirjani, Ahmad Rezaee Jordehi. "Optimal placement and sizing of distribution static compensator (D-STATCOM) in electric distribution networks: A review", Renewable and Sustainable Energy Reviews, 2017

Publication

<% 1

---

14

A.H. Ahmed, S. Hasan. "Optimal allocation of distributed generation units for converting conventional radial distribution system to loop

<% 1

using particle swarm optimization", Energy Procedia, 2018

Publication

---

15

Managerial Auditing Journal, Volume 30, Issue 4\_5 (2015)

Publication

---

<% 1

16

Heba Ahmed Hassan, Mohamed Zellagui. "MVO Algorithm for Optimal Simultaneous Integration of DG and DSTATCOM in Standard Radial Distribution Systems Based on Technical-Economic Indices", 2019 21st International Middle East Power Systems Conference (MEPCON), 2019

Publication

---

<% 1

17

T. S. Tawfeek, A.H. Ahmed, S. Hasan. "Analytical and particle swarm optimization algorithms for optimal allocation of four different distributed generation types in radial distribution networks", Energy Procedia, 2018

Publication

---

<% 1

18

Ferry R A Bukit, Naemah Mubarakah, D M Nasution. "Minimizing The Electrical Power Distribution Cost By Optimizing the Distributed Generation Placement", 2019 3rd International Conference on Electrical, Telecommunication and Computer Engineering (ELTICOM), 2019

Publication

---

<% 1

19

H. NOMURA. "Quantum-Behaved Particle Swarm Optimization with Chaotic Search", IEICE Transactions on Information and Systems, 07/01/2008

Publication

<% 1

20

Zulkifli Tahir, Al-Riefqy Dasmito, Adnan, Muhammad Niswar, Wardi. "A Reliable Offline Web System for Small and Medium Industries", MATEC Web of Conferences, 2020

Publication

<% 1

21

Atma Ram Gupta, Abhinav Jain, Ashwani Kumar. "Optimal D-STATCOM placement in radial distribution system based on power loss index approach", 2015 International Conference on Energy, Power and Environment: Towards Sustainable Growth (ICEPE), 2015

Publication

<% 1

22

Soheil Zarkandi. "A novel optimization-based method to find multiple solutions for path synthesis of planar four-bar and slider-crank mechanisms", Proceedings of the Institution of Mechanical Engineers, Part C: Journal of Mechanical Engineering Science, 2021

Publication

<% 1

23

Bushra Weqar, Mohd Tauseef Khan, Anwar Shahzad Siddiqui. "Optimal Placement of Distributed Generation and D-STATCOM in

<% 1

## Radial Distribution Network", Smart Science, 2017

Publication

---

24

Satyasheel Prakash, Vinay Rangta, Jayalakshmi N. S., Vinay Kumar Jadoun. "Optimal Location of DGs in a Distribution System for Maintaining Voltage Profile and Loss Reduction Using Genetic Algorithm", 2020 International Conference on Power Electronics & IoT Applications in Renewable Energy and its Control (PARC), 2020

Publication

---

25

Khalid Mohammed Saffer Alzaidi, Oguz Bayat, Osman N. Uçan. "Multiple DGs for Reducing Total Power Losses in Radial Distribution Systems Using Hybrid WOA-SSA Algorithm", International Journal of Photoenergy, 2019

Publication

---

26

Hyeon-Jin Moon, Jae Won Chang, Seok-Young Lee, Seung-Il Moon. "Autonomous active power management in isolated microgrid based on proportional and droop control", Energy Procedia, 2018

Publication

---

27

T.H. Ortmeier, K. Zehar. "Distribution system harmonic design", IEEE Transactions on Power Delivery, 1991

Publication

<% 1

<% 1

<% 1

<% 1

---

28

Carolina G. Marcelino, Paulo E. M. Almeida, Elizabeth F. Wanner, Manuel Baumann et al. "Solving security constrained optimal power flow problems: a hybrid evolutionary approach", Applied Intelligence, 2018

Publication

<% 1

---

29

Adel M. Sharaf, Adel A. A. El-Gammal. "Chapter 9 Particle Swarm Optimization PSO: A New Search Tool in Power System and Electro Technology", Springer Science and Business Media LLC, 2010

Publication

<% 1

---

30

Surender Reddy Salkuti. "Optimal location and sizing of DG and D-STATCOM in distribution networks", Indonesian Journal of Electrical Engineering and Computer Science, 2019

Publication

<% 1

---

31

Shatha S. Alkubragyi, Patrick C.K. Luk, John Economou. "A new Supervisory Strategy of a modified D-STATCOM with Dual DC Source in Smart Distribution Grids", 2018 Third Scientific Conference of Electrical Engineering (SCEE), 2018

Publication

<% 1

---

32

I. C. Goulter. "Chapter 6 Reliability and Risk in a Water Supply System Emphasising Drought Periods", Springer Science and Business Media

<% 1

LLC, 1999

Publication

---

33

Subhrajyoti Sahu, Ajit Kumar Barisal, Abhishek Kaudi. "Multi-objective optimal power flow with DG placement using TLBO and MIPSO: A comparative study", Energy Procedia, 2017

Publication

---

<% 1

34

Aadesh Kumar Arya, Ashwani Kumar, Saurabh Chanana. "Analysis of Distribution System with D-STATCOM by Gravitational Search Algorithm (GSA)", Journal of The Institution of Engineers (India): Series B, 2019

Publication

---

<% 1

35

Shoushuai He, Lei Zhu, Lei Wang, Lu Yu, Changhua Yao. "A Modified Gravitational Search Algorithm for Function Optimization", IEEE Access, 2019

Publication

---

<% 1

36

Ayat Ali Saleh, Al-Attar Ali Mohamed, A. M. Hemeida. "Impact of Optimum Allocation of Distributed Generations on Distribution Networks Based on Multi-Objective Different Optimization Techniques", 2019 International Conference on Innovative Trends in Computer Engineering (ITCE), 2019

Publication

---

<% 1

37

Abhinav Jain, A.R. Gupta, Ashwani Kumar. "An

efficient method for D-STATCOM placement in radial distribution system", 2014 IEEE 6th India International Conference on Power Electronics (IICPE), 2014

Publication

<% 1

38

"Recent Advances in Power Systems", Springer Science and Business Media LLC, 2021

Publication

<% 1

39

Atma Ram Gupta, Ashwani Kumar. "Optimal placement of D-STATCOM using sensitivity approaches in mesh distribution system with time variant load models under load growth", Ain Shams Engineering Journal, 2016

Publication

<% 1

40

Ali Ehsan, Qiang Yang. "Optimal integration and planning of renewable distributed generation in the power distribution networks: A review of analytical techniques", Applied Energy, 2018

Publication

<% 1

41

"Artificial Intelligence and Evolutionary Computations in Engineering Systems", Springer Science and Business Media LLC, 2020

Publication

<% 1

EXCLUDE  
BIBLIOGRAPHY

ON

WORDS