

IOP 2019

by M. Bachtiar Nappu

Submission date: 27-Sep-2022 09:25AM (UTC-0400)

Submission ID: 1910359247

File name: Nappu_2019_J._Phys._Conf._Ser._1341_052017_2.pdf (1.29M)

Word count: 2408

Character count: 12547

PAPER · OPEN ACCESS

Economic dispatch of Jenepono thermal power plant for primary energy efficiency

3
To cite this article: M B Nappu *et al* 2019 *J. Phys.: Conf. Ser.* **1341** 052017

View the [article online](#) for updates and enhancements.



IOP | ebooks™

Bringing you innovative digital publishing with leading voices to create your essential collection of books in STEM research.

Start exploring the collection - download the first chapter of every title for free.

Economic dispatch of Jeneponto thermal power plant for primary energy efficiency

M B Nappu^{1,2}, A Arief^{1,2}, S W Soalehe² and M Rianty²

¹Centre for Research and Development on Energy and Electricity, Hasanuddin University, Makassar 90245, Indonesia

²Electricity Market and Power Systems Research Group, Department of Electrical Engineering, Faculty of Engineering, Hasanuddin University, Gowa 92119, Indonesia

bachtiar@eng.unhas.ac.id, thiar@engineer.com

Abstract. Economic dispatch is a method to compute the amount of power that must be generated from each generator units to meet a specific load while minimizing its operating costs. This study performed economic dispatch for the Jeneponto Thermal Power Plant, in the Jeneponto Regency, South Sulawesi Province, Indonesia by using the Lagrange multiplier method. The results of this study showed that by performing economic dispatch, it is effective in minimizing the fuel cost compared to the existing dispatch. The overall savings that can be obtained for this case study is 4.5% for the specific case study.

1. Introduction

A good electrical energy system should be safe, economical, efficient, effective, high quality and reliable [1, 2]. This means that in the generation and distribution of electrical energy, it must be done economically and rationally. Nevertheless, there are many obstacles in the electrical power operation that must be handled to achieve the above objectives caused by the random nature of electrical power systems. The operating conditions will change following the variation in load and/or discharge of any network equipment on the system unintentionally and may cause deviation of operation [3, 4]. Most utilities applied the usage of reactive power compensating devices to maintain deviation in reactive powers [5].

Jeneponto Thermal Power Plant located in the Jeneponto Regency, South Sulawesi Province is one of the IPP power plants for the Southern Sulawesi power system which provides power to the system for both base and peak loads [6]. The Jeneponto power plant is a coal based power plant. Like other thermal power plants, the Jeneponto power plant also faces a problem in terms of fuel costs that tend to increase over time. Meanwhile, the fuel costs account for the majority of overall plant operating costs, therefore it is essential for optimizing fuel costs which will result in more economical generating operations than before [7, 8]. Hence, efforts should be made to minimize the production cost of operating the thermal power plants or primary energy efficiency.

Minimizing the operating cost of the plants means optimizing the work of the power plant units, in terms of scheduling the power generation of the existing plants properly [9]. Generators with the smallest operating cost should be maximized and the plants with the greatest cost should be less used.



Content from this work may be used under the terms of the [Creative Commons Attribution 3.0 licence](https://creativecommons.org/licenses/by/3.0/). Any further distribution of this work must maintain attribution to the author(s) and the title of the work, journal citation and DOI.

The economic dispatching of power plants is done by observing the input and output of the plant, i.e. how much fuel is needed to generate energy and how much it will cost in accordance with the capacity of the units. This is done regardless of the existing loading conditions.

2. Economic Dispatch

Economic dispatch is an attempt to determine the amount of power that must be supplied from each unit of generators to meet specific loads with the aim of minimizing the operating costs of generation with operational parameter constraints [10-13]. Economic dispatch computation between the generating units in a power plant is mathematically equal to the economic dispatch between the power plants, but for scheduling between the power plants, it is necessary to calculate the transmission losses as an additional constraint to obtain accurate results [14-16]. Further works in economic dispatch considers the possible transmission congestion problems [17, 18].

Generally, the input-output characteristics of the thermal generator are approximated by a second order polynomial function as,

$$H_i = \alpha_i + \beta_i P_{ti} + \gamma_i P_{ti}^2 \quad (1)$$

Where: H_i is the input of thermal generating fuel to unit i (liter/hour), P_{ti} is the thermal generator output of unit i (MW) and α_i , β_i , γ_i are the input-output constant of the thermal unit i .

Understanding economic dispatching of thermal power plants is the economic sense because the cost is required on the input side for every generator, hence for the total power output generated by all the generators requires total cost amount of all generators [19, 20]. The financial problem is how to regulate and manage the output of each plant in such a way as to obtain the minimum total input cost of all generators. This can be done by optimizing the total cost of all generating inputs in the power system to the power output and for that purpose, a mathematical model must be made to perform optimization calculations. The method used in the handling of economic dispatch is the Lagrange multiplier method. The Lagrange multiplier (or λ -iteration) method has been commonly used in finding a solution for solving economic dispatch [21, 22], because of its effectiveness to accomplish optimal fuel cost among thermal generators [23].

The objective equation is formed from the total cost of fuel inputs from each plant:

$$F_T = F_1 + F_2 + F_3 + \dots + F_N = \sum_{i=1}^N F_i(P_i) \quad (2)$$

With constraints:

$$\sum_{i=1}^N P_i = P_r$$

or

$$\Psi(P_1, P_2, P_3, \dots, P_N) = P_r - \sum_{i=1}^N P_i = 0 \quad (3)$$

From Eq. 3, then the Lagrange function is developed as

$$L = F_T + \lambda \Psi \quad (4)$$

Where λ is the Lagrange multiplier factor. Eq. 4 is the generator's output function and optimum condition can be obtained by doing the Lagrange equation equal to zero.

$$\nabla L = 0$$

$$\begin{aligned}\nabla F_T(P_i) + \lambda \nabla \Psi(P_i) &= 0 \\ \frac{\partial F_T(P_i)}{\partial (P_i)} + \lambda \left(\frac{P_r}{P_i} - \frac{\partial P(P_i)}{\partial (P_i)} \right) &= 0 \\ \frac{\partial F_T(P_i)}{\partial (P_i)} + \lambda (0 + 1) &= 0 \\ \frac{\partial F_T(P_i)}{\partial (P_i)} &= \lambda\end{aligned}\tag{5}$$

Since $F_i = F(P_i)$, then the partial differential equation can be written as,

$$\frac{dF_i}{dP_i} = \lambda\tag{6}$$

Where i is the i^{th} generator

Eq. 6 determines the minimum operating cost condition from all thermal units within a power system, with the fuel cost incremental for all units equal to λ , hence Eq. 6 becomes the optimum requirement. Because the generator operation is constrained by its minimum and maximum power output, P_{min} and P_{max} , respectively, hence to obtain the optimum dispatch of the operating units, the equation that can be used are:

$$\begin{aligned}\frac{dF_i}{dP_i} &= \lambda \\ P_{min} &\leq P_i \leq P_{max} \\ \sum_{i=1}^N P_i &= P_r\end{aligned}$$

3. Results and Analysis

Jenepono Thermal Power Plant in Jenepono Regency is a coal based thermal power plant and has power capacity of 2 x 125 MW [24]. It is one of the IPP's in the Southern Sulawesi power system which provides power to the system for both base and peak loads. Fig. 1 shows the power generation dispatching at the Jenepono Thermal Power Plant for every hour in a day with its fuel cost for every hour, while Fig. 2 informs the optimal dispatch for the same total load. Then in Fig. 3, the operating costs between the current dispatch and economic dispatch are compared. In general, the results of the economic dispatch offers smaller fuel cost compared to the existing dispatch. The percentage of cost savings for this optimization can be seen in Fig. 4. The overall savings that can be obtained for this case study is 4.5%. From this study, it is recommended for the Jenepono Thermal Power Plant to perform economic dispatch for their daily operation to save fuel costs. By using the Lagrange method for economic dispatch, this can provide guidance for the Jenepono Thermal Power Plant for their daily generation dispatching.

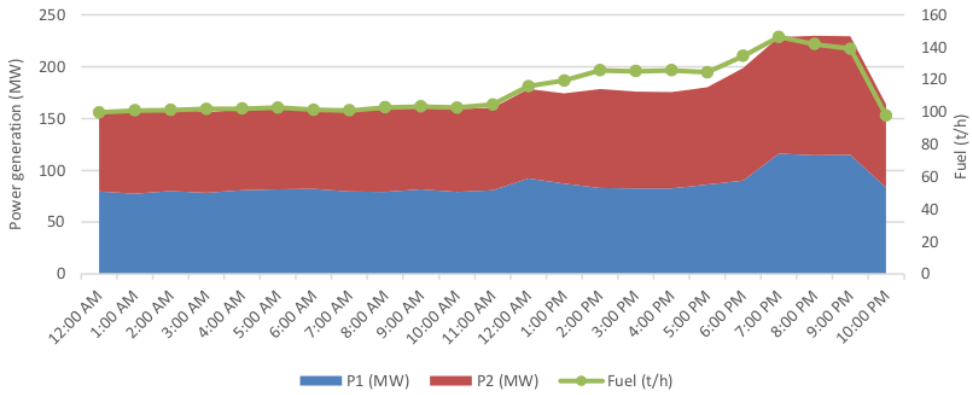


Figure 1. Current dispatch at the Jenepono Thermal Power Plant

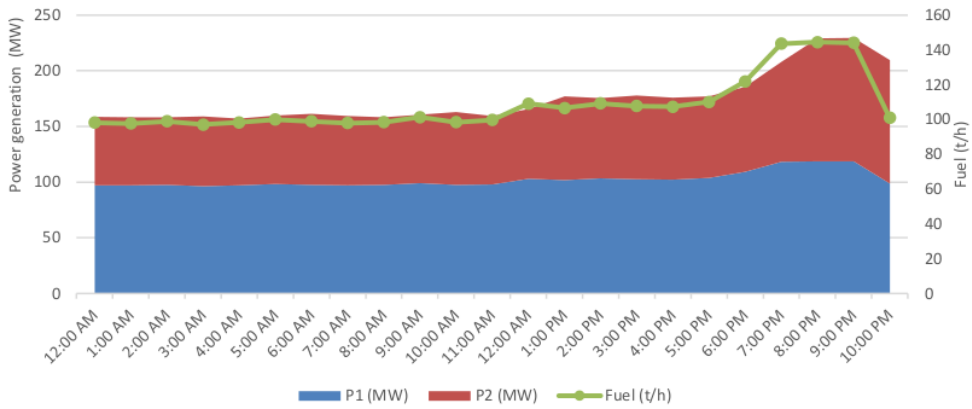


Figure 2. Economic dispatch results for the Jenepono Thermal Power Plant

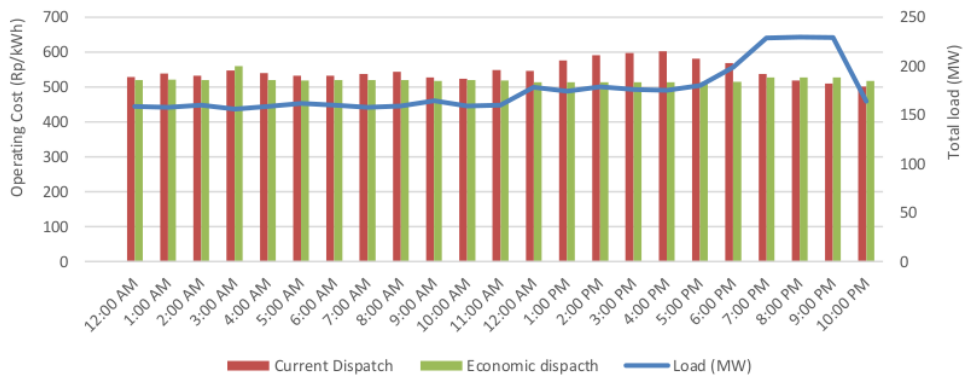


Figure 3. Comparison of operating costs between current dispatch and economic dispatch

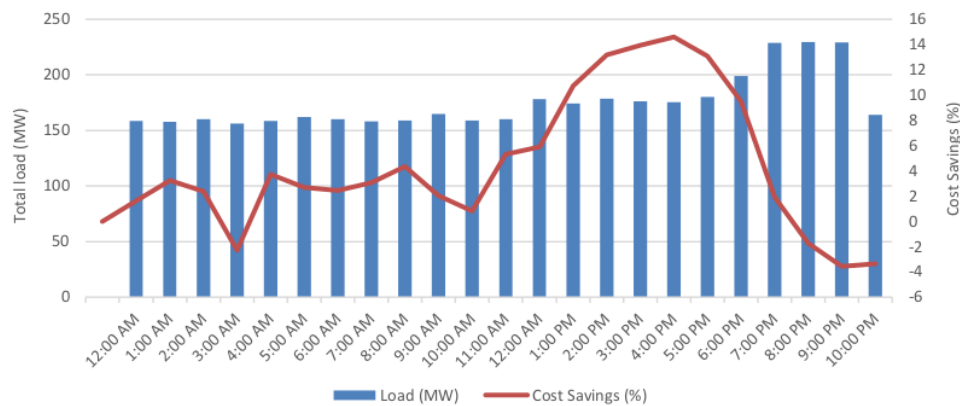


Figure 4. Cost savings for each total load

4. Conclusions

This paper presents economic dispatch for the Jeneponto Thermal Power Plant with a power capacity of 2 x 125 MW. The results of this study confirms that fuel cost can be minimized by performing economic dispatch with Lagrange multiplier method. The overall savings that can be obtained for this case study is 4.5%. Therefore, it is recommended for the Jeneponto Thermal Power Plant to perform economic dispatch for their daily operation to save fuel costs.

2 Acknowledgements

The authors gratefully acknowledge the Indonesian Ministry of Research, Technology and Higher Education for providing the research grant and support in this work.

References

- [1] Dong Z Y and Zhang P 2009 *Emerging Techniques in Power System Analysis*: Springer
- [2] Bacher R, "Power System Models, Objectives and Constraints in Optimal Power Flow Calculations," in *Optimization in Planning and Operation of Electric Power Systems*, ed Heidelberg: Physica-Verlag (Springer), 1993, pp. 217-64.
- [3] Kundur P 1994 *Power System Stability and Control* New York: McGraw-Hill
- [4] Saadat H 2002 *Power System Analysis* 2nd ed. Boston ; Sydney McGraw-Hill Primis Custom
- [5] Arief A, Nappu M B, and Antamil 2018 Analytical Method for Reactive Power Compensators Allocation *International Journal of Technology* **9(3)** 602-12
- [6] Bosowa. 2015. *Bosowa Energi Bangun PLTU Senilai Rp3 Triliun*. Available: http://www.bosowa.co.id/press_release/read/bosowa-energi-bangun-pltu-senilai-rp3-triliun
- [7] Wei Y-M, Chen H, Chyong C K, Kang J-N, Liao H, and Tang B-J 2018 Economic dispatch savings in the coal-fired power sector: An empirical study of China *Energy Economics* **74** 330-42
- [8] Nappu M B, Arief A, and Duhri A S 2019 Economic emission dispatch for thermal power plant in Indonesia *International Journal of Smart Grid and Clean Energy* **8(4)** 500-04
- [9] Ajami W A, Arief A, and Nappu M B 2019 Optimal power flow for power system interconnection considering wind power plants intermittency *International Journal of Smart Grid and Clean Energy* **8 (3)** 372-76
- [10] FERC 2005 *Economic Dispatch: Concepts, Practices and Issues* California: Palm Springs
- [11] Ridzuan M R M, Hassan E E, Abdullah A R, Bahaman N, and Kadir A F A 2016 A New Meta Heuristic Evolutionary Programming (NMEP) in Optimizing Economic Energy Dispatch *Journal of Telecommunication, Electronic and Computer Engineering* **8, No 2: Pioneering**

Future Innovation Through Green Technology I

- [12] Li P and Hu J 2018 An ADMM based distributed finite-time algorithm for economic dispatch problems *IEEE Access* 1-1
- [13] Velasquez M A, Barreiro-Gomez J, Quijano N, Cadena A I, and Shahidehpour M 2019 Distributed model predictive control for economic dispatch of power systems with high penetration of renewable energy resources *International Journal of Electrical Power & Energy Systems* **113** 607-17
- [14] Kouveliotis-Lysikatos I and Hatziaargyriou N 2017 Distributed economic dispatch considering transmission losses in Proc. of 2017 *IEEE Manchester PowerTech* 1-6.
- [15] Ramadan B M S M, Logenthiran T, Naayagi R T, and Su C 2016 Accelerated Lambda Iteration Method for solving economic dispatch with transmission line losses management in Proc. of 2016 *IEEE Innovative Smart Grid Technologies - Asia (ISGT-Asia)* 138-43.
- [16] Iqbal H M Z and Shafique A 2016 A hybrid evolutionary algorithm for economic load dispatch problem considering transmission losses and various operational constraints in Proc. of 2016 *International Conference on Intelligent Systems Engineering (ICISE)* 202-09.
- [17] Bachtiar Nappu M, Arief A, and Bansal R C 2014 Transmission management for congested power system: A review of concepts, technical challenges and development of a new methodology *Renewable and Sustainable Energy Reviews* **38** 572-80, DOI:10.1016/j.rser.2014.05.089
- [18] Nappu M B, Bansal R C, and Saha T K 2013 Market power implication on congested power system: A case study of financial withheld strategy *International Journal of Electrical Power & Energy Systems* **47** 408-15, DOI:10.1016/j.ijepes.2012.09.016
- [19] Yinliang X, Wei Z, and Wenxin L 2015 Distributed Dynamic Programming-Based Approach for Economic Dispatch in Smart Grids *IEEE Transactions on Industrial Informatics* **11** 166-75
- [20] Yanchao L, Ferris M C, and Feng Z 2015 Computational Study of Security Constrained Economic Dispatch With Multi-Stage Rescheduling *IEEE Transactions on Power Systems* **30** 920-29
- [21] Mohatram M 2017 Hybridization of artificial neural network and lagrange multiplier method to solve economic load dispatch problem in Proc. of 2017 *International Conference on Infocom Technologies and Unmanned Systems (Trends and Future Directions) (ICTUS)* 514-20.
- [22] Zhao W, Zhou B, Liu M, Yao W, Lu S, and Wang T 2017 Decentralised method for solving multi-area stochastic dynamic economic dispatch problem *The Journal of Engineering* **2017** 2356-62
- [23] Muda H, Othman A K, and Julai N 2017 Economic Dispatch Strategy for Solar Hybrid System using Lambda Iteration Method *Journal of Telecommunication, Electronic and Computer Engineering* **9, No. 3-10: Engineering Solution Towards A Sustainable Society**
- [24] IPP PROCUREMENT PT PLN (PERSERO) HEAD OFFICE, "Market Sounding IPP Procurement in 2016," ed. Jakarta, Indonesia, December 2015.

IOP 2019

ORIGINALITY REPORT

9%

SIMILARITY INDEX

8%

INTERNET SOURCES

6%

PUBLICATIONS

7%

STUDENT PAPERS

PRIMARY SOURCES

1	repository.unhas.ac.id Internet Source	3%
2	www.ijsgce.com Internet Source	2%
3	eprints.unm.ac.id Internet Source	2%
4	Submitted to Universitas Brawijaya Student Paper	1%
5	Submitted to The Hong Kong Polytechnic University Student Paper	1%

Exclude quotes On

Exclude matches < 5 words

Exclude bibliography On