

MICEEI 2014

by Ardiaty Arief

Submission date: 27-Sep-2022 09:45AM (UTC-0400)

Submission ID: 1910371049

File name: arief2014.pdf (1.05M)

Word count: 3290

Character count: 17582

Optimal Placement of Distributed Generations with Modified P-V Modal Analysis

Ardiaty Arief

Department of Electrical Engineering
Faculty of Engineering, University of Hasanuddin,
Makassar 90245, Indonesia

E-mail: ardiaty@eng.unhas.ac.id, ardiaty@engineer.com

Abstract—Optimal allocation of DGs is currently one of the major challenges for power system engineers. Determination of the proper location of DG units is imperative to maximize their benefits. This research investigates optimal placement of multiple DG units to obtain the most stable system. The proposed method is based on an advanced voltage stability analysis method: the new modified Voltage-Active Power Modal Analysis (VPMA). The modified VPMA assesses voltage stability by considering the incremental relationship between voltage and active power instead of between voltage and reactive power. The VPMA method involves eigenvalue techniques and the associated eigenvectors of the reduced Jacobian matrix. The eigenvectors of the reduced Jacobian matrix are calculated to determine the Voltage-Active Power Modal Participation Factor (VPMPF). VPMPF provides a indication of the weakest bus in the system. Furthermore, an objective function based on loss reduction and eigenvalue is formulated to determine the most appropriate bus location for DG placement. The proposed VPMA method is tested on the IEEE 34-bus distribution network and the results show the robustness of the method. Further relevant findings are also discussed in this paper.

Keywords distributed generations (DG), eigenvalue, eigenvector, modal analysis, modal participation factor, voltage stability.

I. INTRODUCTION

DGs have grown rapidly as a clean renewable energy for alternative generation in the electricity industry due to their fast technological development as well as their advantages in economic and environmental advantages regarding the exhaustion of fossil fuels caused by conventional electricity generations that lead to global warming problems [1-3]. The integration of DGs into the electric power system has brought many benefits. Because DGs are installed within the local distribution system network or at a customer's site, they deliver power directly to the local distribution network. They can improve the voltage profile by reducing power flow inside the transmission system, decrease power losses at the distribution system by delivering power for some load demand at the distribution, enhance system reliability by providing additional system generating capacity at the distribution network for uninterrupted power supply and back-up supply, reduce bottlenecks in the transmission and distribution system, and improve preservation of the power system and restoration operations by supplying temporary back-up power supply.

In this study, a new method determine an optimal distributed generation allocation is presented. This method is based on the Voltage-Active Power Modal Analysis (VPMA) method. VPMA involves eigenvalue techniques and the

associated eigenvectors of reduced Jacobian matrix. In VPMA, eigenvectors are used to calculate bus Voltage-Active Power Modal Participation Factor (VPMPF). VPMPF indicates the contribution of particular buses to the voltage instability of the corresponding system. VPMPF directly provide information about the weakest bus in the system. Therefore, the load bus with the highest VPMPF will be selected as the location for DG unit placement. After the placement of distributed generations, the voltage stability of the system will be re-evaluated to validate the efficiency in improving voltage profile and system eigenvalues. To verify the effectiveness of the proposed method, the IEEE 34-bus distribution network is used in this study. While the integration of DGs into an existing network can result in several benefits, this work only focuses on voltage stability enhancement. The proposed method is robust, straightforward and computation is timely efficient. More interesting results are presented in this paper.

The structure of this paper is as follows. Section 2 describes about distributed generations. Section 3 explains about the modified V-P Modal Analysis method that focusing on the relationship between active power and voltage, and then the VPMPF calculation for the determination of DG location. Section 4 presents the proposed methodology, objective function, system constraints and evaluation parameters. Results and analysis are presented in Section 5. Section 6 concludes the main findings of the research.

II. THE EMERGENCE OF DISTRIBUTED GENERATIONS

In the literature, various terminologies and definitions are used on the subject of distributed generation (DG). "Embedded generation" is frequently employed in Anglo-American countries; "dispersed generation" is utilized in North America while Europe and a few countries in Asia apply "decentralized generation". In addition to various terminologies for distributed generation, several definitions for DG are also applicable. Ackermann et al. [4] propose a general definition for DG as "an electric power source connected directly to the distribution network or on the customer site of the meter". Similar definition is also given in Ochoa et al. [5], where DG is defined as "the development of a set of sources of electric power connected to the distribution network or the customer side of the meter". A study by El-Khattam and Salama [6] classifies classification of DGs based on their technologies, which are: traditional generators (combustion engines) and non-traditional generators. Traditional generators are micro turbine whereas the non-traditional generators are fuel cells, batteries, flywheels, photovoltaic and wind turbine can be seen in Figure 1. In addition, Haiyan et al. [7] provides

classification of DG units based on their capacities and interfaces as in Table 1.

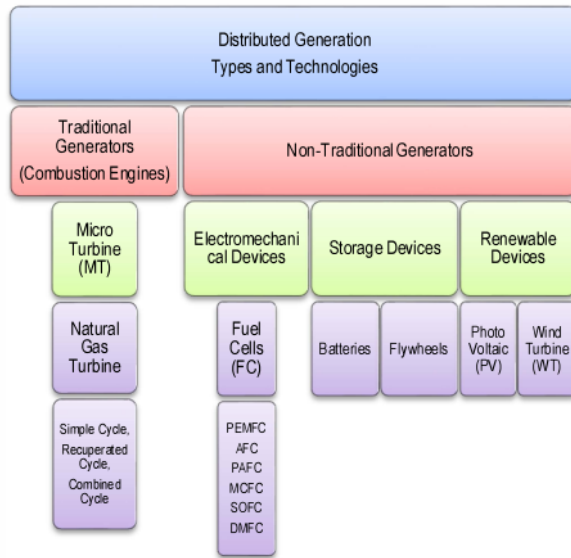


Figure 1. Types of DG and technologies [6]

TABLE I. DG CAPACITIES AND SYSTEM INTERFACE [7]

Technology	Capacity Ranges	System Interface
Solar, Photovoltaic	A few W to several hundred kW	DC/AC converter
Wind	A few hundred W to a few MW	Asynchronous generator
Geothermal	A few hundred kW to a few MW	Synchronous generator
Ocean	A few hundred kW to a few MW	Synchronous generator
Microturbine	A few tens of kW to a few MW	AC/AC converter
Fuel cell	A few tens of kW to a few tens of MW	DC/AC converter

The integration of distributed generations into electric power system has brought many benefits. It has positive effects on the voltage profile at the distribution system as well as power quality. However, these benefits depend on the location and the size of distributed generations. The appropriate location of DGs installation significantly improves voltage stability. Currently, the optimal placement of DG units is one of the major challenges for power system engineers [8]. Therefore, investigation on the DGs' optimal allocation becomes important to maximize their operation benefits.

III. THE PROPOSED METHOD: V-P MODAL ANALYSIS

The voltage stability analysis for a given system state considers two aspects [9]: *proximity* that verifies the voltage security and determines the closeness of the system to instability and *mechanism* that identifies areas prone to voltage instability issues and offers solution information useful to forestall instability

Modal analysis developed by Gao et al. [9] has been applied to solve various power system problems. This method involves eigenvalue techniques and the associated

eigenvalues of the reduced Jacobian matrix. The focus of using the reduced Jacobian matrix instead of system state matrix is on voltage and reactive power characteristics. It provides an accurate estimation of *proximity* and *mechanism* to voltage instability. In modal analysis, the *proximity* is measured by the magnitude of eigenvalues. The eigenvalues sign indicates whether the system is stable or not at the given operating circumstance. The information of *mechanism* of voltage instability is provided by the eigenvectors. The eigenvector-based participation factors clearly define crucial areas of voltage instability and indicate elements which are important in the instability phenomenon.

The linearized model of steady-state power system is given by,

$$\begin{bmatrix} \Delta P \\ \Delta Q \end{bmatrix} = \begin{bmatrix} \frac{\partial P}{\partial \theta} & \frac{\partial P}{\partial V} \\ \frac{\partial Q}{\partial \theta} & \frac{\partial Q}{\partial V} \end{bmatrix} \begin{bmatrix} \Delta \theta \\ \Delta V \end{bmatrix} = J \begin{bmatrix} \Delta \theta \\ \Delta V \end{bmatrix} \quad (1)$$

where,

ΔP is the bus real power incremental change

ΔQ is the bus reactive power injection incremental change

$\Delta \theta$ is the bus voltage angle incremental change

ΔV is the bus voltage magnitude incremental change

J is the Jacobian matrix of partial derivatives

However, in the original modal analysis, voltage stability is assessed with respect to the relationship between V and Q . Nevertheless, in the DG placement study, the research should focus on the active power delivered by DGs to the distribution system. Therefore, we modified the modal analysis that evaluates the system voltage stability by considering the incremental relationship between V and P , hence in this case, Q is kept constant at each operating point.

If ΔQ in Eq. 1 is kept constant, then the V-P reduced Jacobian Matrix becomes:

$$\begin{bmatrix} \Delta P \\ 0 \end{bmatrix} = \begin{bmatrix} J_{P\theta} & J_{PV} \\ J_{Q\theta} & J_{QV} \end{bmatrix} \begin{bmatrix} \Delta \theta \\ \Delta V \end{bmatrix} \quad (2)$$

$$\Delta P = [J_{PV} - J_{P\theta} J_{QV} J_{Q\theta}^{-1}] \Delta V = J_R^{VP} \Delta V \quad (3)$$

And,

$$\Delta V = J_R^{VP-1} \Delta P \quad (4)$$

$$J_R^{VP} = [J_{PV} - J_{P\theta} J_{QV} J_{Q\theta}^{-1}] \quad (5)$$

The reduced V-P Jacobian matrix is labelled as J_R^{VP} which directly relates the bus voltage magnitude and the bus active power supply. For the next description, the superscript VP is used to indicate and differentiate from the original V-Q Modal Analysis. Therefore the eigenvalues and eigenvectors of the V-P reduced Jacobian matrix can be obtained from:

$$J_R^{VP} = \xi^{VP} \Lambda^{VP} \eta^{VP} \quad (6)$$

Where,

ξ^{VP} is the right V-P eigenvector matrix of J_R^{VP}

η^{VP} is the left V-P eigenvector matrix of J_R^{VP}

Λ^{VP} is the diagonal V-P eigenvalue matrix of J_R^{VP}

$$J_R^{VP-1} = \xi^{VP} \Lambda^{VP-1} \eta^{VP} \quad (7)$$

Then we get the direct relation between incremental changes in active power and voltage, hence:

$$\Delta V = \xi^{VP} \Lambda^{VP-1} \eta^{VP} \Delta P \quad (8)$$

Or,

$$\Delta V = \sum_i \frac{\xi_i^{VP} \eta_i^{VP}}{\lambda_i^{VP}} \Delta P \quad (9)$$

Where

λ_i^{VP} is the i th eigenvalue of J_R^{VP}
 ξ_i^{VP} is the i th column right eigenvector of J_R^{VP}
 η_i^{VP} is the i th row left eigenvector of J_R^{VP} .

Hence the VPMPF can be written as:

$$MPF_{ki}^{VP} = \xi_{ki}^{VP} \eta_{ik}^{VP} \quad (10)$$

MPF_{ki}^{VP} indicates the participation of λ_i to the V-P sensitivity at bus k . The bigger the value of MPF_{ki}^{VP} , the more influence of λ_i in determining V-P sensitivity at bus k .

IV. METHODOLOGY

A. Proposed VPMA Methodology

Load bus with the highest VPMPF is the weakest bus in the system and hence has the biggest influence on the instability of the system. Therefore, the location for DG placement is based on the bus with the highest VPMPF. The VPMPF calculation is given Eq. 10. The flowchart of the proposed VPMA method can be seen in Figure 2.

B. Voltage Stability Limit and DG Capacity

In this study this following voltage threshold stability constraint is used:

$$V_{min} \leq V_i \leq V_{max} \rightarrow 0.95 \leq V_i \leq 1.05$$

The DG capacity unit is set at 50 MW by referring to various definitions in [4].

C. The system smallest eigenvalue (λ_{min})

The eigenvalue analysis method has been validated to be useful in assessing the steady-state voltage stability of a system. It is one of the most popular voltage stability assessment parameters. The smallest system eigenvalue λ_{min} is applied to measure the voltage stability of the system. It also becomes an index for voltage stability measurement.

Eq. 6 can be extended into:

$$J_R^{VP} = \begin{bmatrix} \xi_{11} & \xi_{12} & \dots & \xi_{1n} \\ \xi_{21} & \xi_{22} & \dots & \xi_{2n} \\ \vdots & \vdots & \ddots & \vdots \\ \xi_{n1} & \xi_{n2} & \dots & \xi_{nn} \end{bmatrix} \begin{bmatrix} \lambda_1 & 0 & \dots & 0 \\ 0 & \lambda_2 & \dots & 0 \\ \vdots & \vdots & \ddots & \vdots \\ 0 & 0 & \dots & \lambda_n \end{bmatrix} \begin{bmatrix} \eta_{11} & \eta_{12} & \dots & \eta_{1n} \\ \eta_{21} & \eta_{22} & \dots & \eta_{2n} \\ \vdots & \vdots & \ddots & \vdots \\ \eta_{n1} & \eta_{n2} & \dots & \eta_{nn} \end{bmatrix} \quad (11)$$

The magnitude of λ_i determines the degree of stability of the i th modal voltage.

V. TEST RESULTS AND ANALYSIS

In this paper, a new method to determine DG placement based on VPMPF is presented. The VPMPF provides information about the weakest bus in the system. The bus with the highest VPMPF is selected as the DG placement location because by placing DG at this bus, the voltage magnitude will be the most stable. To evaluate the performance of the proposed method, tests have been carried out on the IEEE 34-bus distribution network as can be seen in Figure 3.

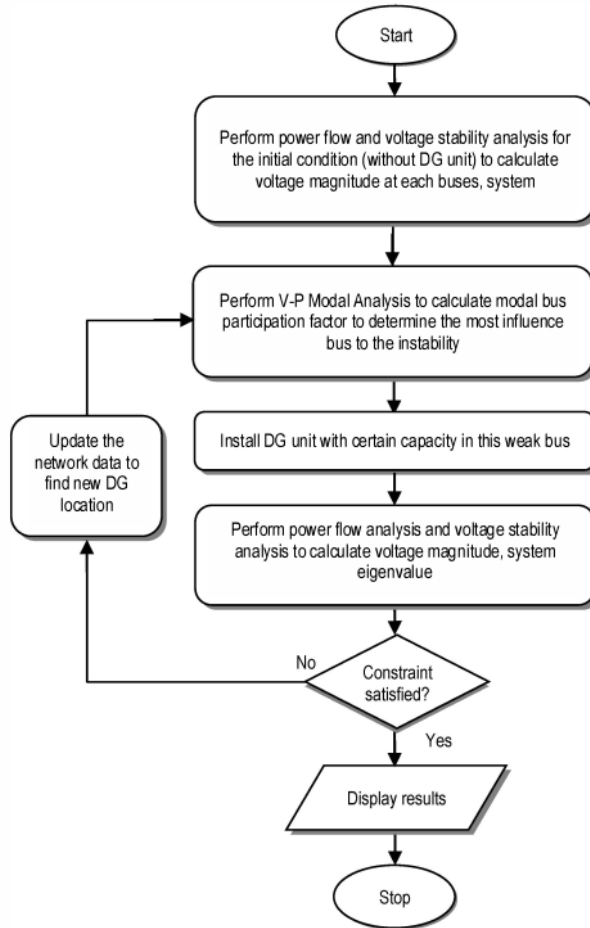


Figure 2. Flowchart of the proposed DG allocation methodology with VPMA

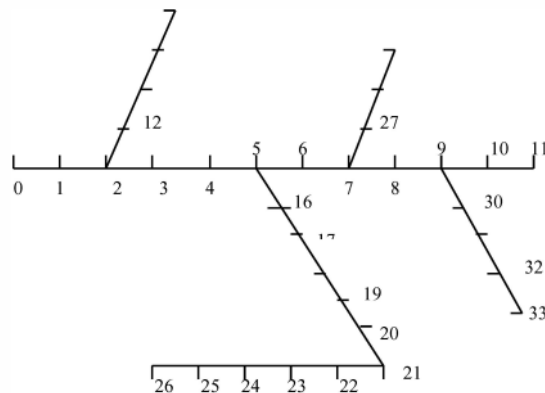


Figure 3. IEEE 34-bus distribution network test system

A. VPMPF Calculation for DG Placement

Figure 4 shows the VPMPF at each load buses to determine the location for the 1st DG placement. As shown, bus 26 has the highest VPMPF (0.1774), hence bus 26 is declared as the most effective DG placement. However, after DG placement at bus 26, the voltage stability constraints are not yet satisfied, so a second DG unit needs to be placed. With reference to Figure 5, bus 33 becomes the most influential to instability with the highest VPMPF values of 0.1698. Again because the constraints have not yet been met, the third DG unit needs to be placed, hence the VPMPF for the third DG unit is calculated and the results can be seen in Figure 6 in which bus 11 has the highest MPF (0.1393). With 3 DG units placed at buses 26, 33 and 11, the stability constraints have been satisfied, and hence the process is stopped.

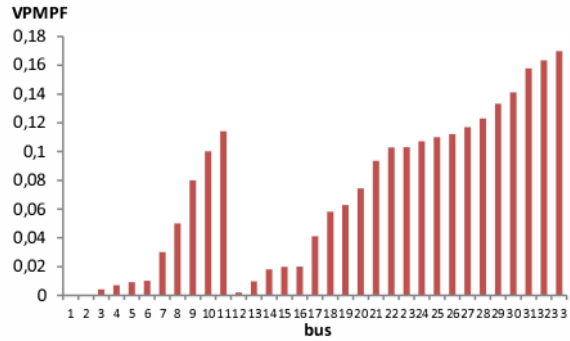


Figure 5. The VPMPF for determining second DG location

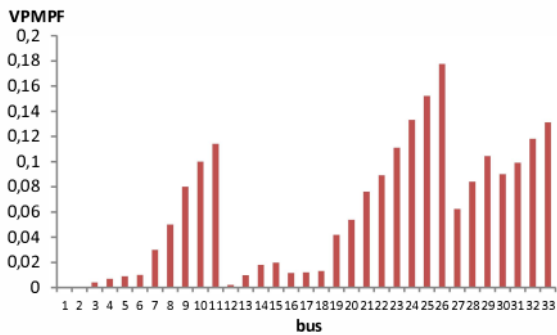


Figure 4. The VPMPF for determining first DG location

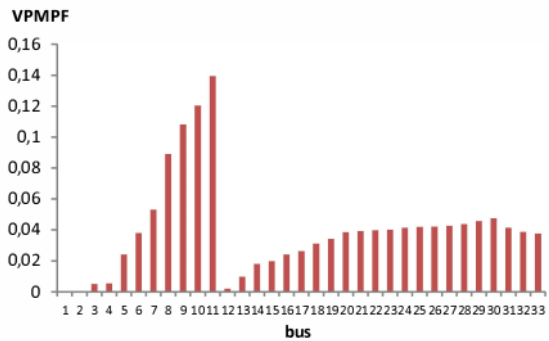


Figure 6. The VPMPF for determining third DG location

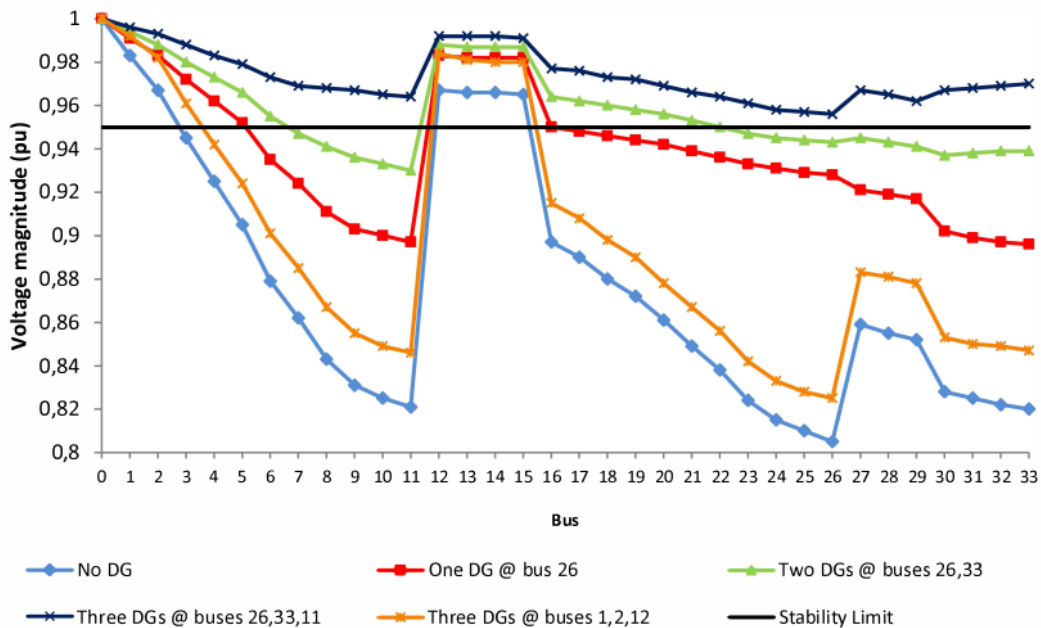


Figure 7. Voltage profile improvement with DG units placement

B. System Voltage Profile Improvement

Figure 7 presents the voltage magnitude for each condition. To prove the robustness of the proposed method, we also observe the system performance when 3 DG units with a capacity of 50 MW each are installed at strong buses.

The light blue line represents the voltage profile of each bus at initial condition without any DG. It clearly shows that voltages at most buses are below the stability limit (black line). The voltage profile improves when a one DG unit is placed at bus 26 (the red line). The voltage magnitude increases again when the second DG is installed at bus 33 (the green line). The dark blue line represents the voltage magnitude with 3 DG units installed at buses 26, 33 and 11 based on the proposed VPMA method.

This study also observes the voltage magnitude when 3 DGs are placed in strong buses (1, 2 and 12) as indicated with the orange line. Evidently, the voltage magnitudes do not improve considerably. In fact, the voltage profile with only one DG placed at proper bus (26) is better. However, for a better indication of stability, the next section will review the system performance from the eigenvalue analysis.

Strong buses are indicated with small VPMPF values. By referring to Figures 4, 5, and 6, bus # 1, 2 and 12 all have small VPMPF values.

C. The System Smallest Eigenvalue (λ_{min})

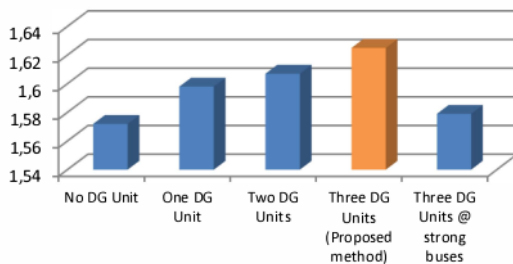


Figure 8. The system smallest eigenvalue

As can be seen in Figure 8, the system eigenvalue increases with the installation of more DG units. The λ_{min} for the system without any DG unit is 1.572. When one DG unit is installed at bus 26, the λ_{min} becomes 1.598, and then improves to 1.607 when two DG units are installed at buses 26 and 33. By using the proposed VPMA method, the third DG is placed at bus 11. The final eigenvalue with 3 DG units placed at buses 26, 33 and 11 becomes 1.61. If 3 DG units are placed at strong buses, i.e. bus # 1, 2 and 12, the λ_{min} is only 1.579, which is lower than λ_{min} for one DG unit placed at bus 26 (1.598). Yet there is only one DG unit at bus 26 with a capacity of 50 MW, and if we install DG units at these 3 strong or normal buses, the total DG capacity is 150 MW.

However, one DG unit at the proper location will result in better voltage profile magnitude and higher λ_{min} , hence the system will be in a more stable condition.

VI. CONCLUSION

The proper placement of DG units is important to maximize the benefits of DG. This paper proposes a new method based on an advanced voltage stability analysis technique: the Voltage-Active Power Modal Analysis (VPMA). The objective of this study is to obtain the most stable system. To evaluate the robustness of the proposed method, this work also observes the system's performance when DG units are placed at strong buses.

The results of applying this method to the modified IEEE 34-bus distribution network clarify the robustness of this method in the optimal placement of DG units. The results show the efficiency of VPMPF in determining the optimal allocation for DG installation for the improvement of voltage profile and also to increase the system's eigenvalue compare to the existing approach. It was evident in this study that proper DG location is very critical to maximize their benefits.

REFERENCES

- [1] T. Senjyu, *et al.*, "Optimal Distribution Voltage Control and Coordination with Distributed Generation," *IEEE Transactions on Power Delivery*, vol. 23, pp. 1236-1242, 2008.
- [2] R. Caldon, *et al.*, "Feasibility of Adaptive Intentional Islanding Operation of Electric Utility Systems With Distributed Generation," *Electric Power Systems Research*, vol. 78, pp. 2017-2023, 2008.
- [3] A. Keane, *et al.*, "Planning and operating non-firm distributed generation," *IET Renewable Power Generation*, vol. 3, pp. 455-464, 2009.
- [4] T. Ackermann, *et al.*, "Distributed Generation: A Definition," *Electric Power Systems Research*, vol. 57, pp. 195-204, 2001.
- [5] L. F. Ochoa, *et al.*, "Evaluating Distributed Generation Impacts With a Multiobjective Index," *IEEE Transaction on Power Delivery*, vol. 21, pp. 1452-1458, 2006.
- [6] W. El-Khattam and M. M. A. Salama, "Distributed Generation Technologies, Definitions and Benefits," *Electric Power Systems Research*, vol. 71, pp. 119-128, 2004.
- [7] C. Haiyan, *et al.*, "Power Flow Study and Voltage Stability Analysis for Distribution Systems with Distributed Generation," in *Proc. IEEE Power Engineering Society General Meeting*, Montreal, Quebec, Canada, 18-22 June, 2006, pp. 1-8.
- [8] Y. M. Atwa and E. F. El-Saadany, "Reliability Evaluation for Distribution System With Renewable Distributed Generation During Islanded Mode of Operation," *IEEE Transactions on Power Systems*, vol. 24, pp. 572-581, 2009.
- [9] B. Gao, *et al.*, "Voltage Stability Evaluation Using Modal Analysis," *IEEE Transactions on Power Systems*, vol. 7, pp. 1529-1542, 1992.
- [10] D. P. Kothari and J. S. Dhillon, *Power System Optimization*. New Delhi: Prentice-Hall of India, 2004.

ORIGINALITY REPORT

14%

SIMILARITY INDEX

8%

INTERNET SOURCES

11%

PUBLICATIONS

5%

STUDENT PAPERS

PRIMARY SOURCES

1

University of Tennessee, Knoxville

Publication

1%

2

veprints.unica.it

Internet Source

1%

3

Arief, Ardiaty, ZhaoYang Dong, Muhammad Bachtiar Nappu, and Marcus Gallagher.

"Under voltage load shedding in power systems with wind turbine-driven doubly fed induction generators", Electric Power Systems Research, 2013.

Publication

1%

4

Paniagua Ramirez, Judith, and Jose Horacio Tovar Hernandez. "Review of methodologies for the analysis of voltage stability in power systems", 2013 IEEE International Autumn Meeting on Power Electronics and Computing (ROPEC), 2013.

Publication

1%

5

A Arief, M B Nappu, A Sultan. "Frequency stability and under frequency load shedding of the Southern Sulawesi power system with

1%

integration of wind power plants", IOP
Conference Series: Earth and Environmental
Science, 2020

Publication

6	Che Wanik, Mohd Zamri(Erich, István and Mohamed, Azah). "Dynamic Simulation and Intelligent Management of Distributed Generation", DuEPublico: University of Duisburg-Essen Publications Online, 2011. Publication	1 %
7	updocs.net Internet Source	1 %
8	www.transnav.eu Internet Source	1 %
9	Lecture Notes in Electrical Engineering, 2015. Publication	1 %
10	Submitted to University of Babylon Student Paper	1 %
11	Atul R. Phadke, S.K. Bansal, K.R. Niazi. "A Comparison of Voltage Stability Indices for Placing Shunt FACTS Controllers", 2008 First International Conference on Emerging Trends in Engineering and Technology, 2008 Publication	<1 %
12	M. Ojaghi, M. Azari, M. Darabian. "Multi-objective evolutionary scheme for distributed generations planning in distribution	<1 %

networks", 2013 IEEE International
Conference on Industrial Technology (ICIT),
2013

Publication

13

Submitted to Jawaharlal Nehru Technological
University

Student Paper

<1 %

14

mjee.iaumajlesi.ac.ir

Internet Source

<1 %

15

Submitted to University of Northumbria at
Newcastle

Student Paper

<1 %

16

Submitted to University of Surrey

Student Paper

<1 %

17

koreascience.kr

Internet Source

<1 %

18

www.scribd.com

Internet Source

<1 %

19

S. Chaitusaney, A. Yokoyama. "Contribution of
Distributed Generation to Voltage Regulation
under Stochastic Attribute of Renewable
Energy Resources", 2006 International
Conference on Power System Technology,
2006

Publication

<1 %

20

vtechworks.lib.vt.edu

Internet Source

<1 %

21

www.frontiersin.org

Internet Source

<1 %

22

J.S. Naturesa. "Transmission systems congestion management by using modal participation factors", 2003 IEEE Bologna Power Tech Conference Proceedings, 2003

Publication

<1 %

23

Jan-E-Alam, Md., K. M. Muttaqi, and D. Sutanto. "Assessment of distributed generation impacts on distribution networks using unbalanced three-phase power flow analysis", 2011 IEEE Power and Energy Society General Meeting, 2011.

Publication

<1 %

24

Muhammad Bachtiar Nappu, Ardiaty Arief, Ramesh C. Bansal. "Transmission management for congested power system: A review of concepts, technical challenges and development of a new methodology", Renewable and Sustainable Energy Reviews, 2014

Publication

<1 %

25

Nandlal, Krishna, and Musti Sastry. "Assessment of voltage stability of a small island network using a developed MATLAB toolbox", 2014 IEEE PES Transmission &

<1 %

Distribution Conference and Exposition - Latin America (PES T&D-LA), 2014.

Publication

26

ejers.org

Internet Source

<1 %

27

eprints.uthm.edu.my

Internet Source

<1 %

28

par.nsf.gov

Internet Source

<1 %

29

serialsjournals.com

Internet Source

<1 %

30

vdoc.pub

Internet Source

<1 %

31

www.ijric.org

Internet Source

<1 %

32

A. Kazemi, M. Sadeghi. "A load flow based method for optimal location of dispersed generation units", 2009 IEEE/PES Power Systems Conference and Exposition, 2009

Publication

<1 %

33

M. H. Albadi, E. F El-Saadany. "The role of distributed generation in restructured power systems", 2008 40th North American Power Symposium, 2008

Publication

<1 %

34

Claudia Reis. "Voltage stability analysis of electrical power system", 2009 International Conference on Power Engineering Energy and Electrical Drives, 03/2009

Publication

<1 %

35

JIAN H. BIAN, PARVIZ RASTGOUFARD. "MEASURES OF VOLTAGE INSTABILITY AND VOLTAGE COLLAPSE, PART II: COMPUTATIONAL ASPECTS", Electric Machines & Power Systems, 1995

Publication

<1 %

Exclude quotes On

Exclude matches < 5 words

Exclude bibliography On