

s_of_Distributed_Generation_Integration_Effect_1a._IJEETC3b.pdf

by

Submission date: 27-May-2023 06:07AM (UTC+0700)

Submission ID: 2102784008

File name: s_of_Distributed_Generation_Integration_Effect_1a._IJEETC3b.pdf (1.56M)

Word count: 5164

Character count: 26516

Analysis of Distributed Generation Integration Effect on Active Power Losses in Distribution Networks

Zaenab Muslimin¹, Ansar Suyuti¹, Elyas Palantei¹, Indrabayu², and Indar Chaerah Gunadin¹

¹Department of Electrical Engineering, Hasanuddin University, Makassar, Indonesia

²Department of Informatics, Hasanuddin University, Makassar, Indonesia

Email: {zaenabandy; elyas.palantei; amirullahindrabayu; indareg}@gmail.com; asuyuti06@yahoo.com

Abstract—Distributed Generation (DG) is commonly used to reduce active power losses on a distribution network. The optimal location and size of DG will result in minimum active power losses and voltage profile improvement. This research proposes Novel Voltage Sensitivity Index (NVSI) and Stability Index (SI) methods to determine the optimal location and analytical expression to find optimal size and location of DG in Makassar distribution system, Feeder Kima, 76 buses to minimize active power losses and improve voltage profile. Therefore, DG interconnection has a significant effect on improving the quality of the distribution network. The results show that the sensitivity method does not lead to the best placement DG in reducing active power losses. However, it is an analytical expression, which is very effective in determining optimal location and size of DG to reduce active power losses and to improve voltage profile in Makassar distribution system, Feeder Kima, 76 buses. The most optimal location for DG placement is on Bus 73 (Mega Sakti Pyramid), with DG size of 0.8515MW. These combinations reduce 45.77% active power losses and increase 1.7336% voltage profile.

Index Terms—Active power losses, distributed generator, voltage profile, distribution networks, optimal location, novel voltage-sensitive index

I. INTRODUCTION

Electricity consumption in Indonesia increases every year as the national economic growth rises (Ministry of Energy and Mineral Resources, January 9, 2020). Generally, conventional power plants are designed on a large scale, centralized, and built far from the load center. Thus it requires extensive transmission and distribution networks to supply electricity. The longer the distance, the higher the power losses and voltage drops. In a distribution system, the X/R ratio (ratio of system reactance to system resistance) is higher than in a transmission system. Therefore, a significant voltage drop will result in power losses and the distribution network [1], [2]. Distributed Generation (DG), a smaller power size generator, is installed along with the network to overcome this problem. The general definition of DG is a distributed generation, which produces small-scale

electrical energy and is directly connected to the distribution network, and is close to the customer [3], [4].

Optimal placement of DG in the distribution network will reduce power system losses, improve voltage profile, increase reliability, and delay the investment of new construction on a distribution network. Otherwise, misplacement of DG will cause higher power losses [5], [6]. Installation of DG is one of the best alternatives to overcome several problems, such as high power losses, low reliability, and poor power quality. These problems often occur in electrical power distribution systems to meet the increasing demand. The small size of DG is easier and faster to be installed rather than conventional generation. To gain advantages of DG integration, such as lower power losses, higher voltage profile, and quality, DG must have proper size and location [7].

Optimal DG placement can be seen as optimal active power compensation, as capacitor placement for reactive power compensation, but DG placement is a relatively novel study and it is different from capacitor placement. It used the power flow algorithm to determine optimal DG size on each load bus and assumed that each load bus could have a DG source. However, this method is less efficient because it employs load flow on its most calculation [8]. Determination of DG size and location by genetic algorithm (GA) method has been studied by several researchers, GA is suitable for multipurpose problems such as DG placement and gives optimal results, but it requires more complex computations and slow convergence [9]. The analytical method is also applied to place DG in the radial grid system to minimize power losses. The method has a different expression for a radial system based on a complex procedure proposed phasor current to find DG location, but this method only optimizes location while DG size remains constant [10].

This research uses SI (Stability Index) and NVSI (Novel Voltage Sensitivity Index) methods to determine the most optimal DG location, while the analytical method is applied to find not only optimal DG location but also the size of DG. The analytical method is not computationally demanding, DG is assumed to be in the primary distribution system, and the purpose of placing DG is to reduce system power losses. The costs of DG and other related benefits are not considered in determining the location and size. The proposed

Manuscript received July 14, 2021; revised September 19, 2021; accepted September 30, 2021.

Corresponding author: Zaenab Muslimin (email: zaenabandy@gmail.com).

methodology is using single DG in the distribution network and it is capable of supplying active power.

II. DISTRIBUTED GENERATION (DG)

The International Energy Agency (IEA) defines DG as a generator that serves customers on-site supports network-connected distribution systems. The International Council of Large Electric System (CIGRE) defines DG as a generator that is not planned to be connected to a distribution system, or centrally distributed and has a small size of 50MW to 100MW. Other organizations, such as the Electric Power Research Institute (EPRI), define DG as generation from a few kilowatts to 50MW. In general, DG is a small-scale generation that directly connects consumers and producers [11].

Distributed generators (DG) can be grouped into four types according to their ability to inject active and reactive power as follows [12], [13]:

- Type 1: DG can inject active power only (e.g., Photovoltaic, microturbine, fuel cells).
- Type 2: DG can inject reactive power only (e.g., synchronous compensators)
- Type 3: DG can inject both active and reactive power (e.g., cogeneration, gas turbine)
- Type 4: DG can inject active power but consumes reactive power (e.g., induction generators in wind farms)

DG's primary function is to anticipate power grid disconnection or as a unit installed during peak load hours. In other words, DG is a stand-by unit. The characteristics of DG are small scale, scattered and close to the load center (closed to load), interconnected with the distribution system, limiting the construction of transmission networks, and having one-way power flow. These generations are environmentally friendly, reliable in responding to load changes, reducing fossil fuels, and deregulation in the electricity market, and some other advantages [14].

III. OPTIMAL LOCATION AND SIZE OF DISTRIBUTED GENERATORS

DG integration with proper planning needed to improve network performance related to active power losses and voltage profiles. However, misplacement and wrong size of DG will result in increased power losses, voltage imbalances, and power quality problems [15]. Therefore, the best location and appropriate DG size must be found before connecting to the distribution system. There are many methods proposed by researchers for optimal placement, including:

- Numerical based approach
- Analytical approach
- Meta-heuristic approach
- Sensitivity-based approach

For this research, analytical and sensitivity-based approaches are considered for the optimal size and location of DG using the SI and NVSI methods.

A. Optimal Location DG Using the Sensitivity Method

The most advantageous placement of DG is to place it on the bus, which has the lowest voltage. In this study,

two different sensitivity indices are used for optimal placement of DG locations; there are NVSI and SI [16], [17].

NVSI is expressed as

$$NVSI = \frac{2X\sqrt{P_r^2 + Q_r^2}}{2Q_r X - V_s^2} \quad (1)$$

where X is the line distance, V_s is the voltage at the sending end, P_r is the real power at the receiving end, and Q_r is the reactive power at the receiving end.

NVSI shows that the maximum value is considered the most susceptible value to voltage collapse. Therefore, the bus with a maximum sensitivity index value is considered a candidate bus for DG installation.

SI is expressed as

$$SI = 2V_s^2 V_r^2 - V_r^4 - 2V_r^2 (P_r R + Q_r X) - Z^2 (P_r^2 + Q_r^2) \quad (2)$$

where V_r is the voltage at the receiving end, R is the line resistance, and Z is the line impedance.

For the sensitivity index, the bus with the minimum SI value is considered the most susceptible value to voltage collapse. Thus, the bus that shows the smallest/minimum SI is considered the optimal DG location [18], [19].

B. Optimal Location and Size Using Analytical Methods

Active power loss P_{loss} in an electrical power system can be determined using equation (3), which is often known as the "exact loss formula" [20].

$$P_{loss} = \sum_{i=1}^n \sum_{j=1}^n [a_{ij} \{P_i P_j + Q_i Q_j\} + b_{ij} \{Q_i P_j - P_i Q_j\}] \quad (3)$$

where

$$a_{ij} = \frac{r_{ij}}{v_i v_j} \cos\{\delta_i - \delta_j\} \quad (4)$$

$$b_{ij} = \frac{r_{ij}}{v_i v_j} \sin\{\delta_i - \delta_j\} \quad (5)$$

and r_{ij} is the ij th real element of the Z_{bus} matrix, v_i and δ_i is the voltage and angle on bus i , v_j and δ_j is the voltage and angle on bus j , P_i and P_j is the active power on buses i and j , and Q_i and Q_j is the reactive power on buses i and j .

The active and reactive power injected on bus i , where DG is installed, can be written as follows:

$$P_i = P_{DG} - P_{Di} \quad (6)$$

$$Q_i = Q_{DG} - Q_{Di} = (\text{apf} \cdot P_{DG}) - Q_{Di} \quad (7)$$

where P_{DG} and Q_{DG} are the active and reactive power of injected DG, P_{Di} and Q_{Di} are the active power load and reactive power load on bus i , and apf is defined as

$$\text{apf} = \left\{ \begin{array}{l} \text{sign} \left\{ \cos^{-1} \left(\text{PF}_{\text{DG}} \right) \right\} \\ = \left\{ \begin{array}{l} 1 \text{ if DG injected reactive power} \\ -1 \text{ if DG absorbed reactive power} \end{array} \right. \end{array} \right. \quad (8)$$

here PF_{DG} is the DG power factor. 43

Substituting (6) and (7) into (3), the active power loss with DG is obtained as follows:

$$P_{\text{loss}} = \sum_{i=1}^n \sum_{j=1}^n \left[a_{ij} \left\{ P_{\text{DG}i} - P_{D_i} \right\} P_j + \left((\text{apf} \cdot P_{\text{DG}i}) - Q_{D_i} \right) Q_j \right] + \left[b_{ij} \left\{ (\text{apf} \cdot P_{\text{DG}i}) - Q_{D_i} \right\} P_j - (P_{\text{DG}i} - P_{D_i}) Q_j \right] \quad (9)$$

where $P_{\text{DG}i}$ and $Q_{\text{DG}i}$ are the active power and reactive power of injected DG into bus i . 45

The system's active power losses can reach a minimum value by partial differentiating of (7) on the active power from DG on the bus i ($P_{\text{DG}i}$) to zero.

$$\frac{\partial P_{\text{loss}}}{\partial P_{\text{DG}i}} = 2 \sum_{j=1}^n \left\{ a_{ij} \left(P_j + (\text{apf} \cdot Q_j) \right) + b_{ij} \left((\text{apf} \cdot P_j) - Q_j \right) \right\} \quad (10)$$

= 0

Equation (10) can be written as follows:

$$a_{ii} \left\{ P_i + (\text{apf} \cdot Q_i) \right\} + b_{ii} \left\{ (\text{apf} \cdot P_i) - Q_i \right\} + \sum_{j=1, j \neq i}^n \left(a_{ij} P_j - b_{ij} Q_j \right) + \text{apf} \sum_{j=1, j \neq i}^n \left(a_{ij} Q_j + b_{ij} P_j \right) = 0 \quad (11)$$

For example:

$$X_i = \sum_{j=1, j \neq i}^n \left(a_{ij} P_j - b_{ij} Q_j \right) \quad (12)$$

$$Y_i = \sum_{j=1, j \neq i}^n \left(a_{ij} Q_j - b_{ij} P_j \right) \quad (13)$$

From (6), (7), (11), (12), and (13), we obtain:

$$a_{ii} \left\{ P_{\text{DG}i} - P_{D_i} + \text{apf}^2 \cdot P_{\text{DG}i} - \text{apf} \cdot Q_{D_i} \right\} + b_{ii} \left\{ Q_{D_i} - \text{apf} \cdot P_{D_i} \right\} + X_i + aY_i = 0 \quad (14)$$

From equation (14), the optimal size of DG on the bus i to minimize power loss is written as in equation (15):

$$P_{\text{DG}i} = \frac{1}{\text{apf}^2 \cdot a_{ii} + a_{ii}} \left[a_{ii} \left(P_{D_i} + \text{apf} \cdot Q_{D_i} \right) + b_{ii} \left(\text{apf} P_{D_i} - Q_{D_i} \right) - X_i - \text{apf} \cdot Y_i \right] \quad (15)$$

Reduction of active power loss after DG integration to the system is given on the following equation:

$$\text{Active Power Loss Reduction} = \frac{P_{\text{loss}} - P_{\text{loss}}^{\text{DG}}}{P_{\text{loss}}} 100\% \quad (16)$$

Active power losses of the system can reach the minimum value by partial differentiating of (7) on the active power from DG on the bus i ($P_{\text{DG}i}$) to zero. 46

Power factor of DG depends on operating conditions and type of DG. When DG power factor is known, the optimal size of DG on the bus i to minimize power losses can be determined in the following ways [21]:

- DG Type 1; Power factor is 1, therefore $\text{apf} = 0$, from equation (15), the optimal capacity of DG on the bus i to minimize power losses can be given by the equation:

$$P_{G_i} = P_{D_i} + \frac{1}{a_{ii}} \left\{ b_{ii} Q_i - \sum_{j=1, j \neq i}^n \left(a_{ij} P_j - b_{ij} Q_j \right) \right\} \quad (17)$$

- DG Type 2; Power factor is assumed to be 2 and $\text{apf} = \infty$, from equation (15), the optimal size of DG on the bus i to minimize power loss is given on the following equation:

$$Q_{\text{DG}i} = Q_{D_i} + \frac{1}{a_{ii}} \left\{ b_{ii} P_i - \sum_{j=1, j \neq i}^n \left(a_{ij} Q_j - b_{ij} P_j \right) \right\} \quad (18)$$

- DG Type 3; Power factor is between 0 and 1, $\text{sign} = +1$, and apf is constant, thus the optimum capacity of DG on the bus i to minimize power losses is given in equations (9) and (17).
- DG Type 4; Power factor is between 0 and 1, $\text{sign} = -1$, and apf is constant, thus the optimum capacity of DG on the bus i to minimize losses is given in equations (7) and (15).

After optimal DG size on each bus is obtained, the next step is to find active power losses by consecutively using the optimal DG size on each bus. Calculation of active power losses when 24 is placed requires several power flow solutions, such as the number of buses in the system. When DG is installed in the system, the value of the losses coefficient will change since it depends on the voltage and phase angle variables. Therefore, an approach method is needed to find the estimated power losses, which will give the best DG placement location. [22], [23].

IV. RESULT AND DISCUSSION 28

To analyze the performance of the proposed method, the Makassar Distribution System, Feeder Kima, 76 bus, as a tested system, is constructed in Fig. 1. Direct load flow analysis is applied to calculate power losses, voltage magnitudes, and phase angles in various buses.

DG Type 1 is used in this research, and it only injects active power into the system. 30 used on the analytical method's proposed approach, the optimal DG size for each bus in the Makassar distribution system, Feeder Kima, 76 buses is given 22 Fig. 2.

Fig. 2 indicates that the size of DG varies and does not depend on the location of the bus. After connecting DG on each bus (one at a time consecutively), the minimum active power losses will be obtained on the corresponding bus. In the Makassar Distribution System, Feeder Kima, 76 buses, optimal DG size ranges from 0.019MW to 5.438MW.

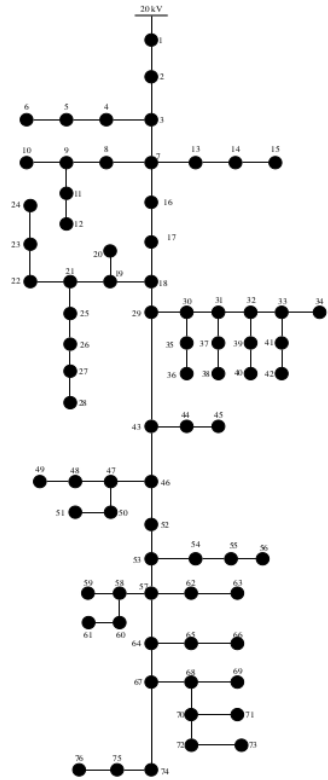


Fig. 1. Makassar Distribution System, Feeder Kima, 76 Buses

42

The optimal placement of DG in Makassar Distribution System, Feeder Kima, 76 buses, is conducted using (NVSI and SI sensitivity approaches). The result of the NVSI sensitivity index is given in Fig. 3, where bus 45 shows the highest NVSI value. Therefore bus 45 is considered the optimal location for DG, and the results of the SI sensitivity index are shown in Fig. 4, where it can be seen that bus 28 shows the minimum SI value. Thus bus 28 is considered the optimal DG location. In contrast, the optimal location for DG placement using the analytical method is located with minimum system power losses. Hence, determination of optimal DG location is carried out by placing DG on each bus at a time, consecutively, with a capacity as shown in Fig. 2, and the result is shown in Fig. 5. Based on Fig. 5, it can be seen that the minimum active power loss is on bus 73; therefore the optimal DG location is on bus 73.

As a result, there are three DG placement locations, and these locations (bus 28, bus 45, and bus 73) will be simulated. The simulation results are given in Table I and Table II.

TABLE I: ACTIVE POWER LOSS BEFORE AND AFTER DG IS INSTALLED ON THE CANDIDATE BUS

Bus Number	Size DG (MW)	Active Power Losses (MW)		Losses Reduction (%)
		Before DG is installed	After DG is installed	
28	0.29220	0.156100	0.161068	-3.183
45	0.19340	0.156100	0.150023	3.893
73	0.85150	0.156100	0.084638	45.770
Size DG (0.5DG) Bus 73		0.156100	0.093745	39.946
Size DG (2DG) Bus 73		0.156100	0.207772	-33.102
Size DG (3DG) Bus 73		0.156100	0.479453	-207.140

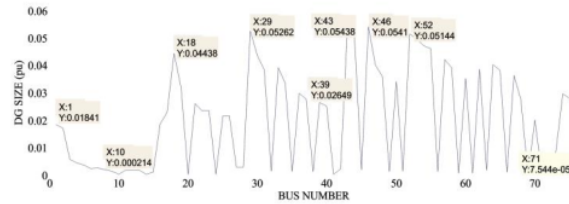


Fig. 2. Graph of DG Size on each bus of Makassar distribution system, feeder Kima, 76 buses

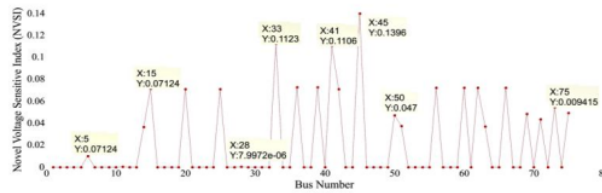


Fig. 3. NVSI Makassar distribution system, feeder Kima, 76 buses

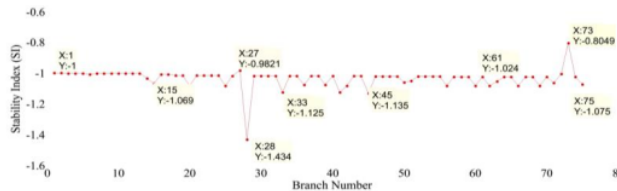


Fig. 4. SI, Makassar distribution system, feeder Kima 76 buses

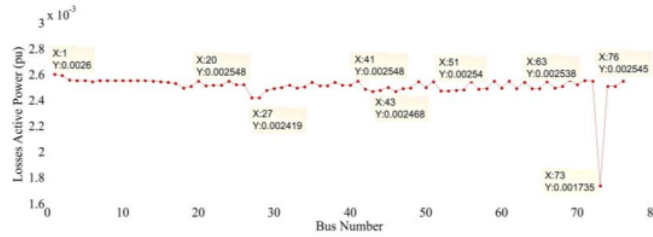


Fig. 5. Active power losses when DG is installed on each bus.

TABLE II: VOLTAGE PROFILE AFTER DG IS INSTALLED ON SOME WEAK BUSES

Bus No.	Size DG (MW)	Voltage (pu) before DG is installed	Voltage After DG is Installed on					
			Bus 28 (pu)	Delta (%)	Bus 45 (pu)	Delta (%)	Bus 73 (pu)	Delta (%)
28	0.292	1.0040	1.004	0.012	1.004	0.013	1.004	0.051
42	0.214	0.9065	0.906	0.020	0.906	0.018	0.907	0.072
45	0.193	0.9326	0.932	0.016	0.932	0.017	0.933	0.080
56	0.116	0.9674	0.967	0.015	0.967	0.019	0.968	0.094
63	0.180	0.9673	0.967	0.015	0.967	0.019	0.968	0.099
73	0.851	0.8729	0.87	0.019	0.873	0.024	0.972	10.242
Average voltage rise (%)				0.0165		0.0187		1.7736

Table I gives the value of active power losses before and after DG is installed on bus 28 (SI sensitivity result), bus 45 (NVSI sensitivity result), and bus 73 (analytical method). It can be seen that among the three buses, minimum active power losses occurred on bus 73 with a DG size of 0.8515MW, and its value reached 0.084638MW. There is a significant decline in active power losses to 45.77%. Active power losses are significant when DG is placed on buses 28 and 45. Therefore, the most optimal location of DG is on bus 73 based on the analytical method. When DG size on bus 73 is doubled, active power losses increase to 33.102%, as well, when DG size is enlarged three times, increasing of active power losses reach 207.14%. Reducing DG size to half of its capacity (0.5 DG) will reduce active power losses, but not at the minimum value. Thus, a larger DG size does not always indicate a more considerable reduction of active power losses, nor smaller size indicates higher active power losses reduction. It can be concluded that the most optimal placement of DG in Makassar Distribution System, Feeder Kima, 76 Buses is on bus 73 (Mega Sakti Pyramid Bus) and optimal DG size is 0.8515MW. It will result in minimum active power losses of 0.084638MW and percentage reduction of 45.77%.

Table II shows voltage variations on several buses by placing DG on a selected bus: bus 28, bus 45, and bus 73 with DG capacity based on Fig. 2. The results show that voltage increases in each bus when DG is installed on bus 28, bus 45, and bus 73. DG 0.2922MW is installed on bus 28, the voltage profile increases by an average of 0.0165%; DG 0.1934MW installed on bus 45, the voltage profile increased by an average of 0.0187%; DG 0.8515MW is installed on bus 73, the voltage profile increases by an average of 1.7736%. The highest percentage on voltage profile gained 6.5 happened when DG is installed on bus 73. Therefore, the optimal location and size of DG will reduce active power losses and improve voltage profile.

V. CONCLUSION

This research has proposed sensitivity method, NVSI and SI, to determine the optimal location of DG and analytical methods to find the optimal size of DG and minimum active power losses of primary distribution for optimal DG placement. The results give the optimal candidate locations for the Makassar Distribution System, Feeder Kima, 76 buses are bus 28 (SI), bus 45 (NVSI), and bus 73 (analytical method). Active power loss based on the placement and size of DG is varied. Thus, the optimal location and size of DG are essential factors in DG application in reducing active power losses and improving voltage profiles. Bus 73 (Mega Sakti Pyramid) is the best location for DG placement, and DG size is 0.85150MW, it results in reducing active power loss to 45.77% and increasing voltage profile to 1.7736%.

CONFLICT OF INTEREST

The authors declare no conflicts of interest.

AUTHOR CONTRIBUTIONS

Zaenab Muslimin and Indar Chaerah Gunadin conducted the research and preparation for the manuscript. Ansar Suyuti, Elyas Palantei, and Indrabayu helped to check the whole manuscript and approved the final version.

REFERENCES

- [1] D. Q. Hung, N. Mithulananthan, and R. C. Bansal, "Analytical expressions for DG allocation in primary distribution networks," *IEEE Trans. on Energy Conversion*, vol. 25, no. 3, pp. 814-820, September 2010.
- [2] Z. Muslimin, A. Suyuti, E. Palantei, Indrabayu, and I. C. Gunadin, "Reactive power injection at the North Makassar distribution system with D-STATCOM," in *Proc. IOP Conf. Series: Material Science and Engineering, International Symposium on Material Electrical Engineering*, vol. 850, July 2020, pp. 1-10.
- [3] R. Srinath and P. Sangeetha, "Reduction of losses and improving

voltage by optimal location of DG," *International Journal of Engineering Research & Technology*, vol. 2, no. 11, pp. 1926-1930, November 2013.

[4] F. Gonzalez, Longatt, and C. Fortoul, "Review of the distributed generation concept: Attempt of unification," *RE&PQJ*, vol. 1, no. 3, pp. 281-284, 2005.

[5] D. B. Prakasha and C. Lakshminarayana, "Multiple DG placements in distribution system for power loss reduction using PSO algorithm," *Procedia Technology*, vol. 25, pp. 785-792, 2016.

[6] S. H. Win and P. L. Swe, "Loss minimization of power distribution network using different types of distributed generation unit," *International Journal of Electrical and Computer Engineering*, vol. 5, no. 5, pp. 918-928, Oct. 2015.

[7] K. M. S. Alzaidi, O. Bayat, and O. N. Uçan, "Multiple DGs for reducing total power losses in radial distribution systems using hybrid WOA-SSA algorithm," *International Journal of Photoenergy*, March 2019.

[8] K. R. Devalalaji and K. Ravi, "Optimal size and siting of multiple DG and DSTATCOM in radial distribution system using bacterial foraging optimization algorithm," *Ain Shams Engineering Journal*, vol. 7, no. 3, pp. 959-971, Sept. 2016.

[9] B. Singh and M. K. Yadav, "GA for enhancement of system performance by DG incorporated with DSTATCOM in distribution power networks," *Journal of Electri. Sys. and Inform. Techno.*, Feb. 2018.

[10] S. Zhang, H. Cheng, K. Li, N. Tai, D. Wang, and F. Li, "Multi-objective distributed generation planning in distribution network considering correlations among uncertainties," *Applied Energy*, vol. 226, pp. 743-755, June 2018.

[11] G. Pepermansa, J. Driesenb, D. Haeseldonckxc, R. Belmansc, and W. D'haeseleerc, "Distributed generation: definition, benefits and issues," *Energy Policy*, vol. 33, pp. 787-798, April 2005.

[12] A. H. Ahmeda and S. Hasan, "Optimal allocation of distributed generation units for converting conventional radial distribution system to loop using particle swarm," *Energy Procedia*, vol. 153, pp. 118-124, Oct. 2018.

[13] P. Mehta, P. Bhatt, and V. Pandya, "Optimal selection of distributed generating units and its placement for voltage stability enhancement and energy loss minimization," *Ain Shams Engineering Journal*, vol. 9, pp. 187-201, June 2018.

[14] B. Das and D. B. C. Deka, "Impact of distributed generation on reliability of distribution system," *IOSR Journal of Electrical and Electronics Engineering*, vol. 8, no. 1, pp. 42-50, 2013.

[15] K. S. Sambaiah and T. Jayabarathi, "Loss minimization techniques for optimal operation and planning of distribution systems: A review of different methodologies," *International Trans. Electrical Energy System*, vol. 30, no. 2, pp. 1-48, Feb. 2020.

[16] T. Yuvaraj and K. Ravi, "Multi-objective simultaneous DG and DSTATCOM allocation in radial distribution networks using cuckoo searching algorithm," *Alexandria Engineering Journal*, vol. 57, pp. 2729-2742, Dec. 2018.

[17] J. Modarresi, E. Gholipour, and A. Khodabakhshian, "A comprehensive review of the voltage stability indices," *Renewable and Sustainable Energy Reviews*, vol. 63, pp. 1-12, Sept. 2016.

[18] A. R. Gupta and N. Kurukshetra, "Effect of optimal allocation of multiple DG and DSTATCOM in radial distribution system for minimising losses and THD," in *Proc. 7th International Symposium on Embedded Computing and System Design*, 2017.

[19] V. V. S. N. Murty and A. Kumar, "Optimal placement of DG in radial distribution systems based on new voltage stability index under load growth," *Electrical Power and Energy Systems*, vol. 69, pp. 246-256, July 2015.

[20] T.S. Tawfeek, A. H. Ahmed, and S. Hasan, "Analytical and particle swarm optimization algorithms for optimal allocation of four different distributed generation types in radial distribution networks," in *Proc. 5th Int. Conf. on Energy and Environment Research*, 2018, pp. 86-94.

[21] T. Yuvaraj, K. Ravi, and K. R. Devalalaji, "Optimal allocation of DG and DSTATCOM in radial distribution system using cuckoo search optimization algorithm," *Modelling and Simulation in Engineering*, vol. 2017, 2017.

[22] Z. Muslimin, A. Suyuti, E. Palantei, Indrabayu, and I. C. Gunadin, "A new perspective in power loss reduction of ninety two buses integrated D-STATCOM," *Przeglad Elektrotechniczny*, 2020.

[23] N. Acharya, P. Mahat, and N. Mithulananthan, "An analytical approach for DG allocation in primary distribution network," *Electrical Power and Energy Systems*, vol. 28, pp. 669-678, Dec. 2006.

Copyright © 2022 by the authors. This is an open access article distributed under the Creative Commons Attribution License (CC BY-NC-ND 4.0), which permits use, distribution and reproduction in any medium, provided that the article is properly cited, the use is non-commercial and no modifications or adaptations are made.



Zaenab Muslimin was born on February 2nd, 1966 in Ujung Pandang, South Sulawesi, Indonesia and was graduated from Universitas Hasanuddin, Makassar, Indonesia for bachelor in 1990 and magister in 2004. Her major field is Electrical Power Engineering. She is a lecturer at Universitas Hasanuddin, Department of Electrical Engineering. Her research interest includes power system protection and measurement. Ir. Zaenab Muslimin, MT is also active as a member of the Indonesian Engineers Union.



Ansar Suyuti was born on the 31st of December 1967 in Sidrap, South Sulawesi Indonesia, and was graduated from Universitas Hasanuddin, Makassar, Indonesia for a bachelor in 1991, magister in 2002, and doctoral education in 2013. His major field is Electrical Power Engineering. He is a professor with the Department of Electrical Engineering, Universitas Hasanuddin. Currently, he is the Head of Power System Distribution Laboratory. He has been published many publications in the field of electrical power engineering. His research interests include distributed generation planning, sensor network, and environmental engineering.

Prof. Ir. Ansar Suyuti, MT, IPU.ASEAN.Eng is also active as a member of the association of electrical power engineering expert and as assessor of national accreditation bureau for higher education



Elyas Palantei was born in Bone (1969), South Sulawesi Province, Indonesia. He received Sarjana Teknik (ST ~ B.Eng) degree from the Department of Electrical Engineering, Universitas Hasanuddin (UNHAS), Indonesia (1994) specialized in Telecommunication and Electronics Engineering. He pursued the pre-postgraduate course in natural science at the same university (1996-1997). He received the Magister Engineering (M.Eng) degree in Telecommunication Engineering Program from the School of Advanced Technology (SAT), Asian Institute of Technology (AIT), Bangkok, Thailand (2001). He received the award of Ph.D. degree from the Centre for Wireless Monitoring and Applications (CWMA), Griffith School of Engineering, Griffith University, Australia (2012). Since December 1994, he has been with the Electrical Engineering Department, UNHAS, Indonesia. Currently, He has published more or less 100 research manuscripts in national/international events such as seminars, symposiums, and workshops. One of his publications is A Smart RF Harvesting Energy Absorber Applied for Low Electrical Power Charging Unit in Photonics & Electromagnetics Research Symposium-Fall (PIERS-Fall) 2019. His current research interest includes smart antenna technology for wireless communications, coding and modulation, robotics, satellite communication, RF circuit design, mobile computing, underwater communication, biomedical engineering, Smart card-based smart campus, renewable energy for low power consumption electronic appliances, smart transportation systems, smart city/ smart society, microcontroller programming and many more. Dr. Elyas Palantei is a member of several professional organizations such as IEEE, PII, Indonesian Smart Card Consortium, and Indonesian

Communication and Information Technology Consortium.



Indrabayu was born in July 1975 in Makassar, Indonesia. He earned a Bachelor's degree in Electrical Engineering from Hasanuddin University in 1999 and a Master's degree in Multimedia & Communication from Institut Teknologi 10 November, Surabaya, in 2005. Indrabayu was awarded the Summa Cum Laude from a Doctor of Artificial Engineering in Civil Applications from Hasanuddin University, Makassar, Indonesia, in 2013.

His current job is as a lecturer and serves as secretary of the Department of Informatics, Universitas Hasanuddin. In addition, he also serves as Head of the Artificial Intelligence Laboratory, which is in line with his research interests in the field of artificial intelligence and multimedia processing. For three consecutive years, he received a research grant from the Ministry of Education and produced several publications. Some of them have been published in Scopus indexed journals such as the Journal of Engineering Science & Technology and the International Journal of Interactive Mobile Technologies. Dr Indrabayu is an active member of IEEE and IAENG.



Indar Chaerah Gunadin was born in November 1973 in Palopo, South Sulawesi, Indonesia, and was graduated from Universitas Hasanuddin, Makassar, Indonesia for a bachelor in 1997 with a major field is Electrical Power Engineering. He received a master's degree and Ph.D. degree from Sepuluh Nopember Institute of Technology (ITS), Indonesia in 2006 and 2013, respectively.

He is a lecturer at Universitas Hasanuddin, Department of Electrical Engineering since 1998. Currently, he is head of relay, protection, and control laboratory in the Electrical Engineering Department of Universitas Hasanuddin. He has been published many manuscripts in the field of electrical power engineering. One of his publications is the impact of the injection of a wind power plant on steady-state condition and the dynamics of SULSELBAR power system in International Journal of Electrical and Electronic Engineering & Telecommunications, Vol. 8, No. 6, Nov 2019. His research interest includes power system stability, FACTS Device, Artificial Intelligent, and control.

Dr. Indar Chaerah Gunadin is a member of the Indonesian Engineers Union, Indonesian Electrical Engineering Higher Education Forum, and Indonesian Electrical Engineering Experts Association.

ORIGINALITY REPORT

17%

SIMILARITY INDEX

9%

INTERNET SOURCES

15%

PUBLICATIONS

5%

STUDENT PAPERS

PRIMARY SOURCES

- 1 M. Mosbah, S. Arif, R. D. Mohammedi. "Multi-objective optimization for optimal multi DG placement and sizes in distribution network based on NSGA-II and fuzzy logic combination", 2017 5th International Conference on Electrical Engineering - Boumerdes (ICEE-B), 2017
Publication 1%
- 2 Syahrial Shaddiq, Dian Budhi Santoso, Fikriyan Fajar Alfarobi, Sarjiya, Sasongko Pramono Hadi. "Optimal capacity and placement of distributed generation using metaheuristic optimization algorithm to reduce power losses in Bantul distribution system, Yogyakarta", 2016 8th International Conference on Information Technology and Electrical Engineering (ICITEE), 2016
Publication 1%
- 3 Submitted to Victoria University
Student Paper 1%

4

Arya, L.D., Atul Koshti, and S.C. Choube. "Distributed generation planning using differential evolution accounting voltage stability consideration", International Journal of Electrical Power & Energy Systems, 2012.

Publication

1 %

5

K.R. Devabalaji, K. Ravi. "Optimal size and siting of multiple DG and DSTATCOM in radial distribution system using Bacterial Foraging Optimization Algorithm", Ain Shams Engineering Journal, 2016

Publication

1 %

6

digilib.unila.ac.id

Internet Source

1 %

7

Kuo-Ming Chu, Hui-Chun Chan, Chi-Fang Liu. "Investigating the Role of Alliance Knowledge Learning and Institutional Isomorphism in Strategic Alliance Performance of Green Supply Chain", International Journal of e-Education, e-Business, e-Management and e-Learning, 2022

Publication

1 %

8

Olusayo A. Ajeigbe, Josiah L. Munda, Yskandar Hamam. "Towards maximising the integration of renewable energy hybrid distributed generations for small signal stability enhancement: A review", International Journal of Energy Research, 2020

1 %

9	dspace.dtu.ac.in:8080 Internet Source	1 %
10	Ashutosh Kumar Tagore, Atma Ram Gupta. "Impact of DG and D-STATCOM allocation in radial distribution system for reducing harmonics", 2017 8th International Conference on Computing, Communication and Networking Technologies (ICCCNT), 2017 Publication	1 %
11	Patel, Yogesh P., and Ashvin G. Patel. "Placement of DG in Distribution System for loss reduction", 2012 IEEE Fifth Power India Conference, 2012. Publication	1 %
12	Submitted to Universitas Mataram Student Paper	<1 %
13	Submitted to University of Glasgow Student Paper	<1 %
14	www.ijrte.org Internet Source	<1 %
15	"Techno-Societal 2018", Springer Science and Business Media LLC, 2020 Publication	<1 %
16	Shelly Vadhera, Shreya Mahajan. "Optimal allocation of dispersed generation unit in a	<1 %

network system", 2016 International Conference on Microelectronics, Computing and Communications (MicroCom), 2016

Publication

17

Yalew Gebru Werkie, Habtemariam Aberie Kefale. "Optimal allocation of multiple distributed generation units in power distribution networks for voltage profile improvement and power losses minimization", Cogent Engineering, 2022

Publication

<1 %

18

P. Alemi, G.B. Gharehpetian. "DG allocation using an analytical method to minimize losses and to improve voltage security", 2008 IEEE 2nd International Power and Energy Conference, 2008

Publication

<1 %

19

R.K. Singh, S.K. Goswami. "Optimum allocation of distributed generations based on nodal pricing for profit, loss reduction, and voltage improvement including voltage rise issue", International Journal of Electrical Power & Energy Systems, 2010

Publication

<1 %

20

L. Gyugyi, K.K. Sen, C.D. Schauder. "The interline power flow controller concept: a new approach to power flow management in

<1 %

transmission systems", IEEE Transactions on Power Delivery, 1999

Publication

21

Submitted to VIT University

Student Paper

<1 %

22

pserc.wisc.edu

Internet Source

<1 %

23

Tu Jing-jing, Yin Zhong-dong. "An evaluation index of voltage stability of distribution network considering DG", 2017 2nd International Conference Sustainable and Renewable Energy Engineering (ICSREE), 2017

Publication

<1 %

24

inass.org

Internet Source

<1 %

25

www.mdpi.com

Internet Source

<1 %

26

www.mecs-press.org

Internet Source

<1 %

27

"Decision Analytics Applications in Industry", Springer Science and Business Media LLC, 2020

Publication

<1 %

28

Shashank Shekhar Kashyap, Mala De. "Loss allocation and loss minimisation for radial

<1 %

distribution system including DGs", IET Renewable Power Generation, 2017

Publication

29

www.degruyter.com

Internet Source

<1 %

30

C. Nayanatara, J. Baskaran, D.P. Kothari.
"Hybrid optimization implemented for
distributed generation parameters in a power
system network", International Journal of
Electrical Power & Energy Systems, 2016

Publication

<1 %

31

irdindia.in

Internet Source

<1 %

32

koreascience.or.kr

Internet Source

<1 %

33

research.vit.ac.in

Internet Source

<1 %

34

"Applications of Artificial Intelligence
Techniques in Engineering", Springer Science
and Business Media LLC, 2019

Publication

<1 %

35

F. Torrent-Fontbona, B. López. "Decision
support for grid-connected renewable energy
generators planning", Energy, 2016

Publication

<1 %

36

Hamid HassanzadehFard, Alireza Jalilian. "A novel objective function for optimal DG allocation in distribution systems using meta-heuristic algorithms", International Journal of Green Energy, 2016

Publication

<1 %

37

Ontoseno Penangsang, Dimas Fajar Uman Putra, Taufani Kurniawan. "Optimal placement and sizing of distributed generation in radial distribution system using K-means clustering method", 2017 International Seminar on Intelligent Technology and Its Applications (ISITIA), 2017

Publication

<1 %

38

Sultana, U., Azhar B. Khairuddin, M.M. Aman, A.S. Mokhtar, and N. Zareen. "A review of optimum DG placement based on minimization of power losses and voltage stability enhancement of distribution system", Renewable and Sustainable Energy Reviews, 2016.

Publication

<1 %

39

oaji.net
Internet Source

<1 %

40

pt.scribd.com
Internet Source

<1 %

41

ujcontent.uj.ac.za
Internet Source

<1 %

42

www.hindawi.com

Internet Source

<1 %

43

www.iaeng.org

Internet Source

<1 %

44

AlRashidi, M.R.. "Optimal planning of multiple distributed generation sources in distribution networks: A new approach", Energy Conversion and Management, 201110

Publication

<1 %

45

Kang, Q.. "Group search optimizer based optimal location and capacity of distributed generations", Neurocomputing, 20120215

Publication

<1 %

46

Ruhaizad Ishak, Azah Mohamed, Ahmed N. Abdalla, Mohd Zamri Che Wanik. "Optimal placement and sizing of distributed generators based on a novel MPSI index", International Journal of Electrical Power & Energy Systems, 2014

Publication

<1 %

47

M. F. AlHajri, M. R. AlRashidi, M. E. El-Hawary. "Improved Sequential Quadratic Programming Approach for Optimal Distribution Generation Deployments via

<1 %

Stability and Sensitivity Analyses", Electric Power Components and Systems, 2010

Publication

48

Reza Sirjani, Ahmad Rezaee Jordehi. "Optimal placement and sizing of distribution static compensator (D-STATCOM) in electric distribution networks: A review", Renewable and Sustainable Energy Reviews, 2017

Publication

<1 %

Exclude quotes On

Exclude matches < 5 words

Exclude bibliography On